

# GOVT. OF WEST BENGAL Irrigation & Waterways Directorate

### NATIONAL HYDROLOGY PROJECT

NH-2,Purta Bhawan,  $3^{rd}$ Floor, Purba Burdwan-713103  $\underline{\text{Tel:}+91342-2646799}$ Fax:+91342-2646799Email: eebipd2012@gmail.com / bengalsw@gmail.com

Contact details for this bidding process & documents

Telephones: 0342-2646799 & E-mail: eebipd2012@gmail.com

# NATIONAL COMPETITIVE BIDDING FOR

(Two-Envelope Bidding Process with e-Procurement)

"Supply, installation, testing, commissioning, training, Operation and maintenance of SCADA based Automatic Operation of Durgapur Barrage"

BID REFERENCE : NHP-2018-2019-WBSW-544004-GO-NCB-DE

Bid Published Date : 21-06-2019

DATE OF COMMENCEMENT OF

SALE/Download OF BIDDING DOCUMENT : 22-06-2019, 11:30 Hrs onwards

Clarification Start Date/time : 24-06-2019, 10.00 Hrs

Clarification End Date/time : 05-07-2019, 15.00 Hrs

Pre-bid meeting Date/time : 08-07-2019, 11:30 Hrs

Bid Submission Start Date/time : 17-07-2019, 10.00 Hrs

Bid Document Download/sale End date/ time : 23-07-2019, 12.00 Hrs

Bid Submission End Date/time : 23-07-2019,15.00 Hrs

TIME AND DATE OF OPENING

OF BIDS- Technical Part : 23-07-2019, 15:30 Hrs


OFFICER INVITING BIDS : The Executive Engineer

Burdwan Investigation & Planning Division Irrigation & Waterways Directorate

Govt. of West Bengal

Purta Bhawan, 3<sup>rd</sup> Floor Purba Burdwan-713103

e-mail: eebipd2012@gmail.com



### NATIONAL COMPETITIVE BIDDING FOR

(Two-Envelope Bidding Process with e-Procurement)

"Supply, installation, testing, commissioning, training, Operation and maintenance of SCADA based Automatic Operation of Durgapur Barrage"

# **INVITATION FOR BIDS (IFB) E-Procurement Notice**

Memo No: 247/NHP-02/02 Date: 21-06-2019

Loan No. : 8725-IN

IFB No. : *WBIW/NHP/IFB-04/2019-20* 

REFERENCE : NHP-2018-2019-WBSW-544004-GO-NCB-DE

- 1. This Invitation For Bid follows the General Procurement Notice for this Project that appeared in Development Business on 9<sup>th</sup> March, 2017.
- 2. The Government of India has received financing from the World Bank towards the cost of *National Hydrology Project* and it is intended that part of the proceeds will be applied to eligible payments under the contract for which this invitation of bids is issued.
- 3. The Executive Engineer, Burdwan Investigation & Planning Division, I&WD, Govt. of WB, NH-2, Purta Bhawan, 3<sup>rd</sup> Floor, Purba Burdwan-713103(Purchaser)now invites online bids from eligible bidders for supply of-
  - (a) Complete package of Supply, installation and commissioning of SCADA system for Durgapur Barrage Reservoir automation & monitoring along with Host Server, RTUs, etc., as required for the project, including last mile connection of civil and electrical works, for main work site at Durgapur Barrage
  - (b) Comprehensive Warranty, operation & maintenance for a period of five (5) year from the date of successful commissioning of the project for the supplied and installed articles used for the project along with 5-year warranty for installed software for hassle free running of the whole system and
- 4. Bidding will be conducted through the National Competitive Bidding (NCB) procedures agreed with World Bank. The bidding is open to all eligible bidders as defined in the Bank's Procurement Guidelines. In addition, please refer to paragraphs 1.6 and 1.7 of the Guidelines setting forth the World Bank's policy on conflict of interest.
- 5. Bidding documents are available online on <a href="www.wbtenders.gov.in">www.wbtenders.gov.in</a> For downloading free of cost Bidders will be required to register in the website, which is free of cost. The bidder would be responsible for ensuring that any addenda available on the website is also downloaded and incorporated.

Price of bidding document : Free Available online at <a href="https://wbtenders.gov.in">https://wbtenders.gov.in</a>

DATE OF COMMENCEMENT OF

SALE/Download OF BIDDING DOCUMENT : 22-06-2019, 11:30 Hrs onwards

Clarification Start Date/time : 24-06-2019, 10.00 Hrs

Clarification End Date/time : 05-07-2019, 15.00 Hrs

Pre-bid meeting Date/time : 08-07-2019, 11:30 Hrs

Bid Submission Start Date/time : 17-07-2019, 10.00 Hrs

Bid Document Download/sale End date/ time : 23-07-2019, 12.00 Hrs

Bid Submission End Date/time : 23-07-2019, 15.00 Hrs

TIME AND DATE OF OPENING

OF BIDS- Technical Part : 23-07-2019, 15:30 Hrs


- 6. For submission of the bids, the bidder is required to have Digital Signature Certificate (DSC) from one of the authorized Certifying Authorities, authorised by Government of India for issuing DSC. Aspiring bidders who have not obtained the user ID and password for participating in e-procurement in this Project may obtain the same from designated firms available on e-Procurement portal and then register with the Government of West Bengal e-Procurement platform and submit Bids by using their user ID and Digital Signature.
- 7. Bids security of the amount specified in the bidding document, drawn in favour of *Executive Engineer*, *Burdwan Investigation & Planning Division*, *Burdwan* must be submitted as per the procedure described in paragraph 8below. The Bid security will have to be in any one of the forms as specified in the bidding document and shall have to be valid for 45 days beyond the validity of the bid. Bids must be submitted online on <a href="https://www.wbtenders.gov.in">www.wbtenders.gov.in</a> on or before the date and time for receipt of bids, and the 'Technical Part' of bids will be opened online on the specified time and date for opening of bids, as given above. The "Financial Part" shall remain unopened in the e-procurement system until the second public Bid opening for the financial part. Any bid or modifications to bid (including discount) received outside e-procurement system will not be considered. If the office happens to be closed on the date of opening of the bids as specified, the bids will be opened on the next working day at the same time. The electronic bidding system would not allow any late submission of bids.
- 8. The bidders are required to submit (a) registration on e-procurement website (if not previously registered); (b) original bid security in approved form; and (c) original affidavit regarding correctness of information furnished with bid document with *Executive Engineer, Burdwan Investigation & Planning Division, Purta Bhawan (3<sup>rd</sup> floor), Burdwan-713103* before the opening of the technical part of the Bid given above, either by registered post/speed post/courier or by hand, failing which the bids will be declared non-responsive and will not be opened.
- 9. Other details can be seen in the bidding document. The Purchaser shall not be held liable for any delays due to system failure beyond its control. Even though the system

- will attempt to notify the bidders of any bid updates, the Purchaser shall not be liable for any information not received by the bidder. It is the bidders' responsibility to verify the website for the latest information related to this bid.
- 10. A pre-bid meeting will be held on **08-07-2019 at 11:30** Hrs. at the office of *Superintending Engineer, Investigation and Planning Circle No. II, Jalsampad Bhawan, 5th Floor, Salt Lake, Kolkata-700091* to clarify the issues and to answer questions on any matter that may be raised at that stage as stated in ITB Clause 7.1 of 'Instructions to Bidders' of the bidding document.

Office of the Executive Engineer, Burdwan Investigation & Planning Division Purta Bhawan (3<sup>rd</sup> floor), Burdwan-713103 Telephone number: 0342-2646799 E-mail address: eebipd2012@gmail.com

# TABLE OF CONTENTS

PART 1 – BIDDING PROCEDURES	7
SECTION I - Instructions to Bidders [ITB]	8
SECTION II - BIDDING DATA SHEET	35
SECTION III. EVALUATION AND QUALIFICATION CRITERIA	43
SECTION IV – BIDDING FORMS	46
SECTION V. – ELIGIBLE COUNTRIES	
SECTION VI. BANK POLICY - CORRUPT AND FRAUDULENT PRACTICES	71
PART 2 - SUPPLY REQUIREMENTS	73
SECTION VII – SCHEDULE OF REQUIREMENTS	
PART 3 – CONTRACT	169
SECTION VIII – GENERAL CONDITIONS OF CONTRACT	169
SECTION IX. SPECIAL CONDITIONS OF CONTRACT	190
SECTION X – CONTRACT FORMS	



# **Section I. Instructions to Bidders**

# **Table of Clauses**

A. GENE	RAL	11
1.	SCOPE OF BID	11
2.	Source of Funds	11
3.	CORRUPT &FRAUDULENT PRACTICES	12
4.	Eligible Bidders	12
5.	ELIGIBLE GOODS AND RELATED SERVICES	14
B. CONT	ENTS OF BIDDING DOCUMENT	14
6.	SECTIONS OF BIDDING DOCUMENTS	
7.	CLARIFICATION OF BIDDING DOCUMENTS	
8.	AMENDMENT OF BIDDING DOCUMENTS	
C. PREP	ARATION OF BIDS	16
9.	COST OF BIDDING	
10		
11		
12	. PROCESS OF BID SUBMISSION	17
13		
14		
15		
16		
	ND RELATED SERVICES	20
17		21
	DDER	
18		
19		
20 D ONL II		
	NE SUBMISSION OF BIDS	
21		
22		
23		
24	· · · · · · · · · · · · · · · · · · ·	
25 E EXAL		
	UATION OF BIDS – GENERAL PROVISIONS	
26		
27	CLARIFICATION OF BIDS	21

	28	DEVIATIONS, RESERVATIONS, OMISSIONS	27
	29	NONCONFORMITIES, ERRORS AND OMISSIONS	
	30	EVALUATION OF TECHNICAL PARTS	
	31	DETERMINATION OF RESPONSIVENESS	
	32	QUALIFICATION OF THE BIDDERS	
	33	PUBLIC OPENING OF FINANCIAL PARTS	
	35	CORRECTION OF ARITHMETICAL ERRORS	32
	36	CONVERSION TO SINGLE CURRENCY	32
	37	MARGIN OF DOMESTIC PREFERENCE	32
	38	COMPARISON OF FINANCIAL PARTS	32
	39	PURCHASER'S RIGHT TO ACCEPT ANY BID, AND TO REJECT ANY OR ALL BIDS	32
J. AWA	ARD O	OF CONTRACT	32
	40	AWARD CRITERIA	32
	41	PURCHASER'S RIGHT TO VARY QUANTITIES AT TIME OF AWARD	32
	42	NOTIFICATION OF AWARD	
	PUBLIC	CATION OF AWARD	33
	RECOU	RSE TO UNSUCCESSFUL BIDDERS	33
	43	SIGNING OF CONTRACT	33
	44	PERFORMANCE SECURITY	33

# Section I. Instructions to Bidders

# A. General

- 1. Scope of Bid
- 1.1 The Purchaser **indicated in the Bidding Data Sheet (BDS)**, issues these Bidding Documents for the supply of Goods and Related Services incidental thereto as specified in Section VII, Schedule of Requirements. The name, identification and number of lots (contracts) of this National Competitive Bidding (NCB) procurement are **specified in the BDS**.
- 1.2 Throughout these Bidding Documents:
- (a) the term "in writing" means communicated in written form (e.g. by mail, e-mail, fax, telex, including if **specified in the BDS**, distributed or received through the electronic-procurement system used by the Employer) with proof of receipt;
- (b) if the context so requires, "singular" means "plural" and vice versa; and
- (c) "day" means calendar day.
- 2. Source of Funds
- 2.1 The Government of India (hereinafter called "Borrower") specified in the BDS has applied for or received financing (hereinafter called "funds") from the International Bank for Reconstruction and Development or the International Development Association (hereinafter called "the Bank") in an amount specified in BDS toward the project named in the BDS. The Borrower intends to apply a portion of the funds to eligible payments under the contract for which these Bidding Documents are issued.
- 2.2 Payment by the Bank will be made only at the request of the Borrower and upon approval by the Bank in accordance with the terms and conditions of the Loan (or other financing) Agreement. The Loan (or other financing) Agreement prohibits a withdrawal from the loan or other financing) account for the purpose of any payment to persons or entities, or for any import of goods, if such payment or import, to the knowledge of the Bank, is prohibited by decision of the United Nations Security Council taken under Chapter VII of the Charter of the United Nations. No party other than the Borrower shall derive any rights from the Loan (or other financing) Agreement or have any claim to the funds.

# 3. Corrupt &Fraudulent Practices

- 3.1 The Bank requires compliance with its policy in regard to corrupt and fraudulent practices as set forth in Section VI.
- 3.2 In further pursuance of this policy, Bidders shall permit and shall cause its agents (whether declared or not), sub-contractors, sub-consultants, service providers or suppliers and to permit the Bank to inspect all accounts, records and other documents relating to the submission of the application, bid submission (in case prequalified), and contract performance (in the case of award), and to have them audited by auditors appointed by the Bank.

### 4. Eligible Bidders

- 4.1 A Bidder may be a firm that is a private entity, or a government owned entity subject to ITB 4.5.
- 4.2 A Bidder shall not have a conflict of interest. Any Bidder found to have a conflict of interest shall be disqualified. A Bidder may be considered to have a conflict of interest for the purpose of this bidding process, if the Bidder:
  - a. directly or indirectly controls, is controlled by or is under common control with another Bidder; or
  - b. receives or has received any direct or indirect subsidy from another Bidder; or
  - c. has the same legal representative as another Bidder; or
  - d. has a relationship with another Bidder, directly or through common third parties, that puts it in a position to influence the bid of another Bidder, or influence the decisions of the Purchaser regarding this bidding process; or
  - e. Participates in more than one bid in this bidding process. Participation by a Bidder in more than one Bid will result in the disqualification of all Bids in which such Bidder is involved. However, this does not limit the inclusion of the same subcontractor in more than one bid; or
  - f. any of its affiliates participated as a consultant in the preparation of the design or technical specifications of the goods/equipment that are the subject of the bid; or
  - g. any of its affiliates has been hired (or is proposed to be hired) by the Purchaser or Borrower for the Contract implementation; or
  - h. would be providing goods, works, or non-consulting services resulting from or directly related to consulting services for the preparation or implementation of the project specified in the BDS ITB 2.1 that it provided or were provided by any of its affiliate that directly or indirectly controls, is controlled by, or is under common control with that firm; or
  - i. has a close business or family relationship with a professional staff of the Borrower (or of the project implementing agency, or of a

recipient of a part of the loan) who: (i) are directly or indirectly involved in the preparation of the bidding documents or specifications of the contract, and/or the bid evaluation process of such contract; or (ii) would be involved in the implementation or supervision of such contract unless the conflict stemming from such relationship has been resolved in a manner acceptable to the Bank throughout the procurement process and execution of the contract.

- 4.3 A Bidder may have the nationality of any country, subject to the restrictions pursuant to ITB 4.7. A Bidder shall be deemed to have the nationality of a country if the Bidder is constituted, incorporated or registered in and operates in conformity with the provisions of the laws of that country, as evidenced by its articles of incorporation (or equivalent documents of constitution or association) and its registration documents, as the case may be. This criterion also shall apply to the determination of the nationality of proposed subcontractors or sub-consultants for any part of the Contract including related Services.
- 4.4 A Bidder that has been sanctioned by the Bank in accordance with the above ITB 3.1, including in accordance with the Bank's Guidelines on Preventing and Combating Corruption in Projects Financed by IBRD Loans and IDA Credits and Grants ("Anti-Corruption Guidelines"), shall be ineligible to be prequalified for, bid for, or be awarded a Bank-financed contract or benefit from a Bank-financed contract, financially or otherwise, during such period of time as the Bank shall have determined. The list of debarred firms and individuals is available at the electronic address **specified** in the BDS.
- 4.5 Bidders that are Government-owned enterprises or institutions in the Purchaser's Country may participate only if they can establish that they (i) are legally and financially autonomous (ii) operate under commercial law, and (iii) are not dependent agencies of the To be eligible, a government-owned enterprise or Purchaser. institution shall establish to the Bank's satisfaction, through all relevant documents, including its Charter and other information the Bank may request, that it: (i) is a legal entity separate from the government (ii) does not currently receive substantial subsidies or budget support; (iii) operates like any commercial enterprise, and, inter alia, is not obliged to pass on its surplus to the government, can acquire rights and liabilities, borrow funds and be liable for repayment of its debts, and can be declared bankrupt; and (iv) is not bidding for a contract to be awarded by the department or agency of the government which under their applicable laws or regulations is

the reporting or supervisory authority of the enterprise or has the ability to exercise influence or control over the enterprise or institution.

- 4.6 A Bidder shall not be under suspension from bidding by the Purchaser as the result of the operation of a Bid–Securing Declaration.
- 4.7 Firms and individuals may be ineligible if so indicated in Section V and (a) as a matter of law or official regulations, the Borrower's country prohibits commercial relations with that country, provided that the Bank is satisfied that such exclusion does not preclude effective competition for the supply of goods or the contracting of works or services required; or (b) by an act of compliance with a decision of the United Nations Security Council taken under Chapter VII of the Charter of the United Nations, the Borrower's country prohibits any import of goods or contracting of works or services from that country, or any payments to any country, person, or entity in that country.
- 4.8 A bidder shall provide such evidence of eligibility satisfactory to the Purchaser, as the Purchaser shall reasonably request.

# 5. Eligible Goods 5.1 and Related Services

- 5.1 All the Goods and Related Services to be supplied under the Contract and financed by the Bank may have their origin in any country in accordance with Section V, Eligible Countries.
- 5.2 For purposes of this Clause, the term "goods" includes commodities, raw material, machinery, equipment, and industrial plants; and "related services" includes services such as insurance, installation, training, and initial maintenance.
- 5.3 The term "origin" means the country where the goods have been mined, grown, cultivated, produced, manufactured or processed; or, through manufacture, processing, or assembly, another commercially recognized article results that differs substantially in its basic characteristics from its components.

# **B.** Contents of Bidding Document

6. Sections
Bidding
Documents

of 6.1 The Bidding Documents consist of Parts 1, 2, and 3, which include all the Sections indicated below, and should be read in conjunction with any Addendum issued in accordance with ITB Clause 8.

### **PART 1** Bidding Procedures

• Section I. Instructions to Bidders (ITB)

- Section II. Bidding Data Sheet (BDS)
- Section III. Evaluation and Qualification Criteria
- Section IV. Bidding Forms
- Section V. Eligible Countries
- Section VI Bank Policy-Corrupt and Fraudulent Practices

# **PART 2** Supply Requirements

• Section VII. Schedule of Requirements

### **PART 3** Contract

- Section VIII. General Conditions of Contract (GCC)
- Section IX. Special Conditions of Contract (SCC)
- Section X. Contract Forms
- 6.2 The Invitation for Bids issued by the Purchaser is not part of the Bidding Document.
- 6.3 Unless obtained directly from the Purchaser, the Purchaser is not responsible for the completeness of the document, responses to requests for clarification, minutes of pre-bid meeting (if any),or Addenda to the Bidding Document in accordance with ITB 8. In case of any contradiction, documents obtained directly from the Purchaser shall prevail.
- 6.4 The Bidder is expected to examine all instructions, forms, terms, and specifications in the Bidding Documents and to furnish with its Bid all information or documentation as is required by the Bidding Documents.

# 7. Clarification of 7.1 Bidding Documents

The electronic bidding system **specified in the BDS** provides for online clarifications. A prospective Bidder requiring any clarification on the Bidding Documents may notify the Purchaser online. Clarifications requested through any other mode shall not be considered by the Purchaser. The Purchaser will respond to any request for clarification, provided that such request is received no later than fifteen (15) days prior to the deadline for submission of bids. Description of clarification sought and the response ofthe Purchaser shall be uploaded for information of all Bidders without identifying the source of request for clarification. Should the Purchaser deem it necessary to amend the Bidding Documents as a result of a clarification, it shall do so

following the procedure under ITB Clause 8 and ITB Sub-Clause 22.2. It is the bidder's responsibility to check on the e-procurement system, for any addendum/ amendment/ corrigendum to the bidding document.

# 8. Amendment of 8.1 Bidding Documents

- At any time prior to the deadline for submission of bids, the Purchaser may amend the Bidding Documents by issuing addendum. The addendum will appear on the e-procurement system under "Latest Corrigendum" and email notification is also automatically sent to those bidders who have started working on the tender, or as **otherwise specified in BDS**.
- 8.2 Any addendum thus issued shall be part of the Bidding Documents and shall be deemed to have been communicated to all the bidders.
- 8.3 To give prospective Bidders reasonable time in which to take an addendum into account in preparing their bids, the Purchaser may, at its discretion, extend the deadline for the submission of bids, pursuant to ITB Sub-Clause 22.2

# C. Preparation of Bids

# 9. Cost of Bidding

9.1 The Bidder shall bear all costs associated with the preparation and submission of its bid, and the Purchaser shall not be responsible or liable for those costs, regardless of the conduct or outcome of the bidding process.

# 10. Language Bid

of 10.1 The Bid, as well as all correspondence and documents relating to the bid exchanged by the Bidder and the Purchaser, shall be written in English language. Supporting documents and printed literature that are part of the Bid may be in another language provided they are accompanied by an accurate translation of the relevant passages into English language, in which case, for purposes of interpretation of the Bid, such translation shall govern.

# 11. Documents Comprising the Bid

11.1 The Bid shall comprise two Parts, namely the Technical Part and the Financial Part. These two Parts shall be submitted simultaneously.

### 11.2 **The Technical Part** shall containing the following:

- (a) Letter of Bid Technical Part, in accordance with ITB Clause 12;
- (b) Bid Security, in accordance with ITB Clause 19.1, if required;
- (c) Alternative bids- Technical Part, if permissible, in

- accordance with ITB 13, the Technical Part of any Alternative Bid;
- (d) written confirmation authorizing the signatory of the Bid to commit the Bidder, in accordance with ITB Clause 20.2;
- (e) documentary evidence in accordance with ITB Clause 17 establishing the Bidder's qualifications to perform the contract if its bid is accepted;
- (f) documentary evidence in accordance with ITB 17 establishing the Bidder's eligibility to bid;
- (g) documentary evidence in accordance with ITB Clause 16, that the Goods and Related Services to be supplied by the Bidder are of eligible origin;
- (h) documentary evidence in accordance with ITB Clauses 16, that the Goods and Related Services conform to the Bidding Documents;
- (i) Manufacturer's authorization form; and
- (j) Any other document **required in the BDS**.
- 11.3 The **Financial Part** shall contain the following:
  - (a) Letter of Bid Financial Part: prepared in accordance with ITB 12 and ITB 14;
  - (b) Price Schedules: completed prepared in accordance with ITB 12 and ITB 14;
  - (c) Alternative Bid Financial Part; if permissible in accordance with ITB 13, the Financial Part of any Alternative Bid; and
  - (d) Any other document **required in the BDS**.
- 11.4 The Technical Part shall not include any financial information related to the Bid price. Where material financial information related to the Bid price is contained in the Technical Part, the Bid shall be declared non-responsive.
- 11.5 The Bidder shall furnish in the Letter of Bid, information on commissions and gratuities, if any, paid or to be paid to agents or any other party relating to this Bid.
- **12. Process of Bid** 12.1 The Letter of Bid technical Part, Letter of Bid Financial Part Submission and Price Schedules shall be prepared using the relevant forms furnished in Section IV, Bidding Forms. The forms must be

- completed without any alterations to the text, and no substitutes shall be accepted except as provided under ITB 20.2. All blank spaces shall be filled in with the information requested.
- 12.2 Entire Bid including the Letter of Bid and filled-up Price Schedules shall be submitted online on e-procurement system specified in ITB 7.1. Details and process of online submission of the tender and relevant documents are given in the website mentioned above. Scanned copies of documents listed in clauses 11 and 12.3 should also be uploaded on this website.
- 12.3 **Submission of Original Documents:** The bidders are required to separately submit (i) original demand drafts towards the cost of bid document and registration on e-procurement website (if not previously registered) (as per RFB); (ii) original bid security in approved form; and (iii) original affidavit regarding correctness of information furnished with bid document, with the office **specified in the BDS**, before the opening of the technical part of the Bid, either by registered/speed post/courier or by hand, failing which the bids will be declared non-responsive and will not be opened. Hard copy of rest of the bid is not to be submitted.
- **13. Alternative Bids** 13.1 Unless otherwise **specified in the BDS**, alternative bids shall not be considered.
- Discounts
- **14. Bid Prices and** 14.1 The prices and discounts quoted by the Bidder in the Letter of Bid – Financial Part and in the Price Schedules shall conform to the requirements specified below.
  - 14.2 All lots (contracts) and items must be listed and priced separately in the Price Schedules.
  - 14.3 The price to be quoted in the Letter of Bid Financial Part, in accordance with ITB 12.1, shall be the total price of the bid, excluding any discounts offered.
  - 14.4 The Bidder shall quote any discounts and indicate the methodology for their application in the Letter of Bid – Financial Part in accordance with ITB 12.1.
  - 14.5 Prices quoted by the Bidder shall be fixed during the Bidder's performance of the Contract and not subject to variation on any account, unless otherwise specified in the BDS.A bid submitted with an adjustable price quotation shall be treated as nonresponsive and shall be rejected, pursuant to ITB 31. However, if in accordance with the BDS, prices quoted by the Bidder shall be subject to adjustment during the performance of the Contract, a bid submitted with a fixed price quotation shall

not be rejected, but the price adjustment shall be treated as zero.

- 14.6 If so specified in ITB 1.1, bids are being invited for individual lots (contracts) or for any combination of lots (packages). Unless otherwise **specified in the BDS**, prices quoted shall correspond to 100 % of the items specified for each lot and to 100% of the quantities specified for each item of a lot. Bidders wishing to offer discounts for the award of more than one Contract shall specify in their bid the price reductions applicable to each package, or alternatively, to individual Contracts within the package. Discounts shall be submitted in accordance with ITB 14.4 provided the bids for all lots (contracts) are submitted and opened at the same time.
- 14.7 The terms EXW and other similar terms shall be governed by the rules prescribed in the current edition of Incoterms, published by The International Chamber of Commerce, as specified in the BDS.
- 14.8 Prices shall be quoted as specified in the Price Schedule included in Section IV, Bidding Forms. In quoting prices, the Bidder shall be free to use transportation through carriers registered in any eligible country, in accordance with Section V Eligible Countries. Similarly, the Bidder may obtain insurance services from any eligible country in accordance with Section V Eligible Countries. Prices shall be entered in the following manner:

### (a) For Goods:

- (i) the price of the Goods quoted EXW (ex-works, ex-factory, ex-warehouse, ex-showroom, or off-the-shelf, as applicable), excluding GST as applicable payable on the finished Goods;
- (ii) GST or any other taxes if payable in India on the Goods, if the contract is awarded to the Bidder; and
- (iii) the price for inland transportation, insurance, and other local services required to convey the Goods to their final destination (Project Site) **specified in the BDS.**
- (b) for the Related Services, other than inland transportation and other services required to convey the Goods to their final destination, whenever such Related Services are specified in the Schedule of Requirements:
  - (i) the price of each item comprising the Related

Services (inclusive of any applicable taxes).

### 14.9 **Deemed Export Benefits**

Bidders may like to ascertain availability of tax/duty exemption benefits, if any, available for contracts financed under World Bank Credits/ Loans. They are solely responsible for obtaining such benefits, which they have considered in their bid and in case of failure to receive such benefits for reasons whatsoever, the Purchaser will not compensate the bidder.

Where the bidder has quoted taking into account such benefits, it must give all information required for issue of necessary Certificates in terms of the Government of India's relevant Notification along with its bid as perform stipulated in Section IV Bidding Forms.

If the Bidder has considered the Deemed Export Benefits in its bid, the Bidder shall confirm and certify that the Purchaser will not be required to undertake any responsibilities of the deemed export scheme or the benefits available during contract execution except issuing the required certificates. Bids which do not conform to this provision or any condition by the Bidder which makes the bid subject to availability of deemed export benefits or compensation on withdrawal of or any variations in the deemed export benefits scheme will make the bid non responsive and hence liable to rejection.

# 15. Currencies of Bid& Payment

of 15.1 The Bidder shall quote the Price in Indian Rupees only.

# 16. Documents Establishing the Eligibility and conformity of the Goods and Related Services

16.1 To establish the eligibility of the Goods and Related Services in accordance with ITB Clause 5, Bidders shall complete the country of origin declarations in the Price Schedule Forms, included in Section IV, Bidding Forms.

- 16.2 To establish the conformity of the Goods and Related Services to the Bidding Documents, the Bidder shall furnish as part of its Bid the documentary evidence that the Goods conform to the technical specifications and standards specified in Section VII, Schedule of Requirements.
- 16.3 The documentary evidence may be in the form of literature, drawings or data, and shall consist of a detailed item by item description of the essential technical and performance

characteristics of the Goods and Related Services, demonstrating substantial responsiveness of the Goods and Related Services to the technical specification, and if applicable, a statement of deviations and exceptions to the provisions of the Section VII Schedule of Requirements.

- 16.4 The Bidder shall also furnish a list giving full particulars, including available sources and current prices of spare parts, special tools, etc., necessary for the proper and continuing functioning of the Goods during the period **specified in the BDS** following commencement of the use of the goods by the Purchaser.
- 16.5 Standards for workmanship, process, material, and equipment, as well as references to brand names or catalogue numbers specified by the Purchaser in the Schedule of Requirements, are intended to be descriptive only and not restrictive. The Bidder may offer other standards of quality, brand names, and/or catalogue numbers, provided that it demonstrates, to the Purchaser's satisfaction, that the substitutions ensure substantial equivalence or are superior to those specified in the Section VII Schedule of Requirements.
- 17. Documents
  Establishing the
  Eligibility
  &Qualifications
  of the Bidder
- 17.1 To establish Bidder's eligibility in accordance with ITB 4, Bidders shall complete the Letter of Bid Technical Part, included in Section IV, Bidding Forms.
- 17.2 The documentary evidence of the Bidder's qualifications to perform the contract if its bid is accepted shall establish to the Purchaser's satisfaction:
  - (a) that the Bidder meets each of the qualification criterion Criteria specified in Section III, Evaluation and Qualification;
  - (b) (i) that, if **required in the BDS**, a Bidder that does not manufacture or produce the Goods it offers to supply shall submit the Manufacturer's Authorization using the form included in Section IV, Bidding Forms to demonstrate that it has been duly authorized by the manufacturer or producer of the Goods to supply these Goods in the Purchaser's Country;
    - (ii) Supplies for any particular item in each schedule of the bid should be from one manufacturer only. Bids from agents offering supplies from different manufacturers for the same item of the schedule in the bid will be treated as

non-responsive.

- (iii) that, if **required in the BDS**, the Bidder is or will be (if awarded the contract) represented by an Agent in the country equipped and able to carry out the Supplier's maintenance, repair and spare parts-stocking obligations prescribed in the Conditions of Contract and/or Technical Specifications;
- (c) Bids from Joint Ventures are not acceptable.

# 18 Period of Validity of Bids

- 18.1 Bids shall remain valid for the period **specified in the BDS** after the bid submission deadline date prescribed by the Purchaser in accordance with ITB 22.1. A bid valid for a shorter period shall be rejected by the Purchaser as non-responsive.
- 18.2 In exceptional circumstances, prior to the expiration of the bid validity period, the Purchaser may request bidders to extend the period of validity of their bids. The request and the responses shall be made in writing. If a Bid Security is requested in accordance with ITB Clause 19, it shall also be extended for a corresponding period. A Bidder may refuse the request without forfeiting its Bid Security. A Bidder granting the request shall not be required or permitted to modify its bid, except as provided in ITB Sub-Clause 18.3.
- 18.3 If the award is delayed by a period exceeding fifty-six (56) days beyond the expiry of the initial bid validity, the Contract price shall be determined as follows:
  - (a) In the case of fixed price contracts, the Contract price shall be the bid price adjusted by the factor **specified in the BDS** for each week or part of the week that has elapsed from the expiration of the initial bid validity to the date of notification of award to the successful bidder.
  - (b) In the case of adjustable price contracts, no adjustment shall be made.
  - (c) In any case, bid evaluation shall be based on the bid Price withouttakingintoconsiderationtheapplicablecorrectionfromt hoseindicated above.

# 19 Bid Security

- 19.1 The Bidder shall furnish as part of the Technical Part of its bid, a Bid Security, if required, as **specified in the BDS.**
- 19.2 Not used.

- 19.3 The Bid Security shall be in the amount **specified in the BDS** and denominated in Indian Rupees or a freely convertible currency, and shall:
  - (a) at the bidder's option, be in the form of either a certified check, demand draft, letter of credit, or a bank guarantee from a Nationalized /Scheduled Bank in India, or another security specified in the BDS;
  - (b) be substantially in accordance with one of the forms of Bid Security included in Section IV, Bidding Forms, or other form approved by the Purchaser prior to bid submission;
  - (c) be payable promptly upon written demand by the Purchaser in case the conditions listed in ITB Clause 19.7 are invoked;
  - (d) be submitted in its original form; copies will not be accepted;
  - (e) remain valid for a period of 45 days beyond the original validity period of the bids, or beyond any period of extension of bid validity, if so requested under ITB Clause 18.2.
- 19.4 If a Bid Security is required in accordance with ITB Sub-Clause 19.1, any bid not accompanied by a substantially responsive Bid Security shall be rejected by the Purchaser as non-responsive.
- 19.5 The Bid Security of unsuccessful Bidders shall be returned as promptly as possible upon the successful Bidder's signing the contract and furnishing the Performance Security pursuant to ITB Clause 44.
- 19.6 The Bid Security of the successful Bidder shall be returned as promptly as possible once the successful Bidder has signed the contract and furnished the required performance security.
- 19.7 The Bid Security may be forfeited:
  - (a) if a Bidder
    - (i) withdraws its bid during the period of bid validity specified by the Bidder in the Letter of Bid (Technical Part and/or Financial Part), except as provided in ITB Sub-Clause 18.2; or
    - (ii) does not accept the correction of errors in pursuant

to ITB35,

or

- (b) if the successful Bidder fails to:
  - (i) sign the Contract in accordance with ITB Clause 43; or
  - (ii) Furnish a Performance Security in accordance with ITB Clause 44.
- 19.8 Not used.
- 19.9 If a bid security is **not required in the BDS**, and
  - (a) if a Bidder withdraws its bid during the period of bid validity specified by the Bidder on the Letter of Bid Form, except as provided in ITB 18.2, or does not accept the correction of errors pursuant to ITB 35; or
  - (b) if the successful Bidder fails to sign the Contract in accordance with ITB 43; or furnish a performance security in accordance with ITB 44;

the Borrower may, **if provided for in the BDS**, declare the Bidder ineligible to be awarded a contract by the Purchaser for a period of time **as stated in the BDS**.

# 20 Format and Signing of Bid

- 20.1 The Bidder shall prepare the Bid as per details given in ITB 21.
- 20.2 The bid shall be signed by a person duly authorized to sign on behalf of the Bidder. The authorization shall consist of a written confirmation **as specified in the BDS** and shall be uploaded along with the bid.
- 20.3 Not used.
- 20.4 Corrections if any in the bid can be carried out by editing the information before electronic submission on e-procurement portal.

### D. Online Submission of Bids

# 21 Preparation of 21.1 Bids

Bids, both Technical and Financial Parts, shall be submitted online on the e-procurement system specified in BDS 7.1. Detailed guidelines for viewing bids and submission of online bids are given on the website. The Invitation for Bids under this Project is published on this website. Any citizen or prospective bidder can logon to this website and view the Invitation for Bids and can view the details of goods for which bids are invited. A prospective bidder can submit its bid online; however, the bidder

is required to have enrolment/registration in the website, and should have valid Digital Signature Certificate (DSC) in the form of smart card/e-token obtained from any authorised certifying agency of Government of India (for class of DSC **specified in BDS**). The bidder should register in the website using the relevant option available. Then the Digital Signature registration has to be done with the e-token, after logging into the website. The bidder can then login the website through the secured login by entering the password of the e-token & the user id/ password chosen during registration. After getting the bid schedules, the Bidder should go through them carefully and submit the specified documents, along with the bid; otherwise the bid will be rejected.

- 21.2 The completed bid comprising of documents indicated in ITB 12, should be uploaded on the e-procurement portal along with scanned copies of requisite certificates as are mentioned in different sections in the bidding document and scanned copy of the bid security.
- 21.3 All the documents are required to be signed digitally by the bidder. After electronic on line bid submission, the system generates a unique bid identification number which is time stamped as per server time. This shall be treated as acknowledgement of bid submission.
- 21.4 Physical, Email, Telex, Cable or Facsimile bids will be rejected as non-responsive.

# 22 Deadline for Submission of Bids

- 22.1 Bids must be uploaded online no later than the date and time specified in the BDS.
- 22.2 The Purchaser may, at its discretion, extend the deadline for the submission of bids by amending the Bidding Documents in accordance with ITB Clause 8, in which case all rights and obligations of the Purchaser and Bidders previously subject to the deadline shall thereafter be subject to the deadline as extended.
- 23 Late Bids
- 23.1 The electronic bidding system would not allow any late submission of bids after due date & time as per server time.
- 24 Withdrawal, Substitution, and Modification of Bids
- 24.1Bidders may modify their bids by using appropriate option for bid modification on the e-procurement portal, before the deadline for submission of bids. For this the bidder need not make any additional payment towards the cost of bid document. For bid modification and consequential re-submission, the bidder is not required to withdraw his bid submitted earlier. The last modified bid submitted by the bidder within the bid submission time shall be

considered as the bid. For this purpose, modification/withdrawal by other means will not be accepted. In online system of bid submission, the modification and consequential re-submission of bids is allowed any number of times. A bidder may withdraw his bid by using appropriate option for bid withdrawal, before the deadline for submission of bids, however, if the bid is withdrawn, re-submission of the bid is not allowed (or allowed if specified in BDS).

- 24.2 Bids requested to be withdrawn in accordance with ITB Sub-Clause 24.1 shall not be opened.
- 24.3 No bid may be withdrawn, substituted, or modified in the interval between the deadline for submission of bids and the expiration of the period of bid validity specified by the Bidder on the Letter of Bid (Technical Part and/or Financial Part) or any extension thereof.

# E. Public Opening of Technical Parts of Bids

**Technical** of **Parts of Bids** 

25 Public Opening 25.1. The Purchaser shall publicly open Technical Parts of all bids received by the deadline, at the date, time and place specified in the BDS, in the presence of Bidder's designated representatives and anyone who chooses to attend, and this could also be viewed by the bidders online. The Financial Parts of the bids shall remain unopened in the e-procurement system, until the subsequent public opening, following the evaluation of the Technical Parts of the Bids. In all cases, original documents submitted as specified in ITB 12.3 shall be first scrutinized, and Bids that do not comply with the provisions of ITB 12.3 will be declared non-responsive and will not be opened. Thereafter, bidder's names, and such other details as the Purchaser may consider appropriate will be notified online as Technical Part bid opening summary.

> In the event of the specified date of bid opening being declared a holiday for the Purchaser, the bids will be opened at the appointed time and location on the next working day.

25.2 The electronic summary of the bid opening will be generated and uploaded online. The Purchaser will also prepare minutes of the Bid opening, including the information disclosed and upload the same for viewing online. Only Technical Parts of Bids, alternative bids - Technical Parts if permitted in ITB 13 that are opened at Bid opening shall be considered further for evaluation.

# E. Evaluation of Bids – General Provisions

### 26 Confidentiality

- 26.1 Information relating to the examination, evaluation, comparison, and post-qualification of bids, and recommendation of contract award, shall not be disclosed to bidders or any other persons not officially concerned with such process until information on Contract Award is communicated to all Bidders in accordance with ITB 42.
- 26.2 Any effort by a Bidder to influence the Purchaser in the examination, evaluation, comparison, and post-qualification of the bids or contract award decisions may result in the rejection of its Bid.
- 26.3 Notwithstanding ITB Sub-Clause 26.2, from the time of bid opening to the time of Contract Award, if any Bidder wishes to contact the Purchaser on any matter related to the bidding process, it should do so in writing.

# **Bids**

- **27** Clarification of 27.1 To assist in the examination, evaluation, comparison of the bids and post-qualification of the Bidders, the Purchaser may, at its discretion, ask any Bidder for a clarification of its Bid. Any clarification submitted by a Bidder in respect to its Bid, that is not in response to a request by the Purchaser shall not be considered. The Purchaser's request for clarification and the response shall be in writing. No change, including any voluntary increase or decrease, in the prices or substance of the Bid shall be sought, offered, or permitted, except to confirm the correction of arithmetic errors discovered by the Purchaser in the Evaluation of the bids, in accordance with ITB Clause 35.
  - 27.2 If a Bidder does not provide clarifications of its bid by the date and time set in the Purchaser's request for clarification, its bid may be rejected.

# 28 Deviations, Reservations, **Omissions**

- 28.1 During the evaluation of bids, the following definitions apply:
  - (a) "Deviation" is a departure from the requirements specified in the Bidding Documents;
  - (b) "Reservation" is the setting of limiting conditions or withholding from complete acceptance of the requirements specified in the Bidding Documents; and
  - (c) "Omission" is the failure to submit part or all of the information or documentation required in the Bidding Documents.
- 29 Nonconformitie 29.1 Provided that a Bid is substantially responsive, the Purchaser

# s, Errors and Omissions

may waive any nonconformities or omissions in the Bid which do not constitute a material deviation, reservation or omission.

- 29.2 Provided that a Bid is substantially responsive, the Purchaser may request that the Bidder submit the necessary information or documentation, within a reasonable period of time, to rectify nonmaterial nonconformities or omissions in the Bid related to documentation requirements. Such omission shall not be related to any aspect of the price or substance of the Bid. Failure of the Bidder to comply with the request may result in the rejection of its Bid.
- 29.3 Provided that a Bid is substantially responsive, the Purchaser shall rectify quantifiable nonmaterial nonconformities related to the Bid Price. To this effect, the Bid Price shall be adjusted, for comparison purposes only, to reflect the price of a missing or non-conforming item or component in the manner specified in the BDS.

### G. Evaluation of Technical Parts of Bids

# 30 Evaluation of Technical Parts

30.1

In evaluating the Technical Parts of each Bid, the Purchaser shall use the criteria and methodologies listed in ITB 31, ITB 32, and Section III, Evaluation and Qualification Criteria. No other evaluation criteria or methodologies shall be permitted.

# 31 Determination of Responsiveness

31.1 The Purchaser's determination of a bid's responsiveness is to be based on the contents of the bid itself as defined in ITB 11.

- 31.2 A substantially responsive Bid is one that meets the requirements of the Bidding Documents without material deviation, reservation, or omission. A material deviation, reservation, or omission is one that:
  - (a) If accepted, would
    - (i) affect in any substantial way the scope, quality, or performance of the Goods and Related Services specified in the Contract; or
    - (ii) limit in any substantial way, inconsistent with the Bidding Documents, the Purchaser's rights or the Bidder's obligations under the Contract; or
  - (b) if rectified would unfairly affect the competitive position of other bidders presenting substantially responsive bids.

- 31.2.1Bids from Agents, without proper authorization from the manufacturer as per Section IV, shall be treated as non-responsive.
- 31.3.1The Purchaser shall examine the bids to confirm that all documents and technical documentation requested in ITB Clause 11 have been provided, and to determine the completeness of each document submitted.
- 31.3.2The Purchaser shall examine the bid to confirm that the Bidder has accepted all terms and conditions specified in GCC and the SCC without material deviations or reservations. Deviations from or objections or reservations to critical provisions such as those concerning Performance Security (GCC Clause 18), Warranty (GCC Clause 28), Force Majeure (Clause 32), Limitation of liability (GCC Clause 30), Governing law (GCC Clause 9) and Taxes & Duties (GCC Clause 17) will be deemed to be a material deviation. The Purchaser's determination of a bid's responsiveness is to be based on the contents of the bid itself without recourse to extrinsic evidence.
- 31.4 If a bid is not substantially responsive to the Bidding Documents, it shall be rejected by the Purchaser and may not subsequently be made responsive by the Bidder by correction of the material deviation, reservation, or omission.

# **32 Qualification of** 32.1 the Bidders

- 32.1 The Purchaser shall determine, to its satisfaction, whether all eligible Bidders, whose Bids have been determined to be substantially responsive to the bidding document, meet the Qualification Criteria specified in Section III, Evaluation and Qualification Criteria.
- 32.2 The determination shall be based upon an examination of the documentary evidence of the Bidder's qualifications submitted by the Bidder, pursuant to ITB 17. The determination shall not take into consideration the qualifications of other firms such as the Bidder's subsidiaries, parent entities, affiliates, subcontractors (other than specialized subcontractors if permitted in the bidding document), or any other firm(s) different from the Bidder.
- 32.3 If a Bidder does not meet the qualifying criteria specified in Section III, Evaluation and Qualification Criteria, its Bid shall be rejected by the Purchaser and may not subsequently be made responsive by correction of the material deviation, reservation, or omission.
- 32.4 Only Bids that are both substantially responsive to the bidding document, and meet all Qualification Criteria shall have the

Financial Parts of their Bids opened at the second public opening

# H. Public Opening of Financial Parts of Bids

# 33 Public Opening 33.1 of Financial Parts

- Parts of the Bids, and the Bank has issued its no objection (if applicable), the Purchaser shall notify in writing those Bidders who have failed to meet the Qualification Criteria and/or whose Bids were considered non-responsive to the requirements in the bidding document, advising them of the following information:
  - (a) their Technical Part of Bid failed to meet the requirements of the bidding document;
  - (b) their Financial Part of the Bid shall not be opened; and
  - (c) Notify them of the date and time for public opening of the Financial Parts of the Bids. Financial Parts of the bids shall not be opened earlier than seven (7) days from the communication of technical evaluation results to the bidders.
- 33.2 The Purchaser shall, simultaneously, notify in writing those Bidders whose Technical Parts have been evaluated as substantially responsive to the bidding document and met the Qualification Criteria, advising them of the following information:
  - (a) their Bid has been evaluated as substantially responsive to the bidding document and met the Qualification Criteria;
  - (b) their Financial Part of Bid will be opened at the public opening of Financial Parts;
  - (c) Notify them of the date and time of the second public opening of the Financial Parts of the Bids, as **specified in the BDS**.
- 33.3 The opening date should allow Bidders sufficient time to make arrangements for attending the opening. The Financial Part of the Bid shall be opened publicly in the presence of Bidders' designated representatives and anyone who chooses to attend, and this could also be viewed by the bidders online. The bidder's names, the Bid prices, the total amount of each bid, including any discounts and Alternative Bid Financial Part, and such other details as the Purchaser may consider appropriate will be notified online by the Purchaser at the time of bid opening.

In the event of the specified date of bid opening being declared a

- holiday for the Purchaser, the bids will be opened at the appointed time and location on the next working day.
- 33.4 The electronic summary of the bid opening will be generated and uploaded online. The Purchaser will also prepare minutes of the Bid opening, including the information disclosed and upload the same for viewing online. Only Financial Part of Bids, Financial Parts of Alternative Bids and discounts that are opened and read out at Bid opening shall be considered further for evaluation.

### I. Evaluation of Financial Parts of Bids

# 34 Evaluation of Financial Parts

- of 34.1 To evaluate the Financial Part of each Bid, the Purchaser shall consider the following:
  - (a) evaluation will be done for Items or Lots (contracts), as specified **in the BDS**; and the Bid Price as quoted in accordance with ITB 14;
  - (b) Not used;
  - (c) price adjustment due to discounts offered in accordance with ITB 14.4;
  - (d) Not used;
  - (e) price adjustment due to quantifiable nonmaterial nonconformities in accordance with ITB 29.3; and
  - (f) the additional evaluation factors specified in the BDS as per ITB 34.5 from amongst those set out in Section III, Evaluation and Qualification Criteria.
  - 34.2 The estimated effect of the price adjustment provisions of the Conditions of Contract, applied over the period of execution of the Contract, shall not be taken into account in Bid evaluation.
  - 34.3 If this bidding document allows Bidders to quote separate prices for different lots (contracts), the methodology to determine the lowest evaluated cost of the lot (contract) combinations, including any discounts offered in the Letter of Bid Financial Part, is specified in Section III, Evaluation and Qualification Criteria.
  - 34.4 The Purchaser's evaluation of a Bid shall include (i) price quoted EXW including GST as applicable on the finished goods; (ii) other taxes, if any, payable on finished goods; (iii) price for inland transportation, insurance, and other local services required to convey the Goods to their Final Destination; and (iv) price for

Related Services, if any.

34.5 The Purchaser's evaluation of a Bid may require the consideration of other factors, in addition to the Bid price quoted in accordance with ITB 14. These factors may be related to the characteristics, performance, and terms and conditions of purchase of the Goods and Related Services. The effect of the factors selected, if any, shall be expressed in monetary terms to facilitate comparison of Bids, unless otherwise specified in the **BDS** from amongst those set out in Section III, Evaluation and Qualification Criteria. The criteria and methodologies to be used shall be as specified in ITB 34.1 (f).

### 35 Correction of 35.1 **Arithmetical Errors**

The e-procurement system automatically calculates the total amount from unit rates and quantities and the system also automatically populates the amount in words from the amount in figures and therefore there is no scope of discrepancy and need for arithmetic correction.

36 Conversion Single to Currency

36.1 Not applicable.

37 Margin of 37.1 Not applicable. **Domestic Preference** 

> 38 Comparison Financial **Parts**

38.1 The Purchaser shall compare the evaluated prices of all substantially responsive bids to determine the lowest-evaluated bid, in accordance with ITB Clause 34.

39Purchaser's Right to Accept Any Bid, and to Reject Any or All Bids

39.1 The Purchaser reserves the right to accept or reject any bid, and to annul the bidding process and reject all bids at any time prior to contract award, without thereby incurring any liability to Bidders. In case of annulment, all documents submitted and specifically, bid securities, shall be promptly returned to the Bidders.

# J. Award of Contract

**40 Award Criteria** 40.1 Subject to ITB 39.1,the Purchaser shall award the Contract to the Bidder whose bid has been determined to be the lowest evaluated bid and is substantially responsive to the Bidding Documents, provided further that the Bidder is determined to be qualified to perform the Contract satisfactorily.

# 41 Purchaser's Right to Vary

41.1 At the time the Contract is awarded, the Purchaser reserves the right to increase or decrease the quantity of Goods and Related

### **Quantities** Time of Award

Services originally specified in Section VII, Schedule of Requirements, provided this does not exceed the percentages specified in the BDS, and without any change in the unit prices or other terms and conditions of the bid and the Bidding Documents.

# Award

**42 Notification** of 42.1 Prior to the expiration of the period of bid validity, the Purchaser shall notify the successful Bidder, in writing, that its Bid has been accepted. The notification letter (hereinafter called "Letter of Acceptance") shall specify the sum that the purchaser will pay in consideration of the supply of Goods (hereinafter called "the Contract Price").

# **Publication** Award

of 42.2 At the same time the Purchaser shall publish in a National website(GOI web site-http://tenders.gov.in or GoI Central Public Procurement Portal https://eprocure.gov.in/cppp/) or on the Purchaser's website with free access if available, or in the official gazette, the results identifying the bid and lot numbers and the following information: (i) name of each Bidder who submitted a Bid; (ii) bid prices as read out at bid opening; (iii) name and evaluated prices of each Bid that was evaluated; (iv) name of bidders whose bids were rejected and the reasons for their rejection; and (v) name of the successful Bidder, and the price it offered, as well as the duration and summary scope of the contract awarded.

42.3 The Purchaser shall promptly respond in writing to any unsuccessful Bidder who, after Publication of contract award, requests in writing the grounds on which its bid was not selected.

# Recourse Unsuccessful Bidders

to

- 42.4 Until a formal Contract is prepared and executed, the notification of award shall constitute a binding Contract.
- 42.5 Upon the successful Bidder's furnishing of the performance security and signing the Contract Form pursuant to ITB Clause 43. the Purchaser will promptly notify each unsuccessful Bidder and will discharge its bid security, pursuant to ITB Clause 19.5

### 43 Signing Contract

- of 43.1 Promptly after notification, the Purchaser shall send the successful Bidder the Contract Agreement.
  - 43.2 Within twenty-one (21) days of receipt of the Contract Agreement, the successful Bidder shall sign, date, and return it to the Purchaser.

# 44 Performance **Security**

44.1 Within twenty-one (21) days of the receipt of notification of award from the Purchaser, the successful Bidder, if required, shall furnish the Performance Security in accordance with the GCC, using for that purpose the Performance Security Form

included in Section X Contract forms, or another Form acceptable to the Purchaser. Failure of the successful Bidder to submit the above-mentioned Performance Security or sign the Contract shall constitute sufficient grounds for the annulment of the award and forfeiture of the Bid Security. In that event the Purchaser may award the Contract to the next lowest evaluated Bidder, whose bid is substantially responsive and is determined by the Purchaser to be qualified to perform the Contract satisfactorily.

# **SECTION II - BIDDING DATA SHEET**

The following specific data for the goods to be procured shall complement, supplement, or amend the provisions in the Instructions to Bidders (ITB). Whenever there is a conflict, the provisions herein shall prevail over those in ITB.

ITB Clause Reference	A. General
ITB 1.1	The Purchaser is: The Executive Engineer, Burdwan Investigation & Planning Division, I&WD, Govt. of WB, NH-2, Purta Bhawan, 3 <sup>rd</sup> Floor, Purba Burdwan-713103  The Engineer In-Charge is: Executive Engineer, Damodar Head Works
	Division, I&WD, D.V.C New Colony, Durgapur-2, Dist. Paschim Burdwan  (Executive Engineer, Durgapur Mechanical & Electrical Division will provide necessary technical support to the concerned Executive Engineer for implementation of SCADA under NHP)
ITB 1.1	The name and identification number of the NCB is: "Supply, installation, testing, commissioning, training, Operation and maintenance of SCADA based Automatic Operation of Durgapur Barrage"  Identification no of NCB: "WBIW/NHP/IFB-04/2019-20"  Package ID: NHP-2018-2019-WBSW-544004-GO-NCB-DE
ITB 1.2(a)	The Purchaser shall use the electronic-procurement system specified in BDS 7.1 to manage this Bidding process.
ITB 2.1	The Borrower is Government of India  Loan or Financing Agreement Amount: USD 175 Millions
ITB 2.1	The name of the Project is: National Hydrology Project
ITB 4.4	A list of firms debarred from participating in World Bank projects is available at <a href="http://www.worldbank.org/debarr">http://www.worldbank.org/debarr</a>

	<b>B.</b> Contents of Bidding Documents
ITB 7.1	Electronic –Procurement System
	The Purchaser shall use the following electronic-procurement system to manage this Bidding process: Tenders West Bengal ((The West Bengal Government e-procurement System) - <a href="https://wbtenders.gov.in">https://wbtenders.gov.in</a>
	(Intending bidders may also visit website <a href="www.wbiwd.gov.in">www.wbiwd.gov.in</a> ( <a and="" available="" be="" e-procurement"="" elsewhere.<="" href="the the the the the the the the the the&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;ITB 7.1a&lt;/td&gt;&lt;td&gt;A pre-bid meeting will be held: Yes&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;&lt;/td&gt;&lt;td&gt;Date of pre-bid meeting: 08-07-2019 Time: 11:30 AM&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;&lt;/td&gt;&lt;td&gt;Address: Office of Superintending Engineer, Investigation and Planning Circle No. II, Jalsampad Bhawan, 5th Floor, Salt Lake, Kolkata-700091&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;&lt;/td&gt;&lt;td&gt;Telephone: 0342-2646799 Facsimile number: Electronic mail address: seip2iwd@gmail.com Contact Persons: Executive Engineer, Burdwan Investigation and Planning Division.&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;&lt;/td&gt;&lt;td&gt;For &lt;u&gt;Clarification of bid purposes&lt;/u&gt; only, the Purchaser's address is:&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;&lt;/td&gt;&lt;td&gt;The Executive Engineer,&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;&lt;/td&gt;&lt;td&gt;Burdwan Investigation &amp; Planning Division, I&amp;WD,&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;&lt;/td&gt;&lt;td&gt;Govt. of WB, NH-2, Purta Bhawan, 3&lt;sup&gt;rd&lt;/sup&gt; Floor, Purba Burdwan-713103&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;&lt;/td&gt;&lt;td&gt;Telephone: 0342-2646799&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;&lt;/td&gt;&lt;td&gt;Email: eebipd2012@gmail.com  The bidders are allowed to request for clarifications through the on-line portal also.&lt;/td&gt;&lt;/tr&gt;&lt;tr&gt;&lt;td&gt;ITB 8.1&lt;/td&gt;&lt;td&gt;The addendum will appear on the e-procurement system under https://https://wbtenders.gov.in, " linkin="" not="" shall="" td="" www.wbiwd.gov.in=""></a>

### C. Preparation of Bids

### ITB 11.2(j)


The Bidder shall submit the following additional documents in its bid – technical part:

1. The following details shall also be provided by Bidders [to be submitted under 'My Documents (OID)' Folder]:

SL. No.	Folder Name	File Description		Details
			1	PAN Card
			2	GST Registration Certificate
I	Certificates	Certificates.pdf	1 PAN Card 2 GST Registration Certificate  3 Latest Income Tax Return and I.T Dep Return Acknowledgement / Receipt.  pdf 1 For Proprietorship Firms (Trade Licence) For Partnership Firms  (Partnership Deed, Trade Licence, Fro VIII/Memorandum of Registration) For all Companies  3 (Incorporation Certificate, Trade Licen Memorandum of Articles of ROC, List owners/ Directors/ Board Members)  1 Works completion Certificates  Profit & Loss account audited Balance Sh With annexure containing the appropriate designated Forms 3CA/ 3CD/3CB, as	Latest Income Tax Return and I.T Dept. Return Acknowledgement / Receipt.
		Companydetails.pdf	1	For Proprietorship Firms
		Companydetails.pdf	1	(Trade Licence)
	Company Details	2		For Partnership Firms
II				(Partnership Deed, Trade Licence, From- VIII/Memorandum of Registration)
				For all Companies
				(Incorporation Certificate, Trade License, Memorandum of Articles of ROC, List of owners/ Directors/ Board Members)
III	Credential of Work	Credential.pdf 1 Credential.pdf 2	1	Works completion Certificates
IV	Financial Credential	P/L and audited Balance Sheet for year-1 pdf1	Wi de ap Re	signated Forms 3CA/ 3CD/3CB, as plicable with Annual Turn- Over with I.T turn for last 3 years within the zone of

[to be submitted under 'Others' Folder of the 'Technical Cover']

- 1. Certification of incorporation of the Bidder and Manufacturer
- 2. The Bidder shall clearly confirm that all facilities exist with him (or manufacturer, as applicable) in his factory for inspection and testing and these can be accessed by the Purchaser or his representative for inspection.
- 3. Technical schedules of goods as required by technical specifications.
- 4. Descriptive Documents, drawings, notes and references of operating and assembly of mechanical parts.
- 5. A detailed description of the Goods essential technical and performance characteristics.

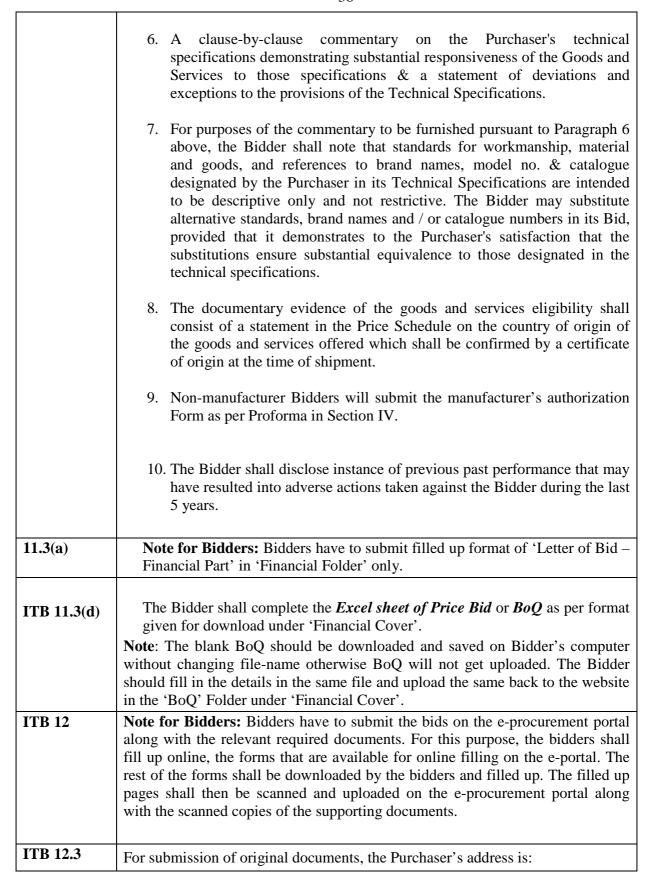

	Office of the Executive Engineer, Burdwan Investigation & Planning Division Purta Bhawan (3rd floor), Burdwan-713103 Country: INDIA Telephone number: 0342-2646799 E-mail address: eebipd2012@gmail.com
ITB 13.1	Alternative Bids "shall not be" considered.
ITB 14.5	The prices quoted by the Bidder "shall not" be subject to adjustment during the performance of the Contract.
ITB 14.7	The Incoterms edition is Incoterms 2010.
ITB 14.8 (a) (iii)	"Final destinations (Project Site)": (i) Durgapur Barrage site, (ii) office of the Executive Engineer, Durgapur Head Works Division, Asansole and (iii) Head office of Irrigation & Waterways Directorate, Salt Lake, Kolkata
ITB 14.9	As per latest instructions from Government of India.
ITB 16.4	Period of time the Goods are expected to be functioning (for the purpose of spare parts): 10 years after Final Acceptance
ITB 17.2 (b) (i)	Manufacturer's authorization is: required as per proforma in Section IV.
ITB 17.2 (b)iii	After Sales service is "required" which shall be provided by the Supplier or alternatively by its Agent in case of a foreign bidder.
ITB 18.1	The bid validity period shall be 90 days.
ITB 18.3(a)	The factor will 1.0007692 per week ( multiplicative)
ITB 19.1	Bid shall include a Bid Security in the form of Bank Guarantee (issued by Nationalized / Scheduled bank or Demand Draft in favour of <i>The Executive Engineer</i> , <i>Burdwan I&amp;P Division payable at Burdwan</i> included in Section IV Bidding Forms

ITB 19.3	The amount of the Bid Security shall be: Rs.9,00,000/- (Rupees Nine lakhs only)
ITB 19.3 (a)	Other types of acceptable securities are:
	Fixed Deposit/Time Deposit certificate issued by a Nationalized or Scheduled Bank located in India for equivalent or higher values are acceptable provided it is pledged in favour of <i>Executive Engineer</i> , <i>Burdwan Investigation &amp; Planning Division</i> , <i>Burdwan</i> , (Purchaser) and such pledging has been noted and suitably endorsed by the bank issuing the certificate.
ITB 19.9	Not applicable
ITB 20.2	The written confirmation of authorization to sign on behalf of the Bidder shall consist of: 1. Original Power of Attorney; 2. Original affidavit vouching for the correctness of the information furnished and documents uploaded;
	D. Online Submission and Opening of Bids
ITB 21.1	Class of DSC required is: A suitable Class 2 Digital Signature Certificate registered in the name of a representative who is authorised to submit online offers for e-procurement applications.
ITB 22.1	The deadline for uploading of Bids is: Date: 23-07-2019 Time: 15:00 HRS (System Server Time)
ITB 24.1	Re-submission of the bid is "not allowed", if withdrawn.
	E. Public Opening of Technical Parts of Bids
ITB 25.1	The online opening of the Technical Parts of Bids shall take place at:  Address: Office of the Superintending Engineer, Investigation & Planning Circle No. II, Jalasampad Bhawan Bhawan(5 <sup>th</sup> floor), Salt Lake, Kolkata-700091, INDIA

	Date: 23-07-2019 Time: 15:30 PM
	F. Evaluation of Bids – General Provisions
ITB 29.3	The adjustment shall be based on the highest price of the item or component as quoted in other substantially responsive Bids, subject to a maximum of the estimated price of the item. If the price of the item or component cannot be derived from the price of other substantially responsive Bids, the Purchaser shall use its best estimate.
	H. Public Opening of Financial Parts of Bids
ITB 33.2 (c)	Following the completion of the evaluation of the Technical Parts of the Bids, the Purchaser will notify all Bidders of the date and time of the public opening of Financial Parts.
	Date: To be notified later.
	Time: To be notified later.
	The online opening of the Financial Parts of Bids (for Technically Qualified Bidders) shall take place at:
	As specified in ITB 25.1 above.
	I. Evaluation and Comparison of Bids
ITB 34.1(a)	Evaluation will be done for all items together.  Bids will not be evaluated for each item separately and single Contract will be concluded with the successful bidder.
	concluded with the successful butter.
ITB 34.1(f)	The evaluation will take into account the cost of <i>system including</i> warranty period of 5 years.
ITB 34.3	Not Applicable
ITB 34.4	Replace with following:
	The Purchaser's evaluation of a bid will exclude and not take into account:
	(a) In the case of Goods manufactured in India or goods of foreign origin

	,
	already located in India, GST and other similar taxes, which will be payable on the goods if a contract is awarded to the Bidder;
	(b) Not Used.
	(c) any allowance for price adjustment during the period of execution of the contract, if provided in the bid.
	But, the purchaser's evaluation of a bid will include i) price for inland transportation, insurance, and other local services required to convey the Goods to their Final Destination; and (ii) price for Related Services, if any.
	The adjustments shall be determined using the following criteria, from amongst
ITB 34.5	those set out in Section III, Evaluation and Qualification Criteria:  (a) Deviation in Delivery schedule: NA
	F
	(b) Deviation in payment schedule: NA
	(c) the cost of major replacement components, mandatory spare parts, and service: 'Not Applicable'
	(d) the availability in the Purchaser's Country of spare parts and after-sales services for the equipment offered in the bid 'Not Applicable'
	(e) the projected operating and maintenance costs during the life of the equipment <i>is</i> 'Not Applicable'
	(f) the performance and productivity of the equipment offered 'Not Applicable']
	J. Award of Contract
ITB 41.1	The maximum percentage by which quantities may be increased is: 15%
	The maximum percentage by which quantities may be decreased is: 15%

### SECTION III. EVALUATION AND QUALIFICATION CRITERIA

This Section complements the Instructions to Bidders. It contains the criteria that the Purchaser shall use to evaluate a bid and determine whether a Bidder qualifies in accordance with ITB 32 & 34. No other criteria shall be used.

#### TECHNICAL PART

#### 1 Qualification (ITB 32)

#### 1.1 Qualification Criteria (ITB 32.1)

The Purchaser shall assess each Bid against the following Qualification Criteria. Requirements not included in the text below shall not be used in the evaluation of the Bidder's qualifications.

#### I- General:

- i) Bidder should be in continuous business of supplying and after sale services of products similar to that specified in the 'Schedule of requirement' during the last 5 years prior to date of bid submission.
- ii) Bidder shall furnish the legal status, place of registration and principal place of business of the company or firm or partnership, etc.;
- iii) Details of experience and past performance on equipment (PLC/RTU based SCADA system) offered within the past five years (Prior to the date of bid submission) and details of current contracts in hand and other commitments (suggested Proforma given in Section IV).
- iv) The bidder should furnish a brief write-up, backed with adequate data, explaining his available capacity and experience (both technical and commercial) for the supply of the required equipment within the specified time of completion after the meeting all their current commitments.
- v) Reports on financial standing of the bidder such as profit and loss statements, balance sheets and auditor's report for the past three years, banker's certificate, etc.
- vi) A firm can submit only one bid in the same bidding process as a bidder. A bidder who submits or participates in more than one bid will cause all the bids in which the bidder has participated to be disqualified.
- vii) Should possess GST Registration.
- viii) The SCADA based PLC/RTU system offered by the bidder must have been fully type tested as per relevant IS/international standards during any year in last 10 years from the date of bid opening. Photo copies of such type of type test reports/certificates must be submitted.

#### **II.** Financial Capability

The Bidder shall furnish documentary evidence that it meets the following financial requirement(s):

Capacity to have a cash flow - The Bidder must provide a letter from a reputed bank stating the availability of liquid assets and/or credit facilities exclusively for this Contract only, of not less than **Rs.150.00 Lac or its equivalent amount in a freely convertible currency**.

The Minimum required annual turnover in respect of supply, installation and commissioning of goods and services for the successful Bidder in any two of the last five (5) years shall be **Rs. 450.00 Lac** *or its equivalent amount in a freely convertible currency*. Period of 5 years shall be reckoned from 31st march of financial year preceding the year in which bid is published.

### III- Experience and Technical Capacity of Bidder

The Bidder shall furnish documentary evidence to demonstrate that it meets the following experience requirement(s):

The bidder must have supplied, installed and commissioned & successfully completed PLC/RTU based SCADA system in water sector (Irrigation, water supply, water utility applications in Power industry) with satisfactory operation for at least two years period in any one/two contracts of PLC/RTU based SCADA system of total contract value not less than **Rs.300.00 Lac.** 

Bidder shall invariably furnish self-attested copies of Work Orders, Completion Certificate and Performance Certificate for two year from the date of installation support of above equipment's for water sector (Irrigation, water supply, water utility applications in Power industry) under Govt./Public sector/Private sector.

#### IV Manufacturer Authorization for equipment's

If the bidder is not the manufacturer of PLC/RTU & SCADA (i.e. listed in schedule of requirements), the bidder shall furnish a legally enforceable authorization from manufacturer in the prescribed Form [Section-IV] assuring full guarantee and warranty obligations as per GCC and SCC for the goods offered;

If the bidder, himself is a manufacturer of the equipment's (listed in Schedule of requirements), then a self-authorization suffices.

Further, bidder should furnish the documentary evidence from the manufacturer of the equipment's (PLC/RTU and SCADA) to establish that the manufacturer has manufactured and supplied the 100% quantity of the equipment as specified in schedule of requirements in each of the year during a period of last 5 years from the last date of submission of bid document.

The bidder should have after sales support in the region (within a radius of 500 km from the State Capital). If bidder does not have any after sales support office within 500 km from state Capital at the time of bidding, he shall require to establish the same within one month after successful award of contract.

#### 2. Margin of Preference (ITB 37) – Not Applicable

3. Evaluation (ITB 30, 31, and 34)

#### 3.1. Evaluation Criteria (ITB 34.5)

The Purchaser shall use the criteria and methodologies listed in this Section to evaluate Bids. By applying the criteria and methodologies, the Purchaser shall determine the substantially responsive lowest-evaluated bid.

#### 3.2. Multiple Contracts (ITB 34.3)-Deleted

### SECTION IV – BIDDING FORMS

### 1A. LETTER OF BID-TECHNICAL PART

The Bidder must prepare the Letter of Bid on stationery with its letterhead clearly showing the Bidder's complete name and address.

Note: All italicized text is for use in preparing these forms and shall be deleted from the final products.

No alterations to the text except as provided in ITB 20.2 shall be permitted and no substitutions shall be accepted except as provided in ITB 12.]

Date: [insert date (as day, month and year) of Bid Submission]

NCB No.: [insert number of bidding process] Invitation for Bid No.: [insert No of IFB]

Alternative No.: [insert identification No if this is a Bid for an alternative]

To: [insert complete name of Purchaser]

We, the undersigned, declare that:

- (a) We have examined and have no reservations to the Bidding Documents, including Addenda No. issued in accordance with ITB 8: [insert the number and issuing date of each Addenda];
- (b) We meet the eligibility requirements and have no conflict of interest in accordance with ITB 4;
- (c) We have not been suspended nor declared ineligible by the Purchaser based on execution of a Bid Securing Declaration in the Purchaser's country in accordance with ITB 4.6;
- (d) We offer to supply in conformity with the Bidding Documents and in accordance with the Delivery Schedules specified in the Schedule of Requirements the following Goods and Related Services [insert a brief description of the Goods and Related Services];
- (e) Our bid shall be valid for the period of time specified in ITB Sub-Clause 18.1, from the date fixed for the bid submission deadline in accordance with ITB Sub-Clause 22, and it shall remain binding upon us and may be accepted at any time before the expiration of that period;
- (f) If our bid is accepted, we commit to obtain a performance security in accordance with the Bidding Documents:
- (g) We are not participating, as a Bidder or as a subcontractor, in more than one bid in this bidding process in accordance with ITB 4.2(e), other than alternative bids submitted in accordance with ITB 13;
- (h) We, along with any of our subcontractors, suppliers, consultants, manufacturers, or service providers for any part of the contract, are not subject to, and not controlled by any entity or individual that is subject to, a temporary suspension or a debarment imposed by the World Bank Group or a debarment imposed by the World Bank Group in accordance with the Agreement for Mutual Enforcement of Debarment Decisions between the World Bank and other development

banks. Further, we are not ineligible under the Purchaser's Country laws or official regulations or pursuant to a decision of the United Nations Security Council;

- (i) We are not a government owned entity/ We are a government owned entity but meet the requirements of ITB 4.5;<sup>1</sup>
- (j) We understand that this bid, together with your written acceptance thereof included in your notification of award, shall constitute a binding contract between us, until a formal contract is prepared and executed;
- (k) We understand that you are not bound to accept the lowest evaluated bid or any other bid that you may receive;
- (l) We hereby certify that we have taken steps to ensure that no person acting for us or on our behalf will engage in any type of fraud and corruption; and
- (m)We undertake that, in competing for (and, if the award is made to us, in executing) the above contract, we will strictly observe the laws against fraud and corruption in force in India namely, "Prevention of Corruption Act 1988."

Name of the Bidder [insert complete name of person signing the Bid]

Name of the person duly authorized to sign the Bid on behalf of the Bidder\*\* [insert complete name of person duly authorized to sign the Bid]

Title of the person signing the Bid [insert complete title of the person signing the Bid]

Signature of the person named above *[insert signature of person whose name and capacity are shown above]* 

Date signed [insert date of signing] day of [insert month], [insert year]

\*\*: Person signing the Bid shall have the power of attorney given by the Bidder to be attached with the Bid Schedules.

\_

<sup>&</sup>lt;sup>1</sup>Bidder to use as appropriate

## 1B. LETTER OF BID- FINANCIAL PART- TO BE SUBMITTED IN FINANCIAL BID ONLY

The Bidder must prepare the Letter of Bid on stationery with its letterhead clearly showing the Bidder's complete name and address.

Note: All italicized text is for use in preparing these forms and shall be deleted from the final products.

No alterations to the text except as provided in ITB 20.2, shall be permitted and no substitutions shall be accepted except as provided in ITB 12.]

Date: [insert date (as day, month and year) of Bid Submission]

NCB No.: [insert number of bidding process]
Invitation for Bid No.: [insert No of IFB]

Alternative No.: [insert identification No if this is a Bid for an alternative]

To: [insert complete name of Purchaser]

We, the undersigned Bidder, hereby submit the second part of our Bid, the Financial Part. In submitting our Financial Part we make the following additional declarations:

- (a) Our bid shall be valid for the period of time specified in ITB Sub-Clause 18.1, from the date fixed for the bid submission deadline in accordance with ITB Sub-Clause 22, and it shall remain binding upon us and may be accepted at any time before the expiration of that period;
- (b) The total price of our Bid, excluding any discounts offered in item (c) below, is:

In case of only one lot, total price of the Bid [insert the total price of the bid in words and figures];

In case of multiple lots, total price of each lot [insert the total price of each lot in words and figures];

In case of multiple lots, total price of all lots (sum of all lots) [insert the total price of all lots in words and figures];

- (c) The discounts offered and the methodology for their application are:
  - (i) The <u>discounts offered are: [Specify in detail each discount offered.]</u>
  - (ii) The exact method of calculations to determine the net price after application of discounts is shown below: [Specify in detail the method that shall be used to apply the discounts]; Discounts.
- (d) The following commissions, gratuities, or fees have been paid or are to be paid with respect to the bidding process or execution of the Contract: [insert complete name of each Recipient, its full address, the reason for which each commission or gratuity was paid and the amount and currency of each such commission or gratuity]

Name of Recipient	Address	Reason	Amount
	_		
	_		

(If none has been paid or is to be paid, indicate "none.")

(e) We understand that this bid, together with your written acceptance thereof included in your notification of award, shall constitute a binding contract between us, until a formal contract is prepared and executed.

Name of the Bidder [insert complete name of person signing the Bid]

Name of the person duly authorized to sign the Bid on behalf of the Bidder\*\* [insert complete name of person duly authorized to sign the Bid]

Title of the person signing the Bid [insert complete title of the person signing the Bid]

Signature of the person named above *[insert signature of person whose name and capacity are shown above]* 

Date signed \_[insert date of signing] day of [insert month], [insert year]

\*\*: Person signing the Bid shall have the power of attorney given by the Bidder to be attached with the Bid Schedules.

### 2. BIDDER INFORMATION FORM

[The Bidder shall fill in this Form in accordance with the instructions indicated below. No alterations to its format shall be permitted and no substitutions shall be accepted.]

-	,	lay, month and ber of bidding p	year) of Bid Submis process]	sion]
Page	of	pages		

- 1. Bidder's Legal Name [insert Bidder's legal name]
- 2. Bidder's actual or intended Country of Registration: [insert actual or intended Country of Registration]
- 3. Bidder's Year of Registration: [insert Bidder's year of registration]
- 4. Bidder's Legal Address in Country of Registration: [insert Bidder's legal address in country of registration]
- 5. Bidder's Authorized Representative Information

Name: [insert Authorized Representative's name]

Address: [insert Authorized Representative's Address]

Telephone/Fax numbers: [insert Authorized Representative's telephone/fax numbers]

Email Address: [insert Authorized Representative's email address]

6. Attached are copies of original documents of: [check the box(es) of the attached original documents]

Articles of Incorporation or Registration of firm named in 1, above, in accordance with ITB Sub-Clauses 4.3.

In case of government owned entity from the Purchaser's country, documents establishing legal and financial autonomy and compliance with commercial law and not dependent agency of borrower or sub-borrower or purchaser, in accordance with ITB Sub-Clause 4.5.

Included are the organizational chart ,a list of Board of Directors, and the beneficial ownership

## 3. FORM OF AFFIDAVIT FOR CORRECTNESS OF INFORMATION AND DOCUMENTS SUBMITTED WITH BID

[Reference ITB 20.2]

[This affidavit should be on a non-judicial stamp paper of Rs.10/- and shall be attested by Magistrate/Sub-Judge/Notary Public]
I,
1. I hereby certify that all the information and documents furnished with the Bid submitted online in response to IFB number date issued by (authority inviting bids) for (name and identification of Goods & Related Services) are true and correct.
2. *I hereby certify that I have been authorised by
Place: Date:

\* This sub-paragraph is not applicable if the Bidder is an individual and is signing the Bid on his own

behalf.

### 4. Price Schedule Forms

[The Bidder shall fill in these Price Schedule Forms in accordance with the instructions indicated. The list of line items in column 1 of the **Price Schedules** shall coincide with the List of Goods and Related Services specified by the Purchaser in the Schedule of Requirements.]

Note: Bidders are required to populate the Excel file containing the BOQ (uploaded along with the NIQ) and upload it in the requisite financial folder for submission of the bid

A. PRICE SCHEDULE FOR SUPPLY OF GOODS AS PER SCHEDULE OF REQUIREMENT

# A. PRICE SCHEDULE FOR SUPPLY OF GOODS AS PER SCHEDULE OF REQUIREMENT

	Tender Inviting Authority: The Execut	tive Engine	er, Burdwa	n Investig	gation &	& Planning	Division, 3rd	floor, Purta Bh	awan, Purba	Burdwan
	Name of Work: Supply, installation, testing, commissioning, training, Operation and maintenance of SCADA based Automatic Operation of Durgapur Barrage									
	Contract No:									
Name of the Bidder/ Bidding Firm / Company	Name of the Bidder/ Bidding Firm / Company :									
	(This BOQ template must not be modified/r be reject	eplaced by t	he bidder and	the same	TO GIV	EN IN RUPE be uploaded	ES (INR) ONLY) after filling the r r Name and Valu	elevant columns,	else the bidder	is liable to
1	2	3	4	5	6	7	8	9	10	11
Line Item No	Description of Goods	Country of Origin	Delivery Date	Quantity	Unit	Unit price EXW [excludin g GST and other taxes if any]	Total EXW price per line item [excluding GST and other taxes if any] (Col. 5×7)	Price per line item for inland transportation, insurance and other services required to convey the Goods to their final destination (ITB 14.8 (a)(iii))	Total GST and other taxes payable per item if Contract is awarded (in accordance with ITB 14.8(a)(ii)	Total Price per line item excluding GST (Col. 8+9)

### LOCAL CONTROL SYSTEM for Durgapur Barrage Control

I.	Supply of PLC/RTU system with software development of PLC/RTU, Control Panel with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HMI display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as per technical specification.	4-6 months from date of signing of contract	c 12	Nos.			
2	Supply of Shaft Encoder based rotary position sensor with Digital Display & proximity limit switches type Gate Position Sensors for indication and monitoring of Spillway gates, Intake Gates, Silt flushing gates including cabling & integration with PLC/RTU as per technical specifications.	4-6 months from date of signing of contract	44	Nos.			
3	Supply of Automated Water Level transmitter non-contact RADAR type having 30m range for measuring level & downstream discharge of barrage/rivers & head regulators, including all necessary cabling with suitable conduits & electrical fittings complete as per technical specification	4-6 months from date of signing of contract	9	Nos.			
4.	Supply of Datalogger of 2 channel input type with GPRS/Gsm telemetry for datalogging & transmission of Real time data from Level transmitters at Asansol in the downstream of Maithon dam, at Panchet and Maithon dam, to SCADA system , with all relevant mounting accessories. As per technical specifications	4-6 months from date of signing of contract	3	Nos.			

			3	-			
5	Supply of solar panel, charger regulator, batteries, lightening arrestor with all connectors, cables and conduit for cables for providing un interrupted power supply to dataloggers, as per technical specifications.	4-6 months from date of signing of contract	3	Nos.			
6	Supply of 3 Phase VFD Starter of 3 Kw panel for each motor which shall consists of VFD, S.P.P, MCB, OLR, Timer, Main Switches including cabling & Electronic Digital Indicator complete as per technical specifications.	4-6 months from date of signing of contract	10	Nos.			
7	Supply of 3 Phase VFD Starter of 2.2 Kw panel for each motor which shall consists of VFD, S.P.P, MCB, OLR, Timer, Main Switches including cabling & Electronic Digital Indicator complete as per technical specifications.	4-6 months from date of signing of contract	34	Nos.			
8	Supply of IP based Bullet Camera (Fixed Type)- Night Vision (I.R.) Outdoor Weather Resistant, 2 Mega Pixel ,72 LED Color Camera. 6 OR 8 or 12 MM (According to site suitability) 2 MP Auto Iris Lens in Elegant Metal Die Cast Housing. Outdoor weather resistant IP 66, for monitoring the gates operation complete as per technical specifications.	4-6 months from date of signing of contract	44	Nos.			
9	Supply of Pan Tilt Zoom (PTZ) 36 X Optical and 12 X Digital Zoom; 2 Mega Pixel IP based (DIGITAL) Sensor, 500 mtrs. Night Vision (Multiple Intelligent Array system) in IP66 Weather Resistant Outdoor Metallic Housing. Outdoor weather resistant IP 66 including cabling required for Barrage monitoring. As per technical specifications	4-6 months from date of signing of contract	2	Nos.			
10	Supply of Automated Weather Stations set which includes Rain Gauge, Air temperature, Air pressure, Relative humidity, Wind speed & Direction, Solar Radiation Sensors, & its accessories as per technical specification	4-6 months from date of signing of contract	1	No			

Π								
	Barrage Control Room Equipmen	nt's						
11	Supply of Main PLC Controller system with firm ware based hot redundancy which shall include software development of PLC, Control Panel with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. All the Electrical fittings will be Industrial Type. Including suitable switch mode power supply (SMPS), 12" display & cabling with related remote PLC/RTU's, complete as per technical specification.	4-6 months from date of signing of contract	1.	No.				
12	Supply, engineering and development of customized SCADA software for complete Barrage automation with life time licensed version as per technical specifications.	4-6 months from date of signing of contract	1	Nos.				
13	Supply of Master server which includes Server with server Rack and industrial grade monitor with USB, RS232/RS485, Ethernet Ports, OS Windows 8 or higher compatible to SCADA System complete as per technical specifications.	4-6 months from date of signing of contract	2.	Nos.				
14	Supply of NETWORK VIDEO RECORDER (NVR) 48 Channel 1080 P Full HD, Real time Recording and Reviewing in Compression Format. As per technical Specifications.	4-6 months from date of signing of contract	1.	No				
15	Supply of IT Hardware which includes required Static IP, Router with modem, Switch, firewall system and A3 color printer as per technical specifications	4-6 months from date of signing of contract	1	No.				
16	Supply of 110" LED Display/ Video wall/ (70", 2X1) DLP based System for monitoring of SCADA & surveillance system at Control Room as per technical specifications	4-6 months from date of signing of contract	1	No.				

17	Supply of online 3 KVA UPS with Battery system for power back up of Barrage control room equipment's including all necessary cabling & electrical fittings complete as per the technical specifications	4-6 months from date of signing of contract	1	No				
18	Supply of laptops & 4G/3G internet dongles along with licenced version of Client SCADA software for remote viewing & monitoring of Barrage automation as per technical specifications.	4-6 months from date of signing of contract	4.	No.				
19	Supply of Diesel Generator Set 10 KVA with Earth Pits for earthling & all associated accessories as per technical specifications.	4-6 months from date of signing of contract	1	No.				
Grand Total of GST	Quoted GST in Words		xxxxxx	XXXXXX	XXXX		XXX	
Grand Total (A)	Quoted Rate in Words excluding GST		XXXXXXX	XXXXXX	<u>XXXX</u>			XXX

### B. PRICE AND COMPLETION SCHEDULE - RELATED SERVICES

Burdwan	Tender Inviting Authority: The Executive Engi	neer, Burdwan	Investigation	on & Plannin	g Division, 3rd flo	or, Purta Bhawan,	Purba
	Name of Work: Supply, installation, testing,	commissionin	g, training,	Operation of	and maintenance	of SCADA based	Automatic
Operation	of Durgapur Barrage						
	Contract No:						
	Name of the Bidder/ Bidding Firm / Company:						
		DDICE	SCHEDULE				
	(DOMESTIC TEI	<u>i Nice</u> Iders - Rates A		I IN RUPEES (IN	NR) ONLY)		
	(This BOQ template must not be modified/ replaced			•	•	evant columns, else ti	he bidder is liable
	to be rejected for this tend						
1	2	3	4	5	6	7	8
Service	Description of Services	Delivery	Quantity	Unit	Unit price	Total GST and	Total Price
No	_	Date at			(excluding	other taxes payable per item if	per Service
		place of			GST)	Contract is	excluding
		Final				awarded (in accordance with	GST
	,	destinatio				ITB 14.8(a)(ii)	(Col. 4*6)
		n					
	Installation of the systems including as	sociated civil	works wh	nich also ind	clude Performai	nce and supervisi	on of the on-
	site assembly and/or start-up of the sup					1	
1			4	5	6	7	8
1	site assembly and/or start-up of the sup	pplied Goods 3	4	5			
1	site assembly and/or start-up of the sup  2  LOCAL CONTROL SYSTEM for Installation, testing & Commissioning or	pplied Goods 3 r Durgapur	4 Barrage	5 e Control			
1	2  LOCAL CONTROL SYSTEM for Installation, testing & Commissioning or PLC/RTU system with software.	pplied Goods  3  r Durgapur  12 months	4 Barrage	5			
1	2  LOCAL CONTROL SYSTEM for Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane	3 r Durgapur  12 months from date of signing	4 Barrage	5 e Control			
1	2  LOCAL CONTROL SYSTEM for Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted	3 r Durgapur  12 months from date of signing	4 Barrage	5 e Control			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply	3 r Durgapur  12 months from date of signing of contract	4 Barrage	5 e Control			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including	T Durgapur  12 months from date of signing of contract	4 Barrage	5 e Control			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply	T Durgapur  12 months from date of signing of contract	4 Barrage	5 e Control			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back	T Durgapur  12 months from date of signing of contract	4 Barrage	5 e Control			
1	2  LOCAL CONTROL SYSTEM for Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Panewith front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting	T Durgapur  12 months from date of signing of contract	4 Barrage	5 e Control			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting & cabling with suitable conduits complete	T Durgapur  12 months from date of signing of contract	4 Barrage	5 e Control			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as pe	T Durgapur  12 months from date of signing of contract	4 Barrage	5 e Control			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting & cabling with suitable conduits complete	pplied Goods  3  r Durgapur  12 months from date of signing of contract	4 Barrage	5 e Control Nos.			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as petechnical specification.  Installation, testing & commissioning of Shaft Encoder based rotary position sensor	The special of the sp	4 Barrage	5 e Control			
1	LOCAL CONTROL SYSTEM for Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as petechnical specification.  Installation, testing & commissioning of Shaft Encoder based rotary position sensor with Digital Display & proximity limited.	The splied Goods  3  The Durgapur Strong date of signing of contract Strong date of signing of contract Strong date of signing	4 Barrage	5 e Control Nos.			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as petechnical specification.  Installation, testing & commissioning of Shaft Encoder based rotary position senso with Digital Display & proximity limit Switches type Gate Position Sensors for	The splied Goods  3  The Durgapur Strom date of signing of contract strom date of signing strom date of signin	4 Barrage	5 e Control Nos.			
1	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Panewith front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as petechnical specification.  Installation, testing & commissioning of Shaft Encoder based rotary position sensor with Digital Display & proximity limit Switches type Gate Position Sensors for indication and monitoring of Spillway.	The purpose of the pu	4 Barrage	5 e Control Nos.			
1 2.	Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as petechnical specification.  Installation, testing & commissioning of Shaft Encoder based rotary position senso with Digital Display & proximity limit Switches type Gate Position Sensors for	polied Goods  3  r Durgapur  12 months from date of signing of contract  12 months from date of signing of contract	4 Barrage	5 e Control Nos.			
1	LOCAL CONTROL SYSTEM for Installation, testing & Commissioning of PLC/RTU system with softward development of PLC/RTU, Control Pane with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HM display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as petechnical specification.  Installation, testing & commissioning of Shaft Encoder based rotary position sensor with Digital Display & proximity limit Switches type Gate Position Sensors for indication and monitoring of Spillway gates, Intake Gates, Silt flushing gates.	polied Goods  3  r Durgapur  12 months from date of signing of contract  12 months from date of signing of contract	4 Barrage	5 e Control Nos.			

3.	Installation, testing & Commissioning of	12 months	09	Nos.		
	Automated Water Level transmitter non- contact RADAR type having 30m range for measuring upstream level & downstream discharge of barrage/rivers & head regulators. including all necessary cabling & electrical fitting & integration	from date of signing of contract	09	NOS.		
	with PLC/RTU/Dataloggers complete, as per technical specification					
4	Installation, testing & Commissioning of Datalogger of 2 channel input type with GPRS/Gsm telemetry for datalogging & transmission of Real time data from Level transmitters at Asansol in the downstream of Maithon dam, at Panchet and Maithon dam, to SCADA system, with all relevant mounting accessories. As per technical specifications	12 months from date of signing of contract	03	Nos.		
5	Installation, testing & Commissioning of solar panel, charger regulator, batteries, lightening arrestor with all connectors, cables and conduit for cables for providing un interrupted power supply to dataloggers, as per technical specifications.	12 months from date of signing of contract	03	Nos.		
6	Installation, testing & commissioning of 3 Phase VFD Starter panel of 3.0 Kw for each motor which consists of VFD, S.P.P, MCB, OLR, Timer, Main Switches including cabling, integration with PLC/RTU & Electronic Digital Indicator complete as per technical specifications.	12 months from date of signing of contract	10	Nos.		
7.	Installation, testing & commissioning of 3 Phase VFD Starter panel of 2.2 Kw for each motor which consists of VFD, S.P.P, MCB, OLR, Timer, Main Switches including cabling, integration with PLC/RTU & Electronic Digital Indicator complete as per technical specifications.	12 months from date of signing of contract	34	Nos.		
8	Installation, testing &Commissioning & integration with NVR located at Barrage Control Room of IP based Bullet Camera (Fixed Type)- Night Vision (I.R.) Outdoor Weather Resistant, 2 Mega Pixel ,72 LED Color Camera. 6 OR 8 or 12 MM (According to site suitability) 2 MP Auto Iris Lens in Elegant Metal Die Cast	12 months from date of signing of contract	44	Nos.		
	Housing. Outdoor weather resistant IP 66, for monitoring the gates operation complete as per technical specifications.					

10	Installation, Testing & Commissioning & integration with NVR Located at Barrage Control Room of Pan Tilt Zoom (PTZ) Cameras, 36 X Optical and 12 X Digital Zoom; 2 Mega Pixel IP (DIGITAL) Sensor, 500 mtrs. Night Vision (Multiple Intelligent Array system) in IP66 Weather Resistant Outdoor Metallic Housing. Outdoor weather resistant IP 66 including cabling required for Barrage monitoring complete in all respects as per technical specifications.  Installation testing & Commissioning of Automated Weather Stations which includes Rain Gauge, Air temperature, Air pressure, relative humidity, wind speed & direction, solar radiation set, including associated civil works and integration with	12 months from date of signing of contract  12 months from date of signing of contract		Nos.		
	PLC/RTU as per technical specifications.					
	Barrage Control Room Equipmen	t's				
11	Installation, Testing & Commissioning of Main PLC Controller system with firm ware based hot redundancy which shall include software development of PLC, Control Panel with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Including suitable switch mode power supply (SMPS) ,12" display & cabling with Industrial grade type electrical fittings for related remote PLC/RTU's, as per technical specification.		1	Nos.		
12	Installation, testing & Commissioning of customized SCADA software for complete Barrage automation with life time licensed version as per technical specifications.	from date of signing of contract	1	No.		
13	Installation, Testing & Commissioning of Master server with SCADA Software which includes Server with server Rack and industrial grade monitor with USB, RS232/RS485, Ethernet Ports, OS Windows 8 or higher compatible to SCADA System complete as per technical specifications	12 months from date of signing of contract	2	Nos.		
14	Installation, testing & commissioning of NETWORK VIDEO RECORDER (NVR) 48 Channel 1080 P Full HD, Real time Recording and Reviewing in Compression Format. Asper technical Specifications.	12 months from date of signing of contract	1	Nos.		

П	T	1	T 2		T	
15	Installation, Testing & Commissioning of IT Hardware which includes required Static IP, Router with modem, Switch, firewall system and A3 color printer as per technical specifications	from date of signing of contract	1	No.		
16		12 months from date of signing of contract	1	No.		
17	Charges for high speed synchronous internet connection (min. 8 mbps upload and download speed) & Static IP for Five years.	from date of signing of contract		No.		
18	Charges for 4G/3G internet dongles for five years which is to be provided along with laptops having lifetime licenced version of Client SCADA software for remote viewing & monitoring of Barrage automation as per technical specifications	12 months from date of signing of contract	4	Nos.		
19	Installation, Testing & Commissioning of Online 3 KVA UPS with Battery system for power back up of Barrage control room equipment's, including cabling & integration as per the technical specifications	12 months from date of signing of contract	1	No		
20	Installation, Testing and Commissioning of Diesel Generator Set 10 KVA with 04 Earth Pits for earthing, Starter Panel, Energy meter, cabling and all associated accessories Complete in all respects as per technical specifications.	12 months from date of signing of contract	1.	No		
21	Five Years Operation & Maintenance and Comprehensive Warranty for SCADA based Barrage automation system as per Price schedule after final acceptance of SCADA & Surveillance system. This includes replacement of material & consumable as & when required at bidders' cost and also necessary up gradation of SCADA system. The cost of Communication for GPRS & SIM charges for data transmission & other related charges.	Ongoing activity for 5 years	1	No.		
	Minimum One Service Engineer shall be placed at Barrage Control Room for Operation of SCADA & Surveillance system.					

22	Training of the purchaser's personnel at the supplier's plant and/or/onsite in assembly, start up, operation, maintenance and/or repair of the supplied goods. Course topics will include sensor calibration, PLC/RTU & SCADA configuration, data downloading, data retrieval, collection, Trouble shooting, processing maintenance requirements and procedure for equipment configuration, installation, site testing and commissioning including training kit containing course material in soft and hard copies.	activity for five years	8	Nos.			
Grand Total of GST	Quoted GST in Words		XXXX XXXX				
Grand Total (B)	Quoted Rate in Words		XXXX				XXXX
Grand Total (A+B)							

### 5. Forms of Bid Security

### Form of Bid Security - Bank Guarantee

[Guarantor letterhead or SWIFT identifier code]

	[insert guarantee reference number] [insert date of issue of the guarantee]
WHEREAS,submitted his Bid dated	[date] or will submit his Bid for the supply of
Invitation for Bids No	[name of Contract] (hereinafter called "the Bid") under[insert number] (hereinafter called "the IFB")
2	

<sup>&</sup>lt;sup>2</sup>In the case of a JV, the bidder should be stated as "a Joint Venture consisting of ......, and ......".

KNOW AI	LL PEC	OPLE by	these presents that	We	7 1 '	[name of bank] o
			[name	(hereinafter	called "the E	Bank") are bound unt
sum of				of Purchaser] ayment well a		ed "the Purchaser ") in th de to the said Purchaser th
SEALED v	with the	e Commo	on Seal of the said I	Bank this	day of	20
THE CON	DITIO	NS of thi	s obligation are:			
	(1)	validity				d during the period of Biept the correction of the Bi
or						
	(2)		Applicant having be the period of Bid v		of the acceptance	of his bid by the Purchase
		(a)	fails or refuses t Instructions to B		_	nent in accordance with th
		(b)	fails or refuses t Instruction to Bio		Performance Secu	rity, in accordance with th
without the	e Purch	aser hav ount clain	ing to substantiate	his demand, p to him owing	rovided that in his	of his first written demands demand the Purchaser will be of one or any of the foundations.
extended b	or subn by the I	nission o Purchase	f Bids as such dead	extension(s) to	the Bank is here	4 days after the sto Bidders or as it may be by waived. Any demand i
DATE			SIGNATU	JRE OF THE I	BANK	

<sup>&</sup>lt;sup>3</sup>The Applicant should insert the amount of the guarantee in words and figures denominated in Indian Rupees. This figure should be the same as shown in Clause 19.1 of the Instructions to Bidders.

<sup>&</sup>lt;sup>4</sup>45 days after the end of the validity period of the Bid.


Note: All italicized text (including footnotes) is for use in preparing this form and shall be deleted from the final product.

### 6. MANUFACTURER'S AUTHORIZATION

[The Bidder shall require the Manufacturer to fill in this Form in accordance with the instructions indicated. This letter of authorization should be on the letterhead of the Manufacturer and should be signed by a person with the proper authority to sign documents that are legally binding on the Manufacturer shall include it in its bid.

Date: [insert date (as day, month and year) of Bid Submission]

NCB No.: [insert number of bidding process]

To: [insert complete name of Purchaser]

#### **WHEREAS**

We [insert complete name of Manufacturer], who are official manufacturers of [insert type of goods manufactured], having factories at [insert full address of Manufacturer's factories], do hereby authorize [insert complete name of Bidder] to submit a bid the purpose of which is to provide the following Goods, manufactured by us [insert name and or brief description of the Goods], and to subsequently negotiate and sign the Contract against the above IFB.

We hereby extend our full guarantee and warranty in accordance with Clause 28 of the General Conditions of Contract, with respect to the Goods offered by the above firm against this IFB.

We as a manufacturer of *[insert type of goods manufactured]* confirm to provide the spare & service support for a minimum period of 10 years after commissioning.

Signed: [insert signature(s) of authorized representative(s) of the Manufacturer]

Name: [insert complete name(s) of authorized representative(s) of the Manufacturer] Title: [insert title]

Duly authorized to sign this Authorization on behalf of: [insert complete name of Bidder]

Dated on \_\_\_\_\_\_ day of \_\_\_\_\_\_\_, \_\_\_\_ [insert date of signing]

Note – Modify this format suitably in cases where manufacturer's warranty and guarantee are not applicable for the items for which bids are invited. If the supply consists of number of items, indicate the specific item (s) for which alone the above authorization is required.

Authorization required for (PLC, SCADA, Level sensors, gate sensor)

[The Bidder shall require the Manufacturer to fill in this Form in accordance with the instructions indicated. This letter of authorization should be on the letterhead of the Manufacturer and should be signed by a person with the proper authority to sign documents that are legally binding on the Manufacturer. The Bidder shall include it in its bid, if so indicated in the **BDS**.]

### 7. DECLARATION FOR CLAIMING TAX/DUTY EXEMPTION<sup>5</sup>

(Nan	e of t	the Project)	
Descri	ption o	of item to be supplied	
		for issue of certificate for claiming exemption of evant notification)	Tax/ Duty in terms of Government
(Bidde	er's Na	ame and Address):	To (Name of Purchaser)
Dear S			
1.	we ha	confirm that we are solely responsible for obtainave considered in our bid and in case of failure to soever, Purchaser will not compensate us.	
2.		re furnishing below the information required by the icate in terms of Government of India's relevant n	•
	(i)	Ex-factory price per unit on which the tax/dutyi	s payable: *Rs.
	(ii)	No of Units to be supplied:	
	(iii)	Total cost on which the tax/duty is payable	(Rs.)
	Curre	requirements listed above are as per ent notifications. These may be modified, cessary, in terms of the rules in force)	
		(Signature)(Printed Name)(Printed Name)(Designation)(Common Seal)ach details item-wise with cost, if there are mould tally with what is given in the price schedule.	

<sup>&</sup>lt;sup>5</sup> This declaration refers to ITB 14.9 and shall be retained only if ITB 14.9 is retained. The format may be modified as per the latest instructions of Government of India.

### 8. PROFORMA FOR PERFORMANCE STATEMENT

Evaluation and		ion Criteria]	111-					
Proforma for 1	Performance	e Statement (for	a period of	last three/five	e years)			
Bid No		Date of openin	ıg			Tin	ne Hour	'S
Name of the F	irm							
Order placed by (full address of Purchaser)	Order No. and date	Description and quantity of ordered equipment	Value of order	Date of condelivery	npletion of	Remarks indicating reasons for late delivery, if any	Has the equipm been satisfactor functioning? (Atta a certificate from Purchaser/Consigne	rily ach the
				As per contract	Actual			
1	2	3	4	5	6	7	8	
Signature and	seal of the	Bidder						

### SECTION V. - ELIGIBLE COUNTRIES

### **Public Information Center**

Eligibility for the Provision of Goods, Works and Non Consulting Services in Bank-Financed Procurement

In reference to ITB 4.7 and 5.1, for the information of the Bidders, at the present time firms, goods and services from the following countries are excluded from this bidding process:

Under ITB 4.7(a) and 5.1: None

Under ITB 4.7(b) and 5.1: None

# SECTION VI. BANK POLICY - CORRUPT AND FRAUDULENT PRACTICES

Guidelines for Procurement of Goods, Works, and Non-Consulting Services under IBRD Loans and IDA Credits & Grants by World Bank Borrowers, dated January 2011.

### "Fraud and Corruption:

- 1.16 It is the Bank's policy to require that Borrowers (including beneficiaries of Bank loans), bidders, suppliers, contractors and their agents (whether declared or not), sub-contractors, sub-consultants, service providers or suppliers, and any personnel thereof, observe the highest standard of ethics during the procurement and execution of Bank-financed contracts. In pursuance of this policy, the Bank:
  - (a) defines, for the purposes of this provision, the terms set forth below as follows:
  - (i) "corrupt practice" is the offering, giving, receiving, or soliciting, directly or indirectly, of anything of value to influence improperly the actions of another party;<sup>7</sup>;
  - ii) "fraudulent practice" is any act or omission, including a misrepresentation, that knowingly or recklessly misleads, or attempts to mislead, a party to obtain a financial or other benefit or to avoid an obligation;<sup>8</sup>
  - (iii) "collusive practice" is an arrangement between two or more parties designed to achieve an improper purpose, including to influence improperly the actions of another party; 9
  - (iv) "coercive practice" is impairing or harming, or threatening to impair or harm, directly or indirectly, any party or the property of the party to influence improperly the actions of a party; 10

In this context, any action to influence the procurement process or contract execution for undue advantage is improper.

For the purpose of this sub-paragraph, "another party" refers to a public official acting in relation to the procurement process or contract execution. In this context, "public official" includes World Bank staff and employees of other organizations taking or reviewing procurement decisions.

For the purpose of this sub-paragraph, "party" refers to a public official; the terms "benefit" and "obligation" relate to the procurement process or contract execution; and the "act or omission" is intended to influence the procurement process or contract execution.

For the purpose of this sub-paragraph, "parties" refers to participants in the procurement process (including public officials) attempting either themselves, or through another person or entity not participating in the procurement or selection process, to simulate competition or to establish bid prices at artificial, non-competitive levels, or are privy to each other's bid prices or other conditions.

For the purpose of this sub-paragraph, "party" refers to a participant in the procurement process or contract execution.

### (v) "obstructive practice" is:

(aa) deliberately destroying, falsifying, altering, or concealing of evidence material to the investigation or making false statements to investigators in order to materially impede a Bank investigation into allegations of a corrupt, fraudulent, coercive or collusive practice; and/or threatening, harassing or intimidating any party to prevent it from disclosing its knowledge of matters relevant to the investigation or from pursuing the investigation, or

- (bb) acts intended to materially impede the exercise of the Bank's inspection and audit rights provided for under paragraph 1.16(e) below.
- (b) will reject a proposal for award if it determines that the bidder recommended for award, or any of its personnel, or its agents, or its sub-consultants, sub-contractors, service providers, suppliers and/or their employees, has, directly or indirectly, engaged in corrupt, fraudulent, collusive, coercive, or obstructive practices in competing for the contract in question;
  - (c) will declare misprocurement and cancel the portion of the loan allocated to a contract if it determines at any time that representatives of the Borrower or of a recipient of any part of the proceeds of the loan engaged in corrupt, fraudulent, collusive, coercive, or obstructive practices during the procurement or the implementation of the contract in question, without the Borrower having taken timely and appropriate action satisfactory to the Bank to address such practices when they occur, including by failing to inform the Bank in a timely manner at the time they knew of the practices;
  - (d) will sanction a firm or individual, at any time, in accordance with the prevailing Bank's sanctions procedures, <sup>11</sup> including by publicly declaring such firm or individual ineligible, either indefinitely or for a stated period of time: (i) to be awarded a Bank-financed contract; and (ii) to be a nominated <sup>12</sup>;
  - (e) will require that a clause be included in bidding documents and in contracts financed by a Bank loan, requiring bidders, suppliers and contractors, and their sub-contractors, agents, personnel, consultants, service providers, or suppliers, to permit the Bank to inspect all accounts, records, and other documents relating to the submission of bids and contract performance, and to have them audited by auditors appointed by the Bank."

A firm or individual may be declared ineligible to be awarded a Bank financed contract upon: (i) completion of the Bank's sanctions proceedings as per its sanctions procedures, including, inter alia, cross-debarment as agreed with other International Financial Institutions, including Multilateral Development Banks, and through the application the World Bank Group corporate administrative procurement sanctions procedures for fraud and corruption; and (ii) as a result of temporary suspension or early temporary suspension in connection with an ongoing sanctions proceeding. See footnote 14 and paragraph 8 of Appendix 1 of these Guidelines.

A nominated sub-contractor, consultant, manufacturer or supplier, or service provider (different names are used depending on the particular bidding document) is one which has either been: (i) included by the bidder in its prequalification application or bid because it brings specific and critical experience and know-how that allow the bidder to meet the qualification requirements for the particular bid; or (ii) appointed by the Borrower.

# PART 2 - SUPPLY REQUIREMENTS

SECTION VII – SCHEDULE OF REQUIREMENTS

## 1(A). LIST OF GOODS AND DELIVERY SCHEDULE

Lin	Description of Goods	Quantit Physic Final			Delivery (as per Incoterms) Date			
e Ite m No.		у	al unit	(Site) Destinati on as specified in BDS	Earliest Delivery Date	Latest Delivery Date	Bidders offered Deliver y Date	
1	Supply of PLC/RTU system with software development of PLC/RTU, Control Panel with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HMI display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as per technical specification.	12	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract		
2	Supply of Shaft Encoder based rotary position sensor with Digital Display & proximity limit switches type Gate Position Sensors for indication and monitoring of Spillway gates, Intake Gates, Silt flushing gates including cabling & integration with PLC/RTU as per technical specifications.	44	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract		
3	Supply of Automated Water Level transmitter non-contact RADAR type having 30m range for measuring level & downstream discharge of barrage/rivers & head regulators, including all necessary cabling with suitable conduits & electrical fittings complete as per technical specification	9	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract		

4	Supply of Datalogger of 2 channel input type with GPRS/Gsm telemetry for datalogging & transmission of Real time data from Level transmitters at Asansol in the downstream of Maithon dam, at Panchet and Maithon dam, to SCADA system, with all relevant mounting accessories. As per technical specifications	3	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract	
5	Supply of solar panel, charger regulator, batteries, lightening arrestor with all connectors, cables and conduit for cables for providing un interrupted power supply to dataloggers, as per technical specifications.	3	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract	
6	Supply of 3 Phase VFD Starter of 3.0 Kw panel for each motor which shall consists of VFD, S.P.P, MCB, OLR, Timer, Main Switches including cabling & Electronic Digital Indicator complete as per technical specifications.	10	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract	
7	Supply of 3 Phase VFD Starter of 2.2 Kw panel for each motor which shall consists of VFD, S.P.P, MCB, OLR, Timer, Main Switches including cabling & Electronic Digital Indicator complete as per technical specifications.	34	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract	
8	Supply of IP based Bullet Camera (Fixed Type)- Night Vision (I.R.) Out door Weather Resistant, 2 Mega Pixel ,72 LED Color Camera. 6 OR 8 or 12 MM (According to site suitability) 2 MP Auto Iris Lens in Elegant Metal Die Cast Housing. Outdoor weather resistant IP 66, for monitoring the gates operation complete as per technical specifications.	44	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract	

9	Supply of Pan Tilt Zoom (PTZ) Camera 36 X Optical and 12 X Digital Zoom; 2 Mega Pixel IP (DIGITAL) Sensor, 500 mtrs. Night Vision (Multiple Intelligent Array system) in IP66 Weather Resistant Outdoor Metallic Housing. Outdoor weather resistant IP 66 including cabling required for Barrage monitoring. As per technical specifications.	2	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract
10.	Supply of Automated Weather Stations set which includes Rain Gauge, Air temperature, Air pressure, Relative humidity, Wind speed & Direction, Solar Radiation Sensors, & its accessories as per technical specification.	1	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract
	Barrage Control Room Equ	ipment's				
11	Supply of Main PLC Controller system with firm ware based hot redundancy which shall include software development of PLC, Control Panel with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. All the Electrical fittings will be Industrial Type. Including suitable switch mode power supply (SMPS) ,12" display & cabling with related remote PLC/RTU's, complete as per technical specification.	1	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract
12.	Supply, engineering and development of customized SCADA software for complete Barrage automation with life time licensed version as per technical specifications.	1	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract
13.	Supply of Master server which includes Server with server Rack and industrial grade monitor with USB, RS232/RS485, Ethernet Ports, OS Windows 8 or higher compatible to SCADA System complete as per technical specifications.	2	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract

14.	NETWORK VIDEO RECORDER (NVR) 48 Channel 1080 P Full HD, Real time Recording and Reviewing in Compression Format. As per technical Specifications.	1	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract	
15.	Supply of IT Hardware which includes required Static IP, Router with modem, Switch, firewall system and A3 color printer as per technical specifications	1	set	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6 months from date of signing of contract	
16.	Supply of 110" LED Display/ Video wall/ (70", 2X1) DLP based System for monitoring of SCADA & surveillance system at Control Room as per technical specifications	1	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6months from date of signing of contract	
17.	Supply of Online 3 KVA UPS with Battery system for power back up of Barrage control room equipment's including all necessary cabling & electrical fittings complete as per the technical specifications	1	No.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6months from date of signing of c ontract	
18.	Supply of laptops & 4G/3G internet dongles along with licenced version of Client SCADA software for remote viewing & monitoring of Barrage automation as per technical specifications.	4	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6months from date of signing of contract	
19.	Supply of Diesel Generator Set 10 KVA with Earth Pits for earthing & all associated accessories as per technical specifications.	1	Nos.	West Bengal, Durgapur Barrage	4 months from date of signing of contract	6months from date of signing of contract	

[The Purchaser shall fill in this table, with the exception of the column "Bidder's offered Delivery date" to be filled by the Bidder]

## 1(B). List of Related Services [ITB Clause 14.8(b)] and Completion Schedule

Service	Description of Service	Quantity <sup>1</sup>	Physical Unit	Place where Services shall be performed	Final Completion Date(s) of Services
	LOCAL CONTROL SYSTEM for Durgapur l	Barrage Co	ontrol		
1	Installation, testing & Commissioning of PLC/RTU system with software development of PLC/RTU, Control Panel with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Suitable 24 V DC power supply to power up PLC/RTU panel, including suitable switch mode power supply (SMPS) with 1 KVA UPS for Power back up of minimum 2 hours, 7" or above HMI display & Industrial type electrical fitting & cabling with suitable conduits complete for all related field instruments, as per technical specification.	12	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
2	Installation, testing & commissioning of Shaft Encoder based rotary position sensor with Digital Display & proximity limit Switches type Gate Position Sensors for indication and monitoring of Spillway gates, Intake Gates, Silt flushing gates including cabling & integration with PLC/RTU as per technical specifications.	44	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
3	Installation, testing & Commissioning of Automated Water Level transmitter non-contact RADAR type having 30m range for measuring upstream level & downstream discharge of barrage/rivers & head regulators. including all necessary cabling & electrical fitting & integration with PLC/RTU complete, as per technical specification	9	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
4	Installation, testing & Commissioning of Datalogger of 2 channel input type with GPRS/Gsm telemetry for datalogging & transmission of Real time data from Level transmitters at Asansol in the downstream of Maithon dam, at Panchet and Maithon dam, to SCADA system, with all relevant mounting accessories. As per technical specifications	3	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
5	Installation, testing & Commissioning of solar panel, charger regulator, batteries, lightening arrestor with all connectors, cables and conduit for cables for providing un interrupted power supply to dataloggers, as per technical specifications.	3	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract

6	Installation, testing & commissioning of 3 Phase VFD Starter panel of 3.0 Kw for each motor which consists of VFD, S.P.P, MCB, OLR, Timer, Main Switches including cabling, integration with PLC/RTU & Electronic Digital Indicator complete as per technical specifications.	10	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
7	Installation, testing & commissioning of 3 Phase VFD Starter panel of 2.2 Kw for each motor which consists of VFD, S.P.P, MCB, OLR, Timer, Main Switches including cabling, integration with PLC/RTU & Electronic Digital Indicator complete as per technical specifications.	34	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
8	Installation, testing & Commissioning & integration with NVR located at Barrage Control Room of IP based Bullet Camera (Fixed Type)- Night Vision (I.R.) Outdoor Weather Resistant, 2 Mega Pixel 2 OR4Array/ 72 LED Colour Camera. 6 OR 8 or 12 MM (According to site suitability) 2 MP Auto Iris Lens in Elegant Metal Die Cast Housing. Outdoor weather resistant IP 66 for monitoring the gates operation, complete in all respects as per technical specifications.	44	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
9	Installation, Testing & Commissioning & integration with NVR Located at Barrage Control Room of Pan Tilt Zoom (PTZ) Cameras, 36 X Optical and 12 X Digital Zoom; 2 Mega Pixel IP (DIGITAL) Sensor, 500 mtrs. Night Vision (Multiple Intelligent Array system) in IP66 Weather Resistant Outdoor Metallic Housing. Outdoor weather resistant IP 66 including cabling required for Barrage monitoring complete in all respects as per technical specifications.	2	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
10	Installation testing & Commissioning of Automated Weather Stations which includes, Rain Gauge, Air temperature, Air Pressure, Relative humidity, Wind speed & direction, solar radiation set, including associated civil works and integration with PLC/RTU as per technical specifications.	1	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
	Barrage Control Room Equipment's				
11	Installation, Testing & Commissioning of Main PLC Controller system with firm ware based hot redundancy which shall include software development of PLC, Control Panel with front door opening cabinet, fitted with Power buses, MCBs & GPRS modem. Including suitable switch mode power supply (SMPS) ,12" display & cabling with Industrial grade type electrical fittings for related remote PLC/RTU's, as per technical specification.	1	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
12	Installation, testing & Commissioning of customized SCADA software for complete Barrage automation with life time licensed version as per technical specifications.	1	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract

				West	12 months from
13	Installation, Testing & Commissioning of Master server with SCADA Software which includes Server with server Rack and industrial grade monitor with USB, RS232/RS485, Ethernet Ports, OS Windows 8 or higher compatible to SCADA System complete as per technical specifications	2	Nos.	Bengal, Durgapur Barrage	the date of signing of Contract
14	Installation, testing & commissioning of NETWORK VIDEO RECORDER (NVR) 32 Channel 1080 P Full HD, Real time Recording and Reviewing in Compression Format. As per technical Specifications.	1	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
15	Installation, Testing & Commissioning of IT Hardware which includes required Static IP, Router with modem, Switch, firewall system and A3 color printer as per technical specifications	1	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
16	Installation, Testing & Commissioning of 110" LED Display/ Video wall /(70", 2X1) DLP based System for monitoring of SCADA & Surveillance system at Control Room as per technical specifications	1	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
17	Charges for high speed synchronous internet connection (min. 8 mbps upload and download speed) & Static IP for Five years.	1	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
18	Charges for 4G/3G internet dongles for five years which is to be provided along with laptops having lifetime licenced version of Client SCADA software for remote viewing & monitoring of Barrage automation as per technical specifications	4	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
19	Installation, Testing & Commissioning of Online 3 KVA UPS with Battery system for power back up of Barrage control room equipment's, including cabling & integration as per the technical specifications	1	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
20	Installation, Testing and Commissioning of Diesel Generator Set 10 KVA with 04 Earth Pits for earthing, Starter Panel, Energy meter, cabling and all associated accessories Complete in all respects as per technical specifications.	1	Nos.	West Bengal, Durgapur Barrage	12 months from the date of signing of Contract
21	Five Years Operation & Maintenance and Comprehensive Warranty for SCADA based Barrage automation system as per Price schedule after final acceptance of SCADA & Surveillance system. This includes replacement of material & consumable as & when required at bidders' cost and also necessary up gradation of SCADA system. The cost of Communication for GPRS & SIM charges for data transmission & other related charges.	1	No.	West Bengal, Durgapur Barrage	ongoing activity for 5 years
	Minimum One Service Engineer shall be placed at Barrage Control Room for Operation of SCADA & Surveillance system.				

22	Training of the purchaser's personnel at the supplier's plant and/or/onsite in assembly, start up, operation, maintenance and/or repair of the supplied goods. Course topics will include sensor calibration, PLC & SCADA configuration, data downloading, data retrieval, collection, Trouble shooting, processing maintenance requirements and procedure for equipment configuration, installation, site testing and commissioning including training kit containing course material in soft and hard copies.	8	Training	West Bengal, Durgapur Barrage	ongoing activity for 5 years
----	---	---	----------	--	------------------------------

## 3. TECHNICAL SPECIFICATIONS

## 1. About Durgapur Barrage

Durgapur Barrage is constructed on Damodar River. Its Construction was completed in 1955. There are 10 Nos. under sluice gates, 24 Nos. other bay gates in this Barrage. RBMC and LBMC are constructed on right and left side of barrage respectively, for the purpose of irrigation. Water supply canal off-take from the Left bank main canal is located at approximately 500 feet downstream of LBMC head regulator.



Note: Please read RBMC Head Regulator number as (2) instead of (4).

Fig. 1 A map of the Barrage and Canals (figure in brackets indicate No. of Gates)

Salient Features:

Construction year - 1952 - 1955

Length of Barrage - 692 meter

No of Gate - 24 + 10

Gate Size - 60 \* 18 feet

Design discharge maximum - 550,000 cusecs

Discharge Passed - 1,978, 380,000 cusec.

UP Stream H.F.L - 212.0 Metres

Normal Pond level - 211.5 Metres


AC Motor on Spillway Gates - 4 HP 3-Phase

### Brief Detail of Canal gates:

Number of Gates on LBMC Head regulator: 8 Gates (20 \* 08 feet)

Number of Gates on RBMC Head regulator: 2 Gates (20 \* 08 feet)


The existing gate drive is 3-phase 4 HP AC Motor drive with phase reversal starter panel with RAISE/LOWER/STOP buttons for manual control.

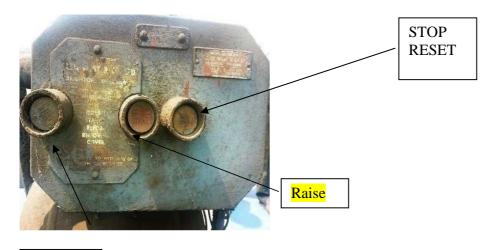

## **LOWER**

#### g. 2 Front View of existing control panel

The speed is reduced by a series of gears from 3000 rpm to one revolution in about 20 minutes to drive the drum on which the rope moving the gate is wound. The diagram below shows the display Dial for Gate Position with pointer connected directly to the drum shaft. The drum is located just behind the dial

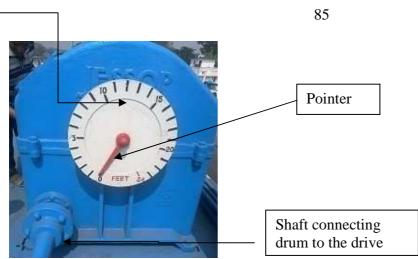

#### Fig. 3 Display Dial

Dial

#### 2. Objective

The broad objective of the project is monitoring and control of water flow through the main Barrage and head regulators of Durgapur Barrage.

The SCADA system will receive controlled water discharge information from upstream reservoirs in Maithon and Panchet (about 60-80 Km away), total discharge at Asansol (about 45 Km upstream) and Upstream pond level & downstream discharge from Durgapur barrage based on which SCADA system will decide on the desired level of discharge as per guideline document by using Measurement of Water Discharge in Durgapur and Asansol.

Further, the gates are required to be operated from the barrage control room as per the dynamic operational schedule to be incorporated in SCADA to achieve automatic gate operation of Barrage.

To achieve this objective, an agency will be engaged for the following:

- **2.1** Automation of the Barrage by installing a suitable SCADA system with remote viewing facility & control the parameters on line from the Barrage Control Room.
- 2.2 The control system along-with SCADA Software shall be provided in the Barrage control room (BCR) and the information available at control room (BCR) should also be available on 3 client laptops which shall have a licensed monitoring Client software installed in it having all features for real time monitoring of data from BCR. The Data provided in BCR should be displayed in complete explicit way and can be extracted in different formats it shall have capability of monitoring the real time data of BCR & trend analysis etc.

  Also, through web server all reports (hourly, daily, weekly, monthly, quarterly, half yearly & yearly etc.) shall be available at any PC/Laptop and on mobile located at any place through web with user name & password protection.
- **2.3** Four client SCADA software's with real time monitoring function of BCR shall be provided along with laptops with latest configuration as per technical specifications.

Client laptops along with high speed internet connection (4G/3G dongles) shall be provided at Xen office, SE office, Head office (Salt Lake) & one at BCR for configuration purposes.

- **2.4 The** Contractor shall supply, install & commission all instruments, terminal boxes, cabling & conduits etc. necessary to make the tendered services complete and ready for operation even if these are not indicated explicitly in this document.
- **2.5** The main items of control & equipment to be supplied and installed under this section comprise the following:
  - i) RTU/PLC based remote control system complete in all respect located at Barrage top for Control and operation of spillway gates and silt flushing gates. (Offer of the Bidder shall contain complete proposed SCADA schematic view & control methodology)
  - ii) Gate position Sensors for indication and monitoring of Spillway gates, Intake Gates, Silt flushing gates.
  - iii) Six (6) sets of **Radar based water level** sensors for Level indication & computed discharge measurement function along with necessary alarms functions at Barrage area and 3 sets for Asansol, maithon & Panchet for monitoring of river discharge inflow to Durgapur barrage.
  - iv) Dataloggers with solar power Back up for remote water level transmitters located at Asansol, Panchet & Maithon.
  - v) VFD (Variable frequency drive) panel for each motor
  - vi) 2 no. PTZ & 44 no. Bullet cameras for surveillance of Barrage & gates respectively
- vii) Master PLC controller at BCR (Barrage Control Room).
  - viii) SCADA system complete in all respects including Servers, PC, UPS system, printers, 110" LED screen/video wall/ (70", 2X1) DLP based system & IT hardware (static IP, router with modem, firewall system) etc. for Barrage Control Room.
  - ix) DG Set of 10 KVA as power back up for SCADA system & instrumentation involved in BCR automation.

The Work shall be complete with all necessary auxiliaries such as primary elements (position transmitters, limit switches, sensors etc.), cabling, conduiting etc., as well as frames, cantilever (as required), cable trays including all spare parts and special tools required. All the Equipment shall be standard-type from well-known manufacturers.

#### 3. Scope of Work

Scope of work shall include supply, installation, testing and commissioning of all components necessary for implementation of the functional requirements described in Objectives. This will include but will not be limited to Hardware, System Software and Utilities, Application Software, Computers, Switches, Controlling Devices (e.g. RTU/PLC), Data Communication Devices, Field Instruments and Sensors, Device Drivers, Power and Signal Cabling including necessary trenching and junction boxes, Power Supplies, and all structures and fittings necessary for installation of all subsystems and Instruments and Sensors in Control Room and in Field. The following will include in the scope of work:

- i) Supply, installation and commissioning of hardware and software necessary for the SCADA system for:
- ii) The Automatic Gate Operation and Control of Durgapur Barrage based on water Level/ discharge from Head Regulators at Barrage Control Room.
- iii) On-line monitoring & control of Barrage from Barrage Control Room
- iv) To protect gates from Accident causes, Access Gate opening control via Remote location (Control Room) and also troubleshoot problems in gate control systems, , unauthorized user protection, information storage of all the events regarding operation of gates, pond levels, reporting system and log information in real time.
- v) Controlling of barrage by SCADA system at BCR and real time monitoring & reporting of various parameters of barrage through client software & web server using latest technology of GPRS & GSM.
- vi) Electrical grounding for all electronic and electrical equipment should be done by following standard CPWD procedure & all equipment's (Sensor, Controllers etc.) shall be protected using lightening arrestors.
- vii) Comprehensive Warranty & Operations of SCADA based System for a period of 5 years is in scope of bidder.

## 3.1 SCADA System Control Methodology

The Contractor shall supply and install all equipment's along with necessary accessories & installation hardware etc. necessary to make the Automation of Barrage through SCADA to run the gates from control room and acquiring all data of Barrage at local control room and viewing at various designated locations as per specifications, Complete and ready for operation even if these are not indicated explicitly in this document. This proposal is for Supply, Installation, Testing & Commissioning of a SCADA System based on PLC/RTU for the following functions:

- i) Automatic Control of Gates of Durgapur Barrage and head Regulator's LBMC &RBMC situated on DVC River. Besides Automatic Control through Automatic Reservoir Monitoring and Control (ARMAC), Provision for Manual operation of Gates shall be provided at site within RTU/PLC panel & through push buttons.
- ii) Monitoring of gate positions with various site operations & safety aspects of the Barrage structures via. CCTV system at BCR.
- iii) On Line Measurement & Display of water Level/discharge in SCADA system.
- iv) Recording of all the above parameters on line & storage of records for analysis.
- v) Generation of customized reports as per the input of Engineer in Charge.
- vi) Reporting of all acquired/calculated variables on web pages for information sharing with all authorized personnel.

- vii) Real time display of gate positions using solid-state rotary type shaft encoders.
- viii) Real Time data monitoring of BCR via client software's at Head office Salt Lake and by Ex-En, SE & CE using laptop & high-speed internet connection.
- ix) The individual PLC/RTU system at Head Regulator & barrage gates shall be capable of controlling the gate operations based on the actual measured discharge, scheduled demand requirement & availability of water. simultaneously all PLC/RTU & datalogger systems shall be connected via GPRS/GSM telemetry system to Centralized SCADA system located in Control Room.

The spillway operation shall be based on a strategy of balancing the Reservoir inflow and outflow by continuously checking and comparing measurements.

The specified measuring system shall provide the data (reservoir level, gate position and spillway discharge) to determine the three above-mentioned parameters by the main server in the BCR (Barrage Control Room).

#### 3.2 Design Data:

The instruments shall be designed & supplied based on following criteria.

i) Rated voltage: 230AC/110V, D.C.

ii) Maximum ambient temperature: 50 degree C

iii) Degree of protection for Panels: IP 54

- iv) Degree of protection for transducers/sensors: IP 67 /IP65 (as per specification)
- v) Special treatment Tropicalized
- vi) Transmitter Output Signal- analogue 4-20 mA(2-wire)/RS485/output compatible with RTU/PLC
- vii) All instruments & PLC/RTU shall be CE/UL certified

#### 3.3 Equipment for Remote Control System

All the real-time data from all instruments specified above shall be transmitted and incorporated in the control system located at barrage control room.

Operator station / workstations shall include Server and monitor of latest configuration and latest popular operating system preferably windows, with hard disk, DVD writer and LED (110inch)/ DLP (70", 2X1) /video wall screen as per specifications for operation and monitoring of gate movement. The operator shall be able to view the gate positions or any gate status with the help of graphic display in the screen.

The Control Room shall have Master PLC controller with firm ware based hot redundancy so that the failure of one of the controllers shall not cause any discontinuity in the control system and shall ensure that no loss of data takes place during change over. The bidder shall also provide A3 size colour printer for printing various logs, instructions and reports. Interlocking

shall be provided between Operator's station and local control panels located near the individual gates via hard wiring and GPRS based wireless technology.

At any time, individual gates shall be allowed to be switched over from the automatic mode to local mode of operation, and vice versa, however the operation from the local panel cannot be overruled by the remote/automatic operation stage once the selector switch is set on the local position. Manually adjusted gates shall, when returned to automatic mode of operation, be adapted to their normal functioning in the automatic mode. The automatic system shall work independent of the number of available gates with the same characteristic. If all gates have been changed over to MANUAL, the master controller shall be reset so as to permit a smooth switching-over to MANUAL operation.

All the input display from field including water level of reservoir/Barrage shall be displayed at the Screen. The system shall continuously monitor the reservoir/Barrage level and depending upon this level it shall be able to calculate the input discharge in to the barrage depending upon the profile made available by the user (**OPTIONAL FACILITY**). In addition to this the gate opening of spillway/radial gates should be displayed in the form of graphic display. The system shall be able to display the output discharge through spillway gates so that operation of spillway gates can be carried out in auto mode. This will be achieved using the standard software (ex. FLOWCAL etc.). Necessary inputs for using software &ADCP to calculate the discharge through spillway gates will be provided by the user department. Bidder based on the inputs shall integrate the discharge rating curve with SCADA system

Formats for various reports & screen displays will be finalized during the detailed engineering stages and bidder shall submit their reporting and screen formats for prior approval from Engineer in charge along with Schematic & control methodology. The software supplied by the bidder should allow any modifications at site without involvement of any other special software.

One uninterruptible power supply (UPS- 1kVA) to provide back up (minimum 2 hours) to the system in case of failure of main power supply to equipment shall also be provided in each remote PLC/RTU Panel. Also, DG Set of 10 KVA shall be provided by bidder as a backup for main power supply to field equipment's & BCR if power failure is more than 2 hours.

For BCR equipment bidder shall provide a 3 KVA online UPS system with 4 hours back up.

#### 3.4 Control of the Barrage and Canal Gates

Barrage Gates 34 Gates LBMC Head Regulator 8 Gates RBMC Head regulator 2 Gates

Minimum Control Inputs: 3 for each Gate- RAISE, LOWER and STOP

Note: In case of any problem with the control of the automated system, it should be possible to revert to the manual system of Gate immediately.

#### **Data Acquisition from Barrage Site**

The system will acquire the following parameters at specified intervals and store them in a data base. The parameters will be displayed in wide screen monitor.

# • Gate Position and Gate Status (Moving UP/Moving Down/Static) of the following:

Main Gates	34	Gates
LBMC Head Regulator	08	Gates
RBMC Head regulator	02	Gates

## • Barrage /Pond Level:

Pond Level in Durgapur Barrage 1 Sensing Unit

#### • Automatic Weather Station (AWS) Parameters:

Air Temperature	1	Sensing Unit
Relative Humidity	1	Sensing Unit
Rainfall	1	Sensing Unit
Air Pressure	1	Sensing Unit
Wind Direction & Speed	1	Sensing Unit
Solar Radiation	1	Sensing Unit

#### • Video Surveillance System

Barrage Gates	34	<b>Bullet Cameras</b>
LBMC Head Regulator	08	<b>Bullet Cameras</b>
RBMC Head regulator	02	<b>Bullet Cameras</b>
Complete Barrage Overview	02	PTZ Cameras

The location of the camera should be decided in consultation with site Engineer of the purchaser such that operation of each gate is clearly visible by cameras.

## • Water Discharge (Gate wise and Total)

Barrage River Discharge	2	Computed Parameter
LBMC Canal Discharge	1	Computed Parameter
RBMC Canal Discharge	1	Computed Parameter

#### • Remote Inputs to be integrated in SCADA System:

Water Level of Asansol 1 Remote Input
Water Discharge in Panchet Dam 1 Remote Input
Water Discharge in Maithon Dam 1 Remote Input

In general, while designing the system, the Bidder will conform to:

- Use of state of the art and reliable technology suitable for 24x7 operations
- Modular design and ease of maintenance

Maximum No. of gates controlled by a field level gate control unit shall be 4. The device should preferably be an intelligent device ( here as Slave Gate Control).

It is mandatory that the successful Bidder will submit a detailed description of the proposed system in each location complete with Block Diagram clearly indicating individual subsystems /units /instruments /sensors and their interconnections and how the proposed system will address the requirements referred in the technical specifications and features.

## 3.5 Scope of Work at Remote Stations

Radar type water level sensor shall be provided at Asansol, Maithon & Panchet in downstream of dam along with GPRS /GSM based Datalogger with Solar power system, which shall transmit data to SCADA on real time basis with configurable sampling interval.

Asansol, Maithon & Panchet Water Level Monitoring Site will be treated as a remote station for the SCADA. Water Level Data shall be received in the Control Room of Durgapur Barrage and Water Discharge will be computed and displayed in the SCADA and saved in the Data Base.

#### 4.0 Technical Specifications of SCADA system & instrumentation

#### 4.1 Water Level Measuring Systems

The bidder shall design, supply and install best quality Level sensors considering the following points.

- a) Radar type level measuring system shall comprise of radar type level transmitter, and any other item required to complete the level measurement loop.
- b) Radar based reservoir/ pond level measurement & downstream level of main barrage & Head regulator. These points are to be selected so that most accurate measurement level is obtained. All accessories along-with cage to avoid theft and Monkey Menace and also proper mounting arrangement (cantilever etc.) for these instruments shall be supplied by the bidder.
- c) The level sensor shall be suitable for flange or thread mounting as required. The installation shall avoid any degradation of instrument performance due to spurious reflections, absorption and condensation. Facilities shall be provided for rejection of spurious reflection.
- d) The radar type level instrument shall have the facility for dampening/ averaging the effect of waves, undulations on the water surface and discriminate the rate of change of levels to provide steady readings.
- e) All necessary instruments, interconnecting wiring, HDPE/GI pipe work, housing, cabling, panel, etc., shall be provided according to the type of equipment proposed to supply in the Tender and accepted in the Contract. Adequate safety measures shall be included in the design of these sensors to negate the effects of disturbances due to turbulence of water levels, strong air currents & electromagnetic waves etc.
- f) The Technical Details are as follows:

Feature	Value	
<b>Site Conditions</b>		
Ambient Temperature	From 0 °C to + 50°C	
Humidity		
Sensor		
Sensor Type	Microwave non-contact sensor,	
Range	30 meters	
Resolution	3 mm or better	
Accuracy	0.02 % FSO	
Output Interface	SDI-12 / RS 485 / 4-20 mA	
	2 wire type, to be powered from PLC/RTU/Datalogger	
Power Supply	(locally)	
Protection	IP67 or better	

	Die cast aluminium or any corrosion resistant metallic	
Enclosure	enclosure	
Isolation	circuits shall be galvanically isolated from each other.	
Display	Digital Read out at site LCD / LED Display	
Manufacturer		
Calibration Certificate	Required	
Beam angle	Less than 12 degrees.	
General Features		
	The Sensor shall be easy to dismount and replace in the	
Enclosure	event of malfunction.	
Tools	Complete tool kit for operation and routine maintenance	
Manuals	Full Documentation and maintenance manual in English	
Accessories	Sensor Mounting support with proper HDPE/ GI Pipe conduiting, cables and other accessories as required	
	Above FRL, below a bridge girder wherever available	
Mounting/Installation	otherwise horizontal cantilever arrangement from a	
Arrangements	mast/wall/pedestal to be provided	
Radar Sensor should have inbuilt diagnostic feature & averaging function		

## 4.2 Gate Position Measuring System

Suitable sensors shall be provided for exact measurement & indication of position of spillway radial gates, intake gates & silt flushing gates. These sensors shall be equipped with suitable shaft couplings and electronic circuits to transmit the signals to the SCADA System via remote PLC/RTU for indication in BCR & for further processing. All sensors are to be mounted in the outdoor locations. Hence, suitable protection class of the enclosures shall be ensured. Minimum IP65 protection class shall be provided. Suitable safe & reliable arrangements of coupling with the motors of gates shall be provided. It shall be ensured that there is no slippage between the motor shaft & the transducers.

The bidder shall provide the gate sensors with following minimum specifications.

Feature	Value	
<b>Site Conditions</b>		
Ambient Temperature	From 0 °C to +50°C	
Humidity	5 to 95 % (non-condensing)	
Sensor		
	Shaft Encoder based rotary position sensor with	
Sensor Type	minimum 4" Digital Display	
Range	1-20 meters	
Resolution	3 mm or better for gate position	
Accuracy	0.025 % FSO	
Output Interface	SDI-12 / RS 485 / 4-20 mA compatible to PLC/RTU	

Power Supply	2 wire type, to be powered by RTU/PLC	
General Features		
	Corrosion Resistance Metal (Stainless steel or	
Material	Aluminium)	
Enclosure	Lockable (key) box provided by the supplier to be mounted on sensor, with IP65 or better protection.	
Tools	Complete tool kit for operation and routine maintenance	
Manuals	Full Documentation and maintenance manual in English	
	Wiring from sensor to RTU/PLC must be through HDPE/ GI Pipe Conduiting or flexible metallic	
Mounting	conduiting as applicable	
Display	Read out LCD / LED Display	
Process connections	through suitable coupling	
Manufacturer's Calibration		
Certificate	Required	

## 4.3 Automatic weather stations at BCR

The Automatic weather station shall be placed at Barrage which shall be connected to Main PLC controller placed in BCR. The Automatic weather station shall be provided with following minimum specifications.

Feature	Value	
<b>Site Conditions</b>		
Ambient Temperature	From 0 to +50 Degree C	
Humidity	5 to 95 % (non-condensing)	
Altitude	0 to 2500 meter	
Automatic Rain gauge		
Sensor Type	Tipping Bucket type with reed switch	
Range	250 mm/h or better	
Resolution	0.5 mm or better	
Accuracy (Intensity)	2% or better, ± 2 mm	
Output Interface	SDI12/ RS 485 / 4-20 mA/Switch closure output	
Material	Corrosion Resistance Metal (Stainless steel/ Aluminum)	
Enclosure	NEMA 4 or IP65	
Certification	IMD/ WMO certification shall be provided.	
	Bidder shall provide spout filter and bird cage to prevent ingress	
Protection	of insects and debris	
Air Temperature Sensor		
Sensor Type	Platinum resistance or better or equivalent	
Range	0 to 50 Degree Celsius	

Resolution	± 0.1°C	
Accuracy (Intensity)	Within ±0.2°C in the entire working range	
Response Time	10 secs or lesser	
Relative Humidity Sensor		
Sensor Type	Capacitive/ Solid State Humidity Sensor	
Range	0 to 100 %	
Resolution	1%	
Accuracy	±3% or better	
Power Supply	To be powered by PLC Located at BCR	
Response time	10 secs or lesser	
Wind Speed and Direction Ser	isor	
Sensor Type	Ultrasonic sensor (No moving Parts)	
Range	0-60 m/s for speed and 0-359 degrees for direction	
Resolution	0.1m/s for Speed; ±1 degree for Direction	
Accuracy	$\pm 0.5$ m/s or better for wind speed; $\pm 5^{\circ}$ or better for wind direction	
Response time	Less than 1 second lag in operating range	
1	All accessories for mounting the instrument e.g. special cross arm	
Mounting	clamps or flag if any shall be provided.	
Air Pressure Sensor		
Sensor Type	Temperature Compensated	
Range	600 to 1100 hPa	
Resolution	± 0.1 hPa	
Accuracy	±0.2hPa	
Power Supply	To be powered by PLC Located at BCR	
Solar Radiation Sensor		
Sensor Type	Silicon Pyranometer	
Threshold	120 W/m2 of direct solar irradiance	
	Alternate shading of sensor to account for sky radiation or	
Methodology	sunshine duration shall be computed in PLC/SCADA system	
Spectral Range	400nm to 1100 nm	
Range	0-2000 W/Square meter	
Resolution	1 W/Square meter	
Accuracy (Including	•	
Temperature Compensation)	3% or better	
General Features		
Material	Corrosion Resistance Metal (Stainless steel / Aluminum)	
Tools	Complete tool kit for operation and routine maintenance	
Manuals	Full Documentation and maintenance manual in English	
Accessories	Sensor Mounting support, cables and other accessories as required	
Power Supply	To be powered by PLC/RTU	

Enclosure	NEMA 4 or IP65
Certification	IMD/ WMO certification shall be provided.
Output Interface	SDI 12/RS 485/ 4-20 mA/Analog/Compatible with RTU/PLC

#### 4.4 Surveillance System

Primary Purpose of Surveillance system is to view gate movement from Control room. Operator should be able to see that the gates moves up/down or stop when the appropriate command is given.

Bullet cameras IP based shall be placed to monitor the position of all the gates & PTZ cameras shall be installed on the main barrage in a way to ensure the complete monitoring of the Barrage. The same shall be connected with NVR (Network Video Recorder) which shall have a memory of at least 30 days. Cameras shall be connected to internet, to have its accessibility from farthest point through IP address.

The cameras shall have a provision of connecting with NVR through hardwiring using video cable (RG-6 coaxial cable)/OFC and simultaneously through wireless connectivity.

The following minimum features shall be available in CCTV system

- i) **Bullet Camera** (Fixed Type)- IP based Night Vision (I.R.) Out door Weather Resistant, 2 Mega Pixel,72 LED Color Camera.6 or 8 or 12 MM (According to site suitability) 2 MP Auto Iris Lens in Elegant Metal Die Cast Housing. Outdoor weather resistant IP 66.
- ii) **Pan Tilt Zoom** (PTZ) 36 X Optical and 12 X Digital Zoom; 2 Mega Pixel IP (DIGITAL) Sensor, 500 mtrs. Night Vision (Multiple Intelligent Array system) in IP66 Weather Resistant Outdoor Metallic Housing.
- iii) Standalone **NETWORK VIDEO RECORDER** (NVR) 32 Channel 1080 P Full HD, Real time Recording and Reviewing in H.264 Compression Format. With HDD. Remote Viewing Capability thru Internet /Android /Apple /Mobile App Xmeye /CMS software with password protection & user name.
- iv) Necessary mounting arrangement like MS/ GI Poles 4/6/8 1nch Dia Medium Grade Pipe of Standard Make with suitable length along with junction box & other accessories as per the suitability shall be provided by the bidder for installation of CCTV system.

## 4.5 Data Logger with 2 channel Inputs

The datalogger with 2 channel input shall be provided by bidder at Remote monitoring stations for data logging & transmission on real time basis with following minimum specifications:

Feature	Value		
Site Conditions			
Ambient Temperature	From 0 to +50 Degree C		
Humidity	5 to 95 % (non condensing)		
Sensor Interface	•		
Sensor Interface	2 channels, compatible with outputs of sensors as specified		
Input type	in BOQ		
Input - Output Interfa	ces		
Data Transfer	USB stick option for Data transfer		
	One Serial Port (RS232) for communication with Laptop		
Port for Configuration	for programming		
	1 Ports for Communication with Telemetry (GPRS/GSM)		
Port for Telemetry	device		
Computer Software			
	Windows software for system configuration /		
Operating System	communication		
Version	English language version		
~.			
Licenses	<b>.</b>		
Analog to Digital Conv			
Resolution	16 bit or better		
Sample intervals	1 Sec to 24 hours (user scalable)		
General Features			
Flash memory	Minimum 1GB Non-volatile Flash memory that can store		
, and the second	one year of data and shall be expandable		
Resolution	A/D resolution ≥16 bit		
Firmware Operating	Multi-tasking operating system - must log data and transmit		
System	at same time		
Diamlari	Inbuilt Digital Display for viewing current data and setting values		
Display			
Power Supply	Shall be powered by solar Power supply to be provided by bidder		
Battery Voltage	Monitoring of battery voltage level		
Dattery voltage	Internal battery backup for clock, lithium battery, storage 2		
Internal battery years years			
Charge Controller	Internal or External		
Different user levels, system of user rights / password			
User Permissions	access restricted to authorized personnel		
	For displaying or transferring data to memory stick,		
Keypad	configuration of data logger and sensors		
Real time clock	GPS synchronized		
	for wall-mounting in a shelter / enclosure with IP65		
Enclosure	protection or better		
	Serial cable + adaptor. All accessories (fixing units, etc.) as		
Accessories	required		

Tools	complete tool kit for installation and routine maintenance giving full detail (number of pieces and type)	
Manuals	full documentation and maintenance instructions in English (1 copy per station).	
GPRS MODEM		
Operating Temperature	From 0 to +50 Degree C	
Performance	Data Reception availability of 95% or better	
Form factor	The GSM /GPRS modem should either be integral part of data logger specified above, or it should be supplied as independent unit compatible with supplied data logger	
Specific Features		
Communication Direction	Utilize network for two-way TCP/IP (INTERNET) connection and SMS	
Transmission trigger	Data collection to be triggered by interrogation from Data Center, or by event-based transmission triggered by remote site	
Power Saving	Ability to disable interrogation system in order to save power at remote site	
Communication Protocol	Data transmission to execute HTTP Post, FTP, SMS to transmit and receiving data to the Data Center	
Accessories	All associated equipment, including Antenna all cables and mounting hardware	
Antenna features	· · · · · · · · · · · · · · · · · · ·	
Frequency range	900 MHz: 824-960 MHz/1800MHz:1710-1880 MHz, 4G and better	
Radiation	Omni-directional	
Operating temperature	0 to + 50 degrees Celsius	
Connector	SMA or suitable RF connector adaptable to GSM/GPRS modem	
Cable length	As required at site	

#### 4.6 Remote PLC/RTU:

CE/UL approved manufacturer's Remote Terminal Unit/Programmable Logic Controller (RTU/PLC) in IP54 enclosure having modular PLC/RTU (Plug and play type) for control & monitoring with Modular Controller and should have modular communication. The PLC should be able to communicate to the master controller on an open protocol such as Profibus / Modbus over ethernet TCP/IP using OFC cable & bidder shall provide the memory map of the same for III party etc. simultaneously the remote PLC/RTU shall be able to communicate with BCR via GPRS based wireless technology in order to create redundancy in telemetry to avoid loss of communication & Data. It should be possible to view the reports of SCADA system without requiring any software, from any PC, using web-based protocols. Data logs should be stored inside the CPU and should be downloadable in CSV format. It should be possible to increase the I/O handling capacity of the PLC/RTU, without changing the CPU. Maximum number of gates that shall be controlled by a

single PLC/RTU shall be 4. The remote PLC/RTU shall communicate to the central monitoring station on Optical Fibre Cable. It should be possible to remotely program the PLC/RTU from the control room. Each CPU shall be shall be tested to work in a temperature range of 0 to +50 degree Celsius. The CPU shall have integrated non-volatile memory capacity of not less than 1MB & expandable memory up to 4MB using memory card. All must be complied with IEC-611131-03 and IEC 61158(4-20Amp). Suitable industrial grade AC to DC Power Supplies shall be mounted inside each PLC/RTU. Each PLC/RTU shall have separate power supplies for electronics and field. Surge Protection Device shall be provided inside each PLC/RTU, to safeguard against transient & lightening surges.

- i) Industrial grade Fibre Optic convertor shall be housed in each PLC/RTU for optical communication between PLC/RTU & central controller. Each PLC/RTU shall have GPRS modem for wireless based communication with BCR.
- ii) Each PLC/RTU shall also be integrated with up to 4 no. digital drive starters panel and capable of operation at up to 50 degrees Celsius. The PLC/RTU equipment shall be housed in a properly sized, weather-proof panel and must be protected with lightening & surge arrestor.

The PLC/RTU shall be designed as per following minimum specifications

#### A. Panel in Climatic Conditions:

The panel shall be fitted with two cooling Fan with filters, and protection, for better control of internal temperature. The individual cooling fans shall be controlled /switched ON/OFF by the PLC/RTU according to the application requirement.

#### **B. Temperature Monitoring**

The PLC panel shall be fitted with the temperature sensor/ thermostat and shall be connected to the monitoring system. The monitoring system shall continuously monitor the panel temperature, and if it exceeds the set value, it shall automatically switch ON the cooling Fan's. The cooling FAN shall be Switched OFF after the temperature of the panel is brought back to normal level. In case of Emergency Sequence of power back-up, the cooling FAN shall be switched OFF to save the power.

The PLC/RTU shall be capable of monitoring and controlling the temperature inside the panel and shall transmit the following information to the central control room.

- i. Panel temperature
- ii. Status of cooling Fan's

#### **C. Power Supply Scheme**

Protection shall be provided in the input side of the mains power supply as follows;

i. Input mains Fault Protection MPCB: The proposed system mains power supply fault level protection shall be 100kA. The mains input shall be protected using MPCB (with adjustable current limiting) and auxiliary signaling contact. Auxiliary signaling contacts shall monitor the Healthy/Trip condition of the MPCB. The signaling contact status information shall be updated in the control room.

PLC/RTU can be provided with Isolation transformer for 415 to 230 Vac. Also, the relay board/contactor switches to be installed for acquiring the status of electrical parameters shall be from reputable manufacturers with better standability against voltage fluctuations.

ii. **Control Voltage**: The proposed PLC/RTU system control power supply voltage shall be 24V-48VDC and the same shall be derived with the use of SMPS Power Supply Unit. The SMPS input power shall be protected with suitable MCB. The power to the input of the SMPS shall be switched ON/OFF from the PLC/RTU through Auxiliary relay contact. The panel control switch gear, PLC/RTU unit, Communication unit, HMI Screen Panel, indication lamp, hooter, instruments, Auxiliary Relays, Signal Conditioners/isolators, etc shall be energized by control voltage of 24V -48V DC.

## D. Power Supply On/Off

All the field instruments integrated with each remote PLC/RTU, shall be connected to the single power supply bus and energized with the control voltage supply of 24V-48 VDC. The PLC/RTU according to the application program (periodically) shall switch OFF the control voltage supply via the DC contactor, and Switch ON the control voltage supply after a programmable time delay by actuating the DC Power contactor and the use of programmable mechanical/electrical timer switch gear unit automatically to clear the memory and other floating memory locations errors, warning, faults, etc. Ultimately it shall Reset (Power-ON-Reset) the PLC/RTU.

The Power Supply ON/OFF function command shall be activated manually locally, or from the remote central control room PLC and/or through timer fitted in PLC. The event shall be recorded in the database and suitable reporting system shall be implemented.

#### **E. GPRS Communication Network**

The proposed Intelligent GPRS communication unit shall have GPRS communication network capability.

**Reliable Integration**: The modem should be tightly integrated with the PLC/RTU network. **Failure of Global System for Mobile Communications:** The PLC/RTU should store data in buffer memory of at least 2MB if unable to transfer due to maintenance of Global Packet Radio Service of the service provider or power failure in the cell towers etc. Data shall be transferred to central location in secure manner. i.e. No data loss in case of no connectivity.

#### F. PLC / RTU:

The PLC should have inbuilt RTU functionality with a support for USB/RS 485/RS232/Ethernet port Modem connection.

The PLC/RTUs shall have minimum communication ports as follows:

- i) Two Ethernet ports for connectivity to Master Station
- ii) 1x RS232 ports for the PLC/RTU maintenance and configuration. It shall be possible to increase the number of communication ports in the PLC/RTU by addition of cards, if required in future.
- iii) PLC/RTU shall be designed with cyber security features based on IEC 62443-4-1 & shall have international certification (for ex. certification Level II or equivalent).
- iv) The access to the Server shall be restricted with passwords both at Windows level and at Application Level. Also, all the data should be stored in a separate file system which can be independently accessed by the Remote Network without disturbing the PLC/RTU operation and thereby maximizing the cyber security.
- v) The PLC/RTU should support for follow minimum features:
  - Should have the facility for the Force Simulation
  - Facility of Forcing Input /output variables when the physical devices are not functional
  - Should have user access with pass word protection
  - Should have the facility to program the PLC/RTU for all the different phases
  - a) Startup phase
  - b) Normal operation phase
  - c) Shut down phase
  - The PLC/RTU based SCADA system should have the facility of the Web Server, the same shall be audited by NIC & hosted by NIC server in order to minimize the cyber security issues.
  - The PLC/RTU should support firmware upgrades through network.
  - The PLC/RTU should have facility of storing intermediate variables
  - Program protection feature, network filter setup, Operation log function, function removal feature should be available
  - User authentication, user-based operation restriction, and CPU operation restriction should be available.
  - The CPU should be fast enough and capable of multi-tasking capabilities like running various tasks at different programmable cycle times.
  - The CPU should have minimum 1 MB RAM to cater to current and future program additions.

- The PLC/RTU shall support all the file operating functions so that CSV file log can be stored in the basic CPU memory/buffer memory of GPRS modem for maintaining the log in case of network connection failure.
- The PLC /RTU shall be designed to a modular concept, with separate modules for each function. The modules shall be rack mounted and may be quickly exchanged for field repair. It shall not be necessary to remove field wiring in order to exchange a module. The PLC/RTU shall support a wide range of input /output signals including status inputs, pulse (accumulator) inputs, analogue inputs, analogue outputs, and control outputs. The PLC/RTU shall support any combination of the above I/O points.
- It shall be possible to add PLC/RTU's and software enhancements in the future, without taking the system out of service. The design and physical layout of the PLC/RTU equipment shall be on a modular basis, so that extra facilities, such as an increase in the number of status points or analogues, may be added with minimum of disturbance.
- The PLC/RTU shall be expandable by simply adding I/O modules to the system bus. Other than user-friendly configuration of the new modules, no additional PLC/RTU software or firmware shall be required.
- The operational status of the PLC/RTU shall be indicated on the front panel of the processor module by means of LED lamps. In addition, each I/O card shall have LED status indication.
- Modbus TCP/IP on Ethernet /Profibus (IEEE 802-3) communication shall be provided for PLC/RTU network interconnection towards Master station.
- SCADA System is to be capable for configuring and programming of PLC/RTU remotely, from Control room.

#### G. Microprocessor / Microcontroller Module (CPU)

- Built-in minimum 1MB RAM should be available for storing Data and log records as files.
   Memory Card of minimum 4 MB is supported for storing data, programs and log records as files Built-in Ethernet port should be available;
   In addition to normal scanning, CPU module should have an independent multiple constant scan function capable of a maximum scan speed i.e fast response should also be achievable.
- CPU should have a compact body
- CPU should have facility to be programmed in minimum 4 different languages like Ladder, Function Block, Sequential Flow Chart, Instruction List.
- Large-capacity programs and large device sizes shall be supported to cope with advanced, complex control applications.

- A rich set of functions should be provided to facilitate program debugging and maintenance. For example, a forced SET/RESET function independent of program processing results.
- PLC/RTU shall employ solid-state technology and use an industrial standard, suitable for operation in an aggressive environment with high levels of temperature, humidity and dust being common. It shall operate correctly up to a temperature of 50 degrees Celsius and up to 95% non-condensing humidity.
- On-board battery backed Real Time Clock (RTC) is required. The RTC will operate on the battery power even when the main power is lost.
- The PLC/RTU shall have a separate watchdog circuit independent from the main processor, which will reset the system if the firmware program fails in any way. The watchdog circuit shall be capable of being enabled or disabled by means of a jumper or by software.

#### **H. Communications Interfaces**

- Communication interfaces shall correspond communications between the central PLC and distributed PLC/RTU units, via hardwired OFC cable and GPRS wireless technology.
- Adequate number of process Bus (Profibus/Modbus over ethernet TCP/IP) Communication Ports shall be configured for communication interfacing to intelligent Instrumentation. Serial communication RS232 Port/Ethernet for local laptop connection shall be available as well.
- The RTU/PLC at gates shall be communicating to BCR primarily through Optical Fiber Cable (OFC). It should possible to remotely program RTU/PLC from the control room. Industrial grade optical fiber convertor shall be housed in each RTU/PLC at gates for optical communication between RTU/PLC and central controller.

#### I. PLC/RTU I/O Facilities

#### a) General

- PLC analogue and digital inputs and outputs shall meet the requirements of test voltage of class II of IEC 255-4 appendix E.
- The PLC /RTU's should be of modular structure, equipped with separate I/O modules for each type of I/O signals, as follows.

#### b) Analogue Inputs

Analogue inputs shall be capable of accepting current signals of, (4-20) mA, with over range capabilities and support for 2/4 wire communications.

All components used in measuring circuits that affect accuracy shall be of high stability and low temperature coefficient.

A/D conversion shall be provided on each analogue module. The module scan cycle shall be rapid so as to satisfy the overall analogue response time specified to the master workstations.

It shall be possible by means of the PLC/RTU configuring software, to modify the signal dead-band, so that fluctuating signals are not continuously reported to the Master Station.

## c) Digital Inputs

Digital input modules shall be optically isolated. Digital filtering to suppress contact bounce shall be provided. In addition, software filtering of two successive cycles shall enable confirmation of state.

To reduce data transmission, time tagging shall be selectively applied. Only some inputs shall be time tagged at the PLC/RTU, but other inputs shall be time tagged on arrival at the Master Station.

#### d) Digital Outputs

- The digital output modules shall support isolated outputs in, latched and BCD mode. Individual LEDs will indicate the status of each output. The outputs shall be isolated to at least 500VDC Controls transmitted between the control station and the PLC/RTU shall comprise a select, check-back, execute sequence (or other means of providing high message security). On receipt of a select message, the PLC shall prepare to operate the output relay, and then return confirmation of correct selection of the relay to the Control Station. This signal shall be obtained as far as possible and shall be generated locally, not derived from the incoming signal. On receipt of the execute command, the output relay shall operate and confirmation of execution shall be returned to the SCADA Control Station.
- Not more than one digital output shall be possible at a time. Selection of two or more contacts simultaneously or in quick succession without one having been completed, shall result in cancellation of both requests and return an alarm to the Master Station.
- Software interlocking schemes shall be applied with reference to process requirements.

## e) Analog Outputs

- The PLC shall support analogue set point outputs. These may be used to issue controls directly to controllers, or to drive displays.
- Analogue outputs shall generate (4-20) mA DC output signals into a minimum load of 500 Ohms at a nominal operating voltage of 24V DC.
- Simultaneous operation of individual digital outputs shall be provided, where this facility is required. Set point outputs shall provide the security to ensure that false selection of controls is minimized, similar to individual digital outputs.

#### f) Dummy Control

To provide test facilities, a remote dummy control shall be provided. The dummy controls and associated status indications shall be allocated with discrete addresses and operate as if they are real equipment. To set up a dummy control a PLC/RTU with dummy control set up for training of operational staff shall be provided.

## J. PLC/RTU Operation Features

#### a) Operation with Control Station

- PLCs shall have their own unique address and not transmit information to the Control Station without the request. In order to reduce communications channel load, PLCs/RTU shall incorporate data transmission reduction methods. PLC/RTU shall reply to each interrogation on a "Report-by-exception" basis with the Control Station, also being fully updated on a regular basis. Digital input data shall only be transmitted when the status has changed since the last pool interrogation. Analog values shall be transmitted when a defined percentage change occurs from the last transmitted value. Each PLC/RTU reply shall automatically include the verification of the address in the response.
- Full details of the management of digital and analogue data input shall be submitted for approval.
- PLC/RTU's shall be also available to be polled at any time from the Control Station, either on a periodic basis or on operator command. In case of polling, all inputs may be scanned.
- Control messages from the Control Station, shall be capable of being initiated at any time to control the barrage, and shall have priority over all other messages.

#### b) Automatic Restart

Following power interruption and /or communications failure, the PLC/RTU shall be arranged to restart automatically. This may be accomplished by retaining memory in non-volatile store.

#### **K. Local HMI Facilities**

The remote PLC/RTU system shall be equipped with adequate operator panel to enable monitoring and control for the operator at the barrage level.

The operator panel shall be preferably accomplished by means of LED/LCD backlit display of 7 inches or above at Local Control Stations & 12" at Central PLC. The graphical LED/LCD should be easily detachable such that its failure does not affect the PLC/RTU functionality.

## L. PLC Programming

- PLCs shall be reconfigurable from either a locally connected portable programming device /laptop, or remotely over the communication links from the control station.
- Configuration changes shall be protected by access codes. Option for download & reconfiguring of PLC/RTU software from control Station is required.
- User-friendly designed PLC/RTU programming editor supporting all IEC 61131-3 programming languages shall be included in the set of engineering software. For local process control, the PLC shall support open PLC programming standard, according to IEC 61131-3, including five main programming methodologies:
  - Ladder Diagram (LD)
  - Function Block Diagrams (FBD)
  - Instruction List (IL)
  - Structured Text (ST)
  - Sequential Function Charts (SFC)
- PLC/RTU application software shall be installed in contiguous PLC/RTU memory data area, in order to ensure sufficient PLC/RTU computing speed. The PLC memory shall be sized to ensure it is not more than 50% occupied and that maximum occupancy does not significantly slow down the computing functions.

#### M. PLC/RTU Process Operation

- PLC/RTU shall be enabled for effective SCADA monitoring, control and data transfer with control station, as well as for local PLC /RTU level closed loop process control, control logic and other local automation applications.
- The PLC/RTU shall be controlled by application software making it capable of the following minimum functions:
  - Command outputs
  - Select before operate feature
  - Digital filter
  - Adjustable chatter frequency
  - Time-tagging of events
  - Alarm handling

The PLC shall be of Industrial grade with the IEC Certification.

#### 4.7 1KVA UPS for each remote RTU/PLC as a power back up

1 KVA Ups shall be installed in each Local PLC/RTU panel to provide a power back up of minimum 2 hours, with following minimum specifications:

Capacity  Voltage Range  140VAC-290VAC  Compact Size  PES  Boost and buck AVR for voltage stabilization  Auto restart while AC is recovering  Simulated sine wave  Off-Mode charging & Cold start function  INPUT-  Nominal Voltage  Frequency Range  OUTPUT-  AC Voltage Regulation (Batt. Mode)  AC Mains Frequency (Batt. Mode)  Transfer Time  Transfer Time	<b>Features</b>	
Voltage Range  140VAC-290VAC  Compact Size  YES  Boost and buck AVR for voltage stabilization  Auto restart while AC is recovering  Simulated sine wave  Off-Mode charging & Cold start function INPUT-  Nominal Voltage  Frequency Range  OUTPUT-  AC Voltage Regulation (Batt. Mode)  AC Mains Frequency (Batt. Mode)  50Hz ± 1%	Capacity	1000VA / 600W
Compact Size  Boost and buck AVR for voltage stabilization  Auto restart while AC is recovering  Simulated sine wave  Off-Mode charging & Cold start function  INPUT-  Nominal Voltage  Frequency Range  OUTPUT-  AC Voltage Regulation (Batt. Mode)  AC Mains Frequency (Batt. Mode)  Syes  YES  Modified sine wave  230Vac  50Hz  230VAC ± 10%  50Hz ± 1%		140VAC-290VAC
Boost and buck AVR for voltage stabilization  Auto restart while AC is recovering  Simulated sine wave  Off-Mode charging & Cold start YES  function  INPUT-  Nominal Voltage  Frequency Range  OUTPUT-  AC Voltage Regulation (Batt. Mode)  AC Mains Frequency (Batt. Mode)  50Hz ± 1%		
Auto restart while AC is recovering  Simulated sine wave  Off-Mode charging & Cold start function INPUT-  Nominal Voltage  Frequency Range  OUTPUT-  AC Voltage Regulation (Batt. Mode)  AC Mains Frequency (Batt. Mode)  Simulated sine wave  Modified sine wave  YES  230Vac  230Vac  230Vac  230VAC ± 10%  50Hz ± 1%	_	
Auto restart while AC is recovering  Simulated sine wave  Modified sine wave  Off-Mode charging & Cold start YES  function INPUT-  Nominal Voltage  230Vac  Frequency Range  OUTPUT-  AC Voltage Regulation (Batt. Mode)  AC Mains Frequency (Batt. Mode)  50Hz ± 1%		
Off-Mode charging & Cold start function INPUT-  Nominal Voltage 230Vac  Frequency Range 50Hz  OUTPUT-  AC Voltage Regulation (Batt. Mode) 230VAC ± 10%  AC Mains Frequency (Batt. Mode) 50Hz ± 1%		YES
function  INPUT-  Nominal Voltage  Frequency Range  OUTPUT-  AC Voltage Regulation (Batt. Mode)  AC Mains Frequency (Batt. Mode)  50Hz ± 1%	Simulated sine wave	Modified sine wave
Nominal Voltage  230Vac  Frequency Range  50Hz  OUTPUT-  AC Voltage Regulation (Batt. Mode)  AC Mains Frequency (Batt. Mode)  50Hz ± 1%		YES
Frequency Range 50Hz  OUTPUT-  AC Voltage Regulation (Batt. Mode) 230VAC ± 10%  AC Mains Frequency (Batt. Mode) 50Hz ± 1%		
OUTPUT-  AC Voltage Regulation (Batt. Mode)  230VAC ± 10%  AC Mains Frequency (Batt. Mode)  50Hz ± 1%	Nominal Voltage	230Vac
AC Voltage Regulation (Batt. Mode)  230VAC ± 10%  AC Mains Frequency (Batt. Mode)  50Hz ± 1%	Frequency Range	50Hz
AC Mains Frequency (Batt. Mode)  50Hz ± 1%	OUTPUT-	
	AC Voltage Regulation (Batt. Mode)	230VAC ± 10%
Twongfor Time	AC Mains Frequency (Batt. Mode)	50Hz ± 1%
Transfer Time Typical 4-onis	Transfer Time	Typical 4-8ms
Waveform (Batt. Mode) Modified sinewave	Waveform (Batt. Mode)	Modified sinewave
BATTERY-	BATTERY-	
Battery Type 12V/7Ah x2	Battery Type	12V/ 7Ah x2
Minimum Backup Time 2 hour	Minimum Backup Time	2 hour
Typical Recharge Time  Shall be less than 8 hours up to 90%	Typical Recharge Time	Shall be less than 8 hours up to 90%
capacity		capacity
INDICATORS-	INDICATORS-	

Battery Mode	Yellow flashing
AC Mode	Green lighting
ALARM-	
Battery Mode	Sounding every 1minute
Low Battery	Sounding every second
Overload	Sounding every 1 second
Fault	Continuously Sounding
Output Sockets	India output
ENVIRONMENT-	
Humidity	0-90% RH @ 0-40degC (non-condensing)

## 4.8 RTU/PLC Enclosures / Housing boxes of protection protocol of IP54 and above

#### A. Enclosure for PLC/RTU

- Factory fabricated to requirements, lockable doors, dead-front, self-supporting.
- Cabinets shall consist of a rigid self-supporting structure constructed of not lighter than 2 mm thick, cold rolled, stretcher levelled sheet steel, braced rigidly where required with structural members. Panels and doors shall be constructed of the same weight and type of material as the housing. Housings, including doors and panels, shall show no evidence of warping, weaving, or distortion upon completion of installations.
- All cable entry in to the panel shall be form bottom using cable glands of adequate size.
- The panel shall be provided with forced fan cooling system as a standard.
- The internal panel layout must be designed considering proper approach to the PLC/RTU, instruments, relays, terminals and other accessories for maintenance
- The Cubicles should in sheet steel construction, free floor mounting with front and back access. The doors and side covers should be of 2- mm thick sheet and all load-bearing members are 2 mm thick.
- Arrange doors with minimum 90- 105 degrees open position and with stops. Construct
  doors so that they neither weave nor warp; provide stiffening members where necessary to
  ensure rigidity.
- Provide ample duct space for adding and removing wiring from the top.
- Dimensions As per site requirement & as approved by Engineer In charge.

- Lock System: Slam lock /Screw Fixed with common key or unique key.
- The cabin shall be provided with power distribution units with sufficient number of sockets to provide power to equipment's hosted inside the cabin
- Provide channel base for mounting.

## **B.** Equipment Arrangement

- Wiring ducts to provide easy access for inspection and maintenance.
- Design and arrange ducts and terminal blocks to accommodate bottom entry to cabinet for control, alarm, status, power, and instrumentation cables, as required.

#### C. Ground Bus

Provide continuous copper bar ground bus, size not less than 6 mm by 25 mm along the full length at the rear of the panel.

## D. Nameplates

- Engraved 20-gauge metal/baked enamel or phenol plastic, black background/white letters, drilled for screw mounting with round head screws.
- Provide nameplates for all equipment, instruments, power supplies, relays, circuit breakers, fuses and other devices furnished and mounted in the cabinet. Provide nameplates for each device on panel interior door.
- Submit size, type, and wording for authorties approval. All nameplates shall be in English.

## E. Terminal blocks

- Terminal blocks for switchboard control wiring shall be rack mounted screw clamp type.
- Provide white or other light-colored markers to the terminal block, for terminal designations.
- Make no more than two connections at each terminal point.
- Confine switchboard internal wiring to one side only of the terminal block. The other side shall be reserved for incoming leads.
- Twenty percent of terminal points in each panel section shall have no connections and shall be designated as spare terminals.
- Form control wire bundles without sharp bends and support adequately.

#### F. INDICATING LAMPS

The indicating lamp assemblies shall be a heavy-duty type with color caps. Indicating lamps shall be suitable for AC/DC power supplies, utilizing long life incandescent type lamps.

#### G. LIGHTED PUSHBUTTONS

Each lighted pushbutton shall be mechanically interlocked, illuminated type. Lighted buttons shall be the recessed guarded type to preclude inadvertent operation. Gate control lighted pushbuttons shall be furnished with a flasher so the lamps will blink at a 1-second on and off rate when the maintained pushbutton is operated.

#### H. PUSH BUTTONS

Each unit shall be a maintained contact type. Pushbuttons shall be the recessed guarded type to preclude inadvertent operation.

#### I. RELAYS/Contactors

Auxiliary relays: The auxiliary relays shall be in accordance with IS standards and shall be machine tool or industrial type. The relays shall have convertible contacts and shall be self-resetting. A minimum of two spare contacts shall be furnished on each relay.

#### J. SPECIAL TOOLS

The bidder shall furnish any special tools that may be required to allow proper connections of wiring to devices and all terminal blocks.

#### K. SURFACE FINISH

Cabinet has to be Nano-Ceramic/Epoxy powder coated with RAL 7035 after proper Pre-Treatment as per the best industry practice, with thickness of 80 to 120 microns.

## L. TEST PROCEDURE

After the cabinets are completely assembled and wired, perform the following tests and procedures.

- Dielectric test on all circuits in accordance with standard test requirements. Instruments or other devices that cannot withstand test voltage shall be disconnected.
- Circuit continuity test to verify connections.
- Functional tests of all control switches and indicating lamps.
- Verify operation of Operator Interface Unit on cabinets.
- Temperature testing to ensure that operational temperature of all equipment's is maintained.

#### 4.9 VFD STARTERS PANELS

3Phase VFD Starter panel shall consists of S.P.P, MCB, OLR, Timer, Main Switches of reputed makes including wiring and Electronic Digital Indicator etc.

The control module must be able to drive motors with the following control modes: linear, parabolic and parameterizable V/f characteristic, V/f characteristic with forward/reverse current control, linear and parabolic V/f characteristics with eco mode for additional power saving, vector control without sensor, torque control without sensor. The drive system must be protected through thermal motor protection, thermal converter protection, monitoring for under voltage and overvoltage, overloading, grounding, short circuiting, stalling and blocking of the motor. All digital and analogue inputs and outputs must be freely parameterizable and assigned to a specific function in the factory setting.

To parameterize the drive, an integrated USB interface for PC/Laptop connection is needed, saving and loading parameter records and firmware updates must be possible by a memory card. The terminals have to be identified by replaceable labelling strips for individual marking.

## 4.10 Equipment's at BCR

Hardware at BCR shall be provided by bidder which will mainly comprise of following major item:

- a) Main Server and Server as Workstation (operating Station)
- b) Necessary data switch, router with modem, Static IP, and fire wall for System
- c) 3KVA online UPS with 4 hours backup time
- d) External memory for data storage of 8TB for 5 years.
- e) A3 size Color printer
- f) 110" LED display/video wall/(70",2X1) DLP based system
- g) Master PLC Controller

## 4.11 Central Control Panel (Main PLC Controller at BCR)

The central controller shall be based on modular PLC with firm ware based hot redundancy. Main and Redundant CPU shall be mounted in two separate racks. Event-driven synchronization method shall be provided for fast and bump less changeover to the redundant CPU in the event of a fault, without any loss of information and control. When a CPU is replaced, all the current programs and data are automatically to be synchronized by master CPU with standby CPU. The central PLC controller & SCADA shall be of the same make/manufacturer as the PLC/RTU controller in the remote station. The central controller & the PLC/RTUs shall be able to exchange data with each other freely & seamlessly, without requirement of any intervening hardware, apart from Optical convertors. The central controller shall have a 12" HMI colored screen for indicating the diagnostic & other information. It should be possible to view detailed information by using buttons on the screen, to drill-down to the appropriate page.

The remote PLC/RTU shall pass-on all the I/O information directly to the central controller, and shall act as a slave.

The controller should be able to communicate over an open protocol such as Profibus / Modbus over ethernet TCP/IP and GPRS wireless technology etc. The communication should be integrated in the CPU and should not require any additional cards or gateways. It should be possible to view, control & troubleshoot the PLC without requiring any additional software apart from SCADA software. Data logs should be stored inside the CPU and should be downloadable in CSV format using a web browser. It should be possible to increase the I/O handling capacity of the PLC, without changing the CPU, by the addition of appropriate I/O cards. The central controller should have a non-volatile memory of at least 4 MB & with 16 MB RAM memory card and should be tested for operation from region to region change in temperature range of 0 to 50 degrees Celsius. The central controller shall have high immunity to electro-magnetic interference according to IEC 61000-6-2 and vibrations according to EN 60068-2-6.

# **4.12 Computer Servers**

Server shall be industrial grade PC with USB, RS232/RS485, Ethernet Ports, OS Windows 8 or higher compatible to SCADA System. BCR shall have Master server with SCADA Software.

110" LED display/ (70", 2X1) DLP based System/video wall Unit to be connected to server with separate USB Port/ Ethernet Port.

There will be two servers with monitors required (one as work station), with the Master Controller (PLC) placed at the BCR. These Computer servers are expected to operate the SCADA software as well as all software required for the project. The computer servers will be managed and operated by the successful bidder and his skilled trained experienced operators/engineers till the end of 5 years warranty period. The minimum specifications for the servers are given in Table below:

1.	Form Factor	Rack Mount Server		
2.	Processor	Intel XEON ES-2440 or higher compatible configuration		
3.	DIMM Memory	Speed: 1600MT/s RDIMMS or higher compatible configuration		
		8GB RDIMM, 1600MT/s, Low Volt, Dual Rank or higher		
		compatible configuration		
4.	Hard Drive	RAID 5 Software or Hardware Controller compatible		
		5-1TB 7.2K RPM Near-Line SAS 6Gbps 2.5in Hot-plug Hard		
		Drive or higher compatible configuration		
5.	Network	2 GB or higher compatible		
	Adapter			
6.	Power Supply	Dual, Hot-plug, Redundant Power Supply/Solar Power and battery		
		backup as compatible configuration		
7.	Electrical	220V AC and supply from AC distribution, DC of DG Set		
	Supply			
8.	Connecting	Soft touch Keyboard, Optical Mouse, Monitor (23" TFT)		
	Devices	110" LED screen (combination of more than one permitted)		
		monitors/Video Wall/(70", 2X1) DLP based.		
9.	Software	SCADA compatible as per specification and OS Windows 8 or		
		higher compatible.		
10	Additional	Additional memory Rack of minimum 8TB that shall be suitable for		
	Memory Rack	data logging for a period of at least 5 years.		
11	Accessories	Power Cord		
		Rack Rail with cable management system		
		Power Points as needed		

## **Computer Rack and related parts**

The bidder is required to procure full height Server racks that will hold the servers and UPS system.

## **4.13 LAPTOP**

laptops (i7,5th Gen) with all allied software and hardware accessories, for programming & configuration & monitoring of SCADA system shall be provided by bidder with 4 licenced version client SCADA software.

## 4.14 Colour A3 size Printer

i. Functions: Print, Copy, Scan

ii. Printing Up to 20 page/minute

iii. Black Print Speed (ppm) -12 Colour Print Speed (ppm)-8

iv. Up to 8000 pages printing

v. Recommended monthly page volume: 250 to 2000

vi. Processor speed: 600MHz vii. Connectivity: e print capability

Paper Handling: -

viii. Paper handling input, standard: 100 sheet input trays

ix. Paper handling output, standard: 100-sheet face-down bin

x. Maximum output capacity (sheets): Up to 100 sheets

xi. Duplex printing: Manual (Driver support provided)

# 4.15 Uninterruptible Power Supply Systems (3 KVA UPS System)

## i) General Design

- The UPS System shall be Single Phase LVAC 50Hz output with the charger and inverter normally supplying the load.
- The charger shall be of thyristor-controlled type. The battery shall be of Nickel Cadmium/ SMF type. The inverter shall be of the Pulse Width Modulated (PWM) type, providing a single-phase output. Configuration with galvanic isolation transformer at the mains supply shall be supported.
- UPS 3 KVA minimum capacity and all its consisting elements shall cover the required Station load, together with 20% spare for future use.

## ii) Operation Requirements

• UPS charger shall continuously supply the load via the UPS inverter, while simultaneously maintaining the battery charge in the float charge mode. In the event of interruption or

depression in the AC mains voltage to the charger, the battery shall supply the load requirements via inverter.

- Upon restoration of the AC mains voltage, the UPS charger shall take over the power supply of the load via the inverter, while simultaneously recharging the battery.
- UPS shall be capable of energizing the load within the permissible tolerances, without the battery connected.

## iii) Charger and Battery

- The charger shall operate according to the constant voltage, current limiting principle, and shall incorporate a soft- start feature to gradually accept load on initial energizing.
- UPS charger output characteristic shall provide an output voltage regulation of + 1%, for load changes 0-100 % and mains voltage supply and frequency within the tolerance ranges. Automatic compensation feature related on battery temperature shall be provided in case if lead-acid battery is installed.

## iv) Inverter

• The UPS inverter output voltage shall be maintained to + 1% of the nominal value for load changes 0-100 % and mains voltage supply and frequency within the tolerance ranges. The dynamic output voltage variations shall not exceed + 10% of the rated output voltage under any circumstances of instantaneous load changes

## v) Readings/Instrumentation and Alarms

• The following readings /instrumentation/LED indication shall be supplied as a minimum:

Battery voltage

UPS output voltage

• The following alarms/LED Indication shall be supplied as a minimum:

Charger fails

Inverter input voltage high /low

Inverter fails

#### vi) UPS Distribution

• The distribution system shall be designed for incoming and outgoing AC supplies. Double pole miniature or moulded case circuit breakers complying to IEC 60157 shall be supplied, fitted with auxiliary contacts that operate when the circuit breaker trips. MCBs shall be rated to meet the load requirements and shall be labelled with the destination of the load.

## 4.16 Display Units

The 110" industrial grade LED video wall/ (70", 2X1) DLP based to be provided by Bidder in BCR for monitoring of SCADA system. The Workstation shall be connected to the screen LED /DLP display panel through communication bus.

All the required information from the PLC panel shall be continuously updated in the screen LED/DLP display panel. The screen LED/DLP display panel shall map and display the vital information like, all reservoir levels, discharge, panel status, power availability, energy meter reading, Motor data etc. Specifications as below or better for 110" LED/ video wall/DLP based system shall be provided

Display Unit for 110" LED /Video Wall/DLP based/System		
Each Screen Size	55" class (54.64" diagonal)	
Native Resolution	1920 x 1080 (FHD)	
Pixels (H x V x 3)	6,220,800	
Brightness	700 cd/m2	
Contrast Ratio	1,400:1	
Viewing Angle	178°/178°	
Running Time	24Hr	
Orientation	Portrait & Landscape	
INPUT		
HDMI	Yes	
RS232C IN	Yes	
RJ45	Yes	
IR Receiver	Yes	
USB (USB3.0, USB2.0)	Yes	

OUTPUT	
DP Out	Yes
Audio Output	Yes
RS232C Output	Yes

SPECIAL FEATURES	
Temperature Sensor	Yes
Check Screen	Yes
Embedded Template	Yes
Set ID Setup	Manual, Auto
Password Change	Yes
Intelligent Auto	Yes
Digital Audio Input	Yes
Local Time Auto Setting	Yes
Sync Mode	Time sync, Content sync
Calibration Mode	Yes
Internal Memory	8GB (System 4GB + Available 4GB)
Brightness/Contrast /Backlight	Yes
Energy Saving	Yes, Off / Minimum / Medium / Maximum / Screen Off
Auto Config/Phase	Yes
Basic	Remote Controller, Power cable, DP Cable, Manual, IR Receiver, RS-232C Cable, LAN Cable, Guide Bracket, Screw
POWER	·
Power Supply	100–240V~, 50/60Hz
ENVIRONMENT CONDITIONS	
Operation Temperature	0 to 50 degree Celsius
Operational Humidity	10%~90%

#### 4.17 SCADA SYSTEM FOR BARRAGE AUTOMATION

#### A. General

The Barrage control room will have two servers (one as a workstation), Monitor with internet connection with static IP & firewall system in combination with router. The Customized SCADA software will accept information sent by all the remote PLC/RTU, store the information in a data base, display the information in appropriate mimic displays, analyze past data and trends, will have the authentication feature by way of user name and password for operating the software; Updating of parameters of the PLC/RTU along with instrument can be done interactively from this software.

#### The development of software has to be customized with end user.

The control room will have main PLC system with IOs, main SCADA system, GPRS Modem, gateway software etc.

The control system along-with SCADA Software shall be provided in the Barrage control room (BCR) and the information available at control room (BCR) should also be available on any other PC/Laptop and on mobile located at any place through web. The Data provided in BCR should be displayed in complete explicit way and can be extracted in different formats.

In Head Office located at Salt Lake, Kolkata three sets of laptops installed with licensed version client SCADA software, internet (4G/3G dongles) shall be provided by bidder for monitoring of system by Executive engineer, SE office, CE office in Salt Lake.

The local control and computing system for the gates shall be able to calculate the actual discharge depending on reservoir water level and gate opening.

The local computing system shall be interconnected with the latest industrial grade Server with monitor and LED video wall not less than 110" size / (70", 2X1) DLP based system via master PLC Controller in the BCR, from which the command for the necessary discharge, to spillway gates shall be provided. All signals shall be sent and received to/from the BCR. Operating system shall be based on Windows server 2008 or latest.

A master controller shall define the required total gate opening. The PLC/RTU shall compare the required value with the total actual opening found by adding up the individual opening values, if the deviation of one or more gates from the required value is large enough, an 'Open'- or 'Close'-instruction shall be given to the respective gate(s). However, to prevent hunting of hoist the deviation should be beyond the preselected tolerance band.

In a selection circuit the 'open'- instruction shall be transferred to that gate, which at the time of the comparison controls the smallest opening. Similarly, a 'close' - instruction shall be given to the gate controlling the largest opening.

For the gate selection, only the gates shall be considered, of which the manual switches are in the 'Automatic 'position, and where no alarm signal has been received from, the 'open'- or 'close'-instruction shall remain with the selected gate, unless any of the following conditions is met:

- The required and actual openings agree and the positioner cancels the instruction, or
- The gate had previously reached its limit position, or,
- The max. Permissible deviation (pre-set difference in position between controlled gate and average of all gates available) has been reached previously.
- The selected gate is not in operating condition.

In the event of major changes in required size of opening, the gates shall be moved successively one step each, i.e. after re-setting all gates again agree within the pre-set margin in size of opening. After all available gates have reached their limit positions a corresponding signal shall be given.

At any time, individual gates shall be allowed to be switched over from the automatic mode to manual mode of operation, and vice versa, however, the operation from the local panel cannot be overruled by the remote/automatic operation stage. Adjustments made manually are to be automatically compensated for with the other gates by the automatic control system.

Manually adjusted gates shall, when returned to automatic mode of operation, be adapted to their normal functioning in the automatic mode. The automatic system shall work independent of the number of available gates with the same characteristic. If all gates have been changed over to MANUAL, the master controller shall be reset so as to permit a smooth switching-over to AUTO operation.

The system is to be designed to monitor the duration of the instruction. The monitoring is to prevent, that an instruction is maintained over a period, that is longer than a pre-select e.g. in the event of a malfunction of a gate selected by the controller, if the monitoring system is actuated, the particular gate is to be cancelled from the group of gates available for selection.

Electronic attenuation is to be included to provide against unsteady level signals. The system should be compatible with flood fore-casting system to be provided by the employer for the monsoon period.

#### B. Functions/ Features of SCADA Software

- Normally Dynamic Gate Operation Scheduling Program will decide position of each Gate depending on the Water Discharge requirement.
- Development of Dynamic Scheduling Program is included in the scope of work.
- Operator in Control room should be able to control movement of individual gates via. SCADA software. This is needed for testing and emergency handling.
- The customized, with life time licensed version SCADA software shall be designed, developed, Supplied, installed & commissioned by bidder based on the inputs provided by Engineer-in-Charge which shall have following minimum features:

- i. It shall accept information send by all the remote locations /sites
- ii. Stores the information in a data base
- iii. Display the information in appropriate mimic displays
- iv. Will have a provision to analyse past data and trends
- v. Will have the authentication feature by way of user name and password for operating the software.
- vi. Updating of parameters of the PLC/RTU along with instrument can be done Interactively from this software.
- vii. SCADA software shall be of at least 5000 tags & screens shall be provided as per user requirement.
- viii. Automatic alarm generation
- ix. Automatic report generation
- x. Auto e mail and SMS with web server facility

## SCADA Software should mandatorily provide Graphical User Interface from Main menu for:

- 1. Parameterisation and configuration setting of Sensor
- 2. Programming of PLC/RTU.
- 3. Real time data monitor on GUI and LED display.
- 4. File creation and Storage controller.
- 5. External Data transmission controller.
- 6. Burglar and alarm warning system controller
- 7. Power status monitor and logging.
- 8. Motor status monitor and logging.
- 9. Data exporting features
- 10. Integration of rating curves
- 11. Manual data entry and input programmes
- 12. Printing graphical and tabular data

The Successful bidder shall upgrade all such developed software during the O & M period on need basis and provide the latest versions of all such software including Source Codes, while handing over the facilities to Authority.

In addition, it shall be possible to export SCADA data to Hydrological Information System (HIS) to be developed under National Hydrology Project in Future.

## 4.18 Tele-metering and Supervisory Control

The bidder shall provide Broadband with minimum internet speed of 8mbps for uploading and downloading along with necessary router with modem, static IP, firewall system & switches for GPRS communication. The bidder shall also provide the digital transmitters and their indications via the bus system. The SCADA System software should have the facility to track the non-functional sensors on daily basis and display on the web.

## **Tele-metering Items**

Digital type gate position indications.

Digital type water level indication.

Digital type discharge indication.

Digital type Automatic weather station data

## **Supervisory Items**

Alarms & Indications shall be provided at BCR. These shall include, but not limited to, the following:

- A.C. fault
- Common Alarm
- O/L Trip
- Open
- Close
- Stop
- Remote/Local

# 4.19 Solar Power System for Dataloggers

- i) Supply, Erection and commissioning of Solar power system with all allied ancillaries for providing un interrupted power supply to dataloggers located at canal systems for Minimum 5 days Backup without sunshine. The Solar Panels shall be provided in anodized aluminium frame with batteries, Solar panel should conform to IEC- 61730, 61215 and 61701.
- ii) The Bidder shall supply a pole mounted arrangement including a standard pole and necessary foundation and fixing arrangements. The location of solar power installation shall be indicated by the concerned engineer in charge.
- iii) The batteries required for the equipment above shall be maintenance free, rechargeable sealed batteries with Overcharge and deep discharge protection Leak-proof Easy handling, Excellent recharge ability.

- iv) The battery pack shall also include arrangements of charging through a standard AC power supply available at canal system and also from solar panels established as above.
- v) The power supply unit shall have audio or visual alarms for overcharging and deep discharging conditions. The sealed construction shall allow trouble-free, safe operation in any position. The battery case shall be high-impact, with sufficient resistance to shock, vibration, chemicals and heat.
- vi) The battery system shall be installed in the site building located near the Cross/Head regulator of Canal system
- vii) Successful bidder shall provide the necessary calculations to ensure the battery backup time of 5 days considering the transmission of data in every 30 minutes & event based.

## 4.20 Standards

The design, manufacture and testing of all works and installations shall strictly comply with the latest edition of the relevant IEC publications/IEEE/IS.

All the instruments/ transmitters shall be UL/CE certified.

## 4.21 Wiring/Cabling requirements

Shielded OFC cables complying with IEC 60793-1-1 shall be used for external Cabling from the RTU/PLC to Master controller & for entire instrumentation system to ensure the reliable operation of the SCADA system with necessary conduiting/ cable trays as per site requirement.

These are minimum requirements. Bidder is free to propose improved cabling technology which shall be subjected to approval from Engineer in Charge.

The cabling system design criteria shall be as follows.

- i). The term cable shall always include necessary type of connectors at both the ends for connecting between two equipment. The connectors shall be properly anchored with protective sheathing of the cable in such a way that the loads due to pulling and twisting shall be borne by the protective sheathing and the conductors shall not be subjected to any stress.
- ii). The connectors shall be so fixed on the individual components of the system that the metal/ plastic connector shall always transfer the loads due to pulling and twisting directly to the protective body of the component and the internal interface cards/ connections shall not be subjected to any load.
- iii). Laying of necessary data and power supply cables for connecting various components and embedding them or protecting them with necessary conduits shall be carried out as per directions of engineer-in-charge.
- iv). Wherever the cables are to be laid indoors and the length of the individual cable run

exceeds 1 meter, the cable shall be housed in a protective conduit made of electrical supply grade conduit of appropriate diameter and the conduit shall be fixed with the wall at a height not less than 1 meter above the floor surface. Whenever the indoor cable is required to cross the floor, it shall be housed in a HDPE /GI flexible conduit pipe of 25 mm internal diameter and the pipe shall be fixed to the floor with suitable protective covering to avoid tripping of personnel using the area or disturbance to the pipe due to such movement.

- v). Wherever cables are to run through open ground including the public road and pathways, the cable shall be armoured and shall be water ingress proof up to static water pressure of 5 kg/cm2. All joints made in cable shall also meet the water proofing criteria. In addition, the cable shall be protected by housing the same in 25mm galvanized iron pipe embedded at a depth of not less than 1.0 meter below the ground surface with a warning brick on the same. A sketch of the cable layout with respect to the identifiable marks of the area shall be prepared and handed over to the Engineer-in-charge for each such cable run on completion of the work of cable laying operation.
- vi). The joints in the cable connecting between the sensor and data collection unit shall be avoided by measuring the appropriate length of the cable required and attaching the same in one piece. If the cable joints become necessary, prior permission of the Engineer-in-charge shall be obtained before executing the same. The joint fabricated through a splicing and jointing kit shall be stronger than the parent cable.
- vii). The cable carrying data and electrical power shall be housed separately in different conduits separated by adequate distance to prevent leakage currents. The data cables shall also be laid out in such a way that the data integrity is not compromised due to mutual interference.

# **4.22 Discharge Measurement**

Discharge profiling of barrage and head regulator shall be carried out by the bidder to obtain data regarding width (m), Area (m<sub>2</sub>), Mean Speed (Mtr/s), Total Discharge (M<sub>3</sub>/s), Max Measured Depth (Mtr), Max Measured Speed (Mtr/s). Profiling should be done twice in a year & accordingly rating curves developed shall be integrated in SCADA system by successful bidder.

#### 4.23 Manufacturer

Only CE/UL certified Sensors, RTU/PLC shall be used. The Remote-Control system is to be sourced from a reputed designer cum manufacturer.

Following names are given as reference for PLC/RTU & SCADA system

- a) Allen Bradley/Rockwell
- b) GE
- c) Siemens
- d) Schneider electric

- e) ABB
- f) Mitsubishi

If the bidder proposes alternative sourcing from an equally reputed and expert Remote-Control System manufacturer, he can propose the same with complete details, references, lists of successful Remote-Control Systems supplied/installed for prior approval from Engineer-In-Charge before placement of order with any of the manufacturer. The Employer reserves the right to reject any or all of such proposed manufacturers including manufacturers named above.

## 4.24 DIESEL GENERATOR SET 10KVA

- Supply, Installation, Testing and Commissioning of Silent DG Set of 10 KVA for power supply to entire SCADA system in case of power failure for more than 2 hours shall be provided by bidder.
- Alternator shall be self-regulated with Standard Alternator protection (Over Voltage, Over Speed, Under Voltage, Under Speed warning & Shutdown).
- Engine shall have industrial silencer, Electronic/Mechanical Governor, Manual & Electric Start, Batteries, Engine Instrument panel, AVM and with water proof powder coated Acoustic enclosure for DG Set.

#### A. ENGINE

- Vertical, 2 cylinders, four stroke cycle Air / Water cooled cold starting compression / ignition, diesel engine under NTP conditions as per BS: 5514.
- The engine will have following standard accessories:

Heavy flywheel

Air cleaner dry type/Oil bath type.

Governor mechanical type

Starter 12 volts DC

12-volt Battery with leads

Dynamo / Alternator

Silencer Industrial (without piping)

Fuel lift pump.

## **B. ALTERNATOR**

• 415, three Phase, 50 cycles/ sec., 1500 RPM, self-excited, self-regulated screen protected drip proof alternator in accordance with BS: 2613.

#### C. ARRANGEMENT

The Engine and Alternator shall be close couple mounted on a common fabricated base plate.

#### D. CONTROL PANEL

- M. S. / CRCA Steel fabricated L.T. switchboard suitable for indoor floor / wall mounting installation & for controlling the above generating set. The control panel will be equipped with.
  - 1. Digital Energy Meter
  - 2. Main On/Off switch / MCB
  - 3. Set of indicating lamps.
  - 4. Set of instrument fuses.
  - 5. Set of current transformers.
  - 6. Over voltage Relay
  - 7. Suitable MPCB

The switchboard will be complete with internal wiring, front cover, rust proof, powder coated paint and arrangement for receiving incoming and outgoing cables. The control panel shall have an automatic mains failure feature for remote automatic starting from the PLC based Control panel at the Field Station. Necessary equipment like solenoid coil etc. shall be provided for the same along with an IP54 or better panel.

#### E. FUEL TANK

Eight hours continuous running capacity, fuel tank complete with inlet/ outlet, air vent, drain plug, inlet arrangement for direct filling. The fuel tank level shall be displayed at the local panel and the RTU/PLC based control panel at the Field Station.

#### 4.25 SPARE PARTS AND TOOLS

All spare parts to be supplied shall be interchangeable with the corresponding parts of all the Works supplied under these Specifications and shall be of the same material and workmanship. They shall be replaceable without cutting or destruction of adjacent components. Before issue of the Taking-Over Certificate the spare parts shall be checked and tested at the Site by bidder in presence of the Engineer.

Acceptance of any spare parts will not take place before the bidder has submitted the complete final detailed list of all spare parts and tools. All spare parts, tools and materials shall be delivered in marked boxes of sufficient sturdy construction to withstand long term storage cum maintenance.

The Following Spare Part List shall be provided by Successful bidder

- a) Mandatory Spare Parts
- b) Recommended Spare Parts

## 4.26 SCHEDULE OF WORK AND PROGRESS REPORTS

#### **Schedule of Work**

The time and the date of completion of work as stipulated shall be deemed to be the essence of the contract. The bidder shall submit a detailed program for all the activities to perform the work as per the Contract. The schedule will be in the form of a detailed PERT network consisting of adequate number of activities covering various key phases of the works such as designs and drawings, procurement, manufacturing, shop assembly and painting. This network shall also indicate the interface facilities to be provided by the Purchaser, if any, and the dates by which such facilities are needed.

The Supplier shall so organize his resources and perform his work as to complete it not later than the date agreed to by him. The time for completion of the supplies contracted for, shall be reckoned from the date of award of supplies to the Supplier.

During the performance of the contract, if in the opinion of the Engineer-in-Charge proper progress is not maintained suitable changes shall be made in the schedule to ensure proper progress.

## **Progress Reports**

The above PERT network shall be reviewed and periodic reports shall be submitted by the bidder as directed by the Engineer-in-Charge before initiating the procurement/manufacturing, the bidder shall submit a detailed list of items/materials to be bought out from outside agencies . The list should be exhaustive and should serve as a check list for reviewing the progress from time to time. It shall be obligatory on the part of the bidder to submit a detailed monthly report by 7th of every month (for the previous month) giving the progress of the following activities:

- a. Designs, data sheet, Drawings & QAP approval of complete assembly for its prior approval by Engineer in charge, within one month of issue of letter of acceptance.
- b. Procurement of materials and bought out items
- c. Fabrication of various assemblies and sub-assemblies indicating detailed status of fabrication of critical items involved and expected date of completion.
- d. Stages of shop assembly.
- e. Shop testing
- f. Dispatch of materials.
- g. Installation status
- h. Maintenance schedules

## 4.27 DRAWING SUBMISSION

• The complete General Arrangement Drawing along-with each component drawing and complete architecture of SCADA, data sheet approval & QAP shall be submitted within 30

days from the issue of letter of acceptance for its approval to Engineer-in-Charge. Failure in submitting drawing in stipulated time shall amount to breach of the Contract.

## 4.28 SUBMISSION OF FOLLOWING DOCUMENTS

Bidder shall submit details of following on separate sheets for each of them, for evaluation of Bids along-with their offer: -

- (1) Warranty Related Services
- (2) Software License
- (3) O&M Staff details
- (4) Training to the Departmental staff
- (5) Installation and Commissioning Services
- (6) Detail Commentary against Technical Specifications
- (7) Deviation Sheet
- (8) Brief SCADA system architecture & control Philosophy

The prices as to-be quoted in BOQ shall include all the prices of above services/Software/Staff.

## **4.29 TECHNICAL RESPONSIVENESS:**

Bidders are requested to confirm that all requirements of technical specifications have been met without any material deviation or reservation by submitting duly signed and stamped bid documents & detailed clause by clause Commentary against technical specifications specified in Annexure1 & in case of any deviation, it shall be clearly stated in deviation sheet failing which offer of the firm may be considered as non-responsive.

## 4.30 DELIVERY AND COMPLETION SCHEDULES

The delivery and installation schedules are described in Schedule of Requirements. The maximum time period from the date of effectiveness of Contract to Final Acceptance is twelve (12) months followed by a Warranty and operation & maintenance period of 5 years. The bidder must comply with the milestones indicated in the delivery schedule and schedule for installation and commissioning.

#### 4.31 TRAINING

## A. Training Programme

The Bidder is required to provide an extensive training programme for the SCADA system. The training set forth in the following paragraphs is a minimum requirement and the bidder should propose any additional training that he considers critical for long term success of the system operations.

The Bidder is expected to provide an outline or table indicating the contents of each of the required courses. The table shall describe the specific topics to be covered for each day of the training period.

The Bidder is responsible for the salaries of the training instructors and all training materials. The costs of travel, transportation and daily allowances for the trainees shall be borne by the Purchaser.

## **B.** Training in General Operation

Training shall be provided by the bidder in several phases. The training shall include both classroom and field trainings and will be continued during all five years. The bidder is required to have instrumentation/ SCADA specialists. The training shall include following:

**Table: Formal training courses** 

S.	Description	Numbers of	Number of
No.		training	Participants per
			session
1	User Training Course for senior management. Design, operation and	2	10
	maintenance back-up, recovery and web-		
	services for officers. (2 days)		
	services for officers. (2 days)		
2	User Training Course for working staff.	2	15
	(2 days)		
3	Operation and Maintenance course onsite	2	10
	& class room (3 days). Course topics will		
	include sensor calibration, PLC		
	operation, SCADA operation &		
	configuration, report generation &		
	analysis, Trouble shooting of SCADA		
	system, maintenance requirements, and		
	procedures for equipment configuration,		
	installation, site testing and		
	commissioning.		
4	Theory and practice of discharge	2	10
	measurements, and development of rating		
	curves. (2 days)		

Theoretical training will take place in Durgapur or Kolkata as decided by the purchaser. On-job training will be in Durgapur. In case of formal training, the Purchaser will provide classroom and other logistics. The Bidder will facilitate the professional and the training material. On-the-job training will be provided by the Bidder in conjunction with the installation of instrumentation system and during the course of operation & maintenance as required.

The Bidder shall prepare a training course plan and include the same in the Bid Document.

The classroom training, hands on experience and troubleshooting will be prepared as video for easy access and will be posted on the web. All training modules will be also provided as a media file (Windows Media Player Compatible) on a USB Drive. Five copies on five separate media shall be required.

## 4.32 After Sales Service

#### A. LOCAL PARTNER

The Bidder is required to be an Indian firm or Indian arm of an international firm so as to develop an incountry technical support base during and after the project implementation phase. The bidder /manufacturer shall have after sales support center in region (within a radius of 500km from state capital) or shall set the same within 30 days from the receipt of LOA.

## **B. OPERATION AND MAINTENANCE (O&M)**

The Bidder shall be responsible for Operation & Maintenance of all stations/ components after installation, commissioning & site acceptance and operational test, during the contract period. All associated cost shall be part of contract price and bid price for evaluation. This operation & maintenance support contract shall refer to the complete instrumentation network of Barrage automation as per the schedule of requirement, proper functioning of SCADA and the hardware and software components. Assistance and troubleshooting shall be provided for all necessary maintenance, servicing, testing, and recalibration operations.

The Bidder will intervene with his personnel within the agreed dates, in-situ, in case of damages or malfunctioning of equipment or software and will proceed to the investigation of the cause and search a prompt solution to ensure proper working of the system.

Bidder shall provide a minimum one no. of Service engineer for operation of SCADA system at BCR from commissioning stage till completion of 5 years warranty, operation & maintenance period The Service Engineer shall have experience of working on Instrumentation / SCADA system for period of at least 3 years and shall be well versed with Operation and Maintenance aspects of SCADA systems. Operation and Maintenance of complete SCADA system shall include free of cost repairs/ replacement of hardware and Software necessary to keep the system functional for the period of five years from Date of Issuance of Final acceptance certificate from Engineer in Charge.

# 4.33 Legal Issues and Intellectual Property Rights

All hardware and software supplied will be legal and without any dispute on intellectual property rights. The Bidder indemnifies the purchaser against any legal issues that may arise out of usage of any part or the whole supplied system. The Supplier shall provide complete and legal documentation of hardware, and licensed operating systems in the name of purchaser. The supplier shall also indemnify the purchaser against any levies/penalties on account of any default in this regard. Supplier shall be responsible for any up gradations & renewals required for software & hardware.

#### 4.34 Civil Works

All the civil works required for installation, commissioning and operation of the system should be provided by the bidder and included in the cost. The civil works would include erection of suitable masts for mounting the sensors, RADAR, PLC/RTU, cameras and all other associated equipment's of the Automation system. The mounting structure should be sturdy enough to withstand wind speed as specified.

## 4.35 System Performance Criteria

The following performance parameters must be strictly maintained.

Average uptime – 95% for 24x7 operations

MRTR (Maximum Response Time to Repair) when the system is down as per definition given below:

- 48 hours during rainy season (June October)
- 120 hours during the rest of the year.

#### **Note**

## **Computation of Down time:**

The System will be considered to be down under any of the following conditions:

- A. Control for more than 2 (two) Barrage Gates are down at a time
- B. Control for more than 1 (one) Canal Gate on LBMC Head Regulator are down at a time
- C. Control for more than 1 (one) Canal Gate on RBMC Head Regulator are down at a time
- D. Monitoring of Water Level in Durgapur Barrage is down for more than three (3) hours
- E. Monitoring of any other parameter is down for more than (3) hours.
- F. Remote Monitoring of Barrage from is down for more than 3 (three) hours.
- G. Any particular hardware or software functionality defined in technical specifications is down for more than 3 hours (including BCR equipment's)

<u>Unless otherwise stated, Control/Monitoring as referred above will mean Monitoring or Control from Barrage Control Room.</u>

4	Db	<b>A XX</b> /	INGS
<b>+</b> .	IJĸ	$\mathbf{A}\mathbf{v}$	ロソリナン

These Bidding Documents includes [insert "thefollowing "or "no"] drawings.

[If documents shall be included, insert the following List of Drawings]

List of Drawings			
DRAWING NR.	Drawing Name	Purpose	

# **5. Inspections and Tests**

The following inspections and tests shall be performed:

#### 5.1 General:

- 1. After award of Contract bidder shall provide the Control philosophy, System Architecture drawing, datasheets of all instruments, QAP/ITP for all equipment's and SCADA software details for necessary approval from purchaser & after approval bidder /manufacturer can start manufacturing of equipment's.
- 2. After manufacture, the supplier shall get each equipment/item of Goods inspected in manufacturer/s works as per approved datasheets and QAP/ITP. Bidder shall forward test reports & calibration reports to the Purchaser along with his letter seeking to inspect a equipment/item of Goods conform to contract specifications.
- 3. Upon receipt of the test certificate and calibration certificates, the purchaser or its representative shall arrange for inspection and/or test of any or part or all the equipment /Goods prior to issuance of dispatch clearance. In cases where the supplies are received from abroad, the purchaser may waive the pre-dispatch inspection.
- 4. However, the inspection and dispatch clearance by the Purchaser or the waiver thereof shall not prejudice the right of the Purchaser or its consignee to test the equipment/goods on receipt at destination. Upon receipt of the goods at final destination, the Purchaser shall have the right to inspect and/or test the equipment/Goods to confirm their conformity to contract specifications.
- 5. If the equipment fails to meet the contract specifications during inspection, whether predispatch or upon receipt at final destination, the supplier shall take immediate steps to remedy the deficiency or replace the defective equipment to ensure that all supplies meet with the specifications specified in the contract

## 5.2 Shop Tests

All equipment shall be checked by the Contractor in order to ascertain its correct functioning and shall be witnessed by the Employer's Representative on the basis of approved datasheets, QAP/ITP & drawings (if applicable).

### **5.3** Site Inspection and Tests

During erection, commissioning and trial operation, the Contractor shall organize at suitable intervals all inspections and tests in the presence of the Engineer in order to prove the orderly execution of the work in accordance with the Contract. Unless otherwise specified, all costs for testing at site and of the works and charges associated with it shall be borne by

the Contractor. This includes the measuring devices, properly calibrated, and any pertinent accessories which shall be made available by the Contractor for the entire duration of the tests. The Contractor shall delegate his experts to supervise the tests at site.

Tests to be performed shall include, but not be limited to, the following:

- Checking sensitivity of transducers, water level transmitters, shaft encoders etc.
- Checking of sensitivity of all Equipment.
- Checking of correct functioning and correct calibration of all Equipment.
- Automatic operation of the gates shall be tested "dry" by simulating various reservoir elevations at the level-sensing equipment.

## **Local Control Systems**

It shall consist of complete set of local controls for all equipment near their installation including their Running tests & Overload tests.

All electrical equipment shall be designed for use in a tropical climate. In order to avoid operational errors and accidents, the hoisting equipment of all gates shall be equipped with an electrically operated emergency stop such that all operations of the machine are stopped on pushing of an emergency stop button.

Complete wiring of the electrical equipment and the control device with all cables shall be included, under the scope of Contractor

All such tests and checks shall be performed in the presence of the Employer's Representative. If not satisfied with the performance of the tests and checks, the Employer's Representative shall have the liberty to ask for additional tests or repetition of same. The testing at site shall be complete in every respect to prove the successful performance and operation of all the works and works supplied and erected under the Contract.

## **5.4.** Acceptance Tests

The Bidder will install all the equipment's and will undertake site tests of each gauge and tests for each lot of equipment's included in the Schedule of Requirements. The exact locations for installation by Bidder shall be decided by the Purchaser. After final configuration and programming, the Bidder will conduct an "end-to-end" operational test for each of these stations. A formal check list shall be followed and the results of the tests shall be recorded. The Site Engineer in charge personnel will be trained in conducting the same site acceptance tests. A Site Acceptance Test will be passed if all sensors and RTU/PLC will perform as per the required objective of the SCADA system in the presence of Site Engineer in charge

## **5.5** Operational Test (OT)

Operational Tests shall be conducted at two stages of project implementation. In each case,

any operational problems related to the remote stations are to be fixed before approval can be received for the system OT. The first OT must be conducted immediately after the first lot of remote stations has been installed by the Bidder. All hardware and software components of this real time network have to be tested. The OT will be considered to be successful if all components as a whole have been operating without problems during at least 7 days period.

The second, third, fourth and final OT will be witnessed by the Site Engineer in charge as each lot of stations are completed. Final OT will take place when all the remote stations (PLC/RTU station) system work satisfactorily for a period of one week. The bidder shall demonstrate and document that the system correctly generated 95% of all expected control operations & desired daily & weekly reports for the one-week period. The Bidder will produce a report documenting the quantities of data expected / received and indicating the success / failure of the OT. The OT will be repeated until the 95% success level is achieved.

All equipment failures will be counted except those that can be specifically determined to be "acts of God". Failure of stations due to acts of God (natural disasters or other incidents) will not count against the 95%. Equipment needed for testing shall be provided by the Bidder.

### 5.6 Final Acceptance

When the system has passed the Final OT, the Bidder can apply for Final Acceptance. When Final Acceptance is given & found satisfactory by the Site Engineer in charge the system will be officially considered to be under Warranty.

#### 5.7 Warranty, Operation & Maintenance Period

The Bidder shall provide 5 years warranty & comprehensive operation & maintenance of all equipment supplied, installed and erected for barrage automation from the date of acceptance by Site Engineer in charge after successful commissioning.

During 5 years Warranty Period, the contractor shall ensure quality, performance as per Detailed Technical Specifications and all commitments as per the Contract.

# **Annexure-1**

# **Technical Responsiveness Form**

Technical Specifications as per the Bid document	Technical Specifications as per Bidder
4.0 Technical Specifications of SCADA system & instrumentation	
<b>4.1 Water Level Measuring Systems</b> The bidder shall design, supply and install best quality Level sensors considering the following points.	
<ul> <li>a) Radar type level measuring system shall comprise of Radar level sensor &amp; transmitter, and any other item required for completing the level measurement loop.</li> </ul>	
b) Radar based reservoir / pond level measurement & downstream level of main Barrage & Head regulators. These points are to be selected so that most accurate measurement level is obtained. All accessories along-with cage to avoid theft and Monkey Menace and also proper mounting arrangement (cantilever etc.) of these instruments shall be supplied by the bidder.	
c) The level sensor shall be suitable for flange or thread mounting as required. The installation shall avoid any degradation of instrument performance due to spurious reflections, absorption and condensation. Facilities shall be provided for rejection of spurious reflection.	
d) The radar type level instrument shall have the facility for dampening/ averaging the effect of waves, undulations on the water surface and discriminate the rate of change of levels to provide steady readings.	
e) All necessary instruments, interconnecting wiring, HDPE/GI pipe work, housing, cabling, panel, etc., shall be provided according to the type of equipment proposed to supply in the bid document and accepted in the Contract. Adequate safety measures shall be included in the design of these sensors to negate the effects of disturbances due to turbulence of water levels, strong air currents & electromagnetic waves etc.	
f) The Technical Details of RADAR level Transmitters are as follows:	

Feature	Value		
Make			
Model No.			
Site Conditions	Site Conditions		
Ambient Temperature	From 0°C to +50 °C		
Humidity	5 to 95 % (non condensing)		
Sensor			
Sensor Type	Microwave non-contact sensor		
Range	30 Meters		
Resolution	3 mm or better		
Accuracy	0.02% FSO		
Output Interface	SDI-12/ RS-485/ 4-20 mA		
Power Supply	2 wire type, to be powered from PLC/		
Drotoction	RTU/Datalogger (locally)		
Protection Enclosure	IP67 or better		
Enclosure	Die-cast aluminum or any corrosion resistant metallic enclosure		
Isolation	Circuits shall be galvanically isolated from each		
	other		
Display	Digital Read-out at site LCD/ LED Display		
Manufacturer	Required		
Calibration Certificate	·		
Beam Angle	Less than 12 Degrees		
General Features			
Mounting	The sensor shall be easy to dismount and		
	replace in the event of malfunction		
Tools	Complete tool-kit for operation and routine maintenance		
Manuals	Full documentation and maintenance manual in		
	English		
Accessories	Sensor mounting support with proper HDPE/ GI pipe conduiting, cables and other accessories as required		
Mounting/ Installation	Above FRL, below bridge girder wherever		
Arrangements	available otherwise horizontal cantilever		
	arrangement from a mast/ wall/ pedestal to be provided		
Radar Sensor should	have inbuilt diagnostic feature and averaging		
function	nave inbant diagnostic reature and averaging		

# 4.2 Gate Position Measuring System

Suitable sensors shall be provided for exact measurement & indication of position of spillway radial gates, intake gates & silt flushing gates. These sensors shall be equipped with suitable shaft couplings and electronic circuits to transmit the signals to the SCADA System via remote PLC/RTU for indication in BCR & for further processing. All sensors are to be mounted in the outdoor locations. Hence, suitable protection class of the enclosures shall be ensured. Minimum IP65 protection class shall be provided. Suitable safe & reliable

arrangements of coupling with the lifting motors of gates shall be provided. It shall be ensured that there is no slippage between the motor shaft & the transducers. The bidder shall provide the gate sensors with following minimum specifications

Feature	Value		
Make			
Model no.			
	Site Conditions		
Ambient Temperature	From 0 °C to +50°C		
Humidity	5 to 95 % (non-condensing)		
Sensor			
	Shaft Encoder based rotary position sensor with		
Sensor Type	minimum 4" Digital Display		
Range	1-20 meters		
Resolution	3 mm or better for gate position		
Accuracy	0.025 % FSO		
	SDI-12 / RS 485 / 4-20 mA compatible to		
Output Interface	PLC/RTU		
Power Supply	2 wire type, to be powered by RTU/PLC		
General Features			
	Corrosion Resistance Metal (Stainless steel or		
Material	Aluminum)		
	Lockable (key) box provided by the supplier to		
	be mounted on sensor, with IP65 or better		
Enclosure	protection		
	Complete tool kit for operation and routine		
Tools	maintenance		
	Full Documentation and maintenance manual in		
Manuals	English		
	Wiring from sensor to RTU/PLC must be through		
NA a continue	HDPE/ GI Pipe Conduiting or flexible metallic		
Mounting	conduiting as applicable		
Display	Read out LCD / LED Display		
Process connections	Through suitable coupling		
	Required		
   Manufacturer's			
Calibration Certificate			
Cambration Certificate			

## 4.3 Automatic weather stations at BCR

The Automatic weather station shall be placed at Barrage which shall be connected to Main PLC controller placed in BCR. The Automatic weather station shall be provided with following minimum specifications.

Feature	Value	
Make		

Model No.		
Site Conditions		
Ambient Temperature	From 0 to +50 Degree C	
Humidity	5 to 95 % ( non-condensing)	
Altitude	0 to 2500 meter	
Automatic Rain	0 to 2500 fileter	
gauge		
Sensor Type	Tipping Bucket type with reed switch	
Range	250 mm/h or better	
Resolution	0.5 mm or better	
Accuracy (Intensity)	2% or better, ± 2 mm	
Output Interface	SDI12/ RS 485 / 4-20 mA/Switch closure output	
Output Interface	Corrosion Resistance Metal (Stainless steel/	
Material	Aluminum)	
Enclosure	NEMA 4 or IP65	
Certification	IMD/ WMO certification shall be provided.	
Certification		
Protection	Bidder shall provide spout filter and bird cage to prevent ingress of insects and debris	
	prevent nigress of insects and debtis	
Air Temperature Sensor		
Sensor Type	Platinum resistance or better or equivalent	
Range	0 to 50 Degree Celsius	
Resolution	±0.1°C	
Accuracy (Intensity)	Within ±0.2°C in the entire working range	
Response Time	10 secs or lesser	
Relative Humidity	10 secs of fesser	
Sensor		
Sensor Type	Capacitive/ Solid State Humidity Sensor	
Range	0 to 100 %	
Resolution	1%	
Accuracy	±3% or better	
Power Supply	To be powered by PLC Located at BCR	
Response time	10 secs or lesser	
Wind Speed and	To sees of fesser	
Direction Sensor		
Sensor Type	Ultrasonic sensor (No moving Parts)	
Range	0-60 m/s for speed and 0–359 degrees for direction	
Resolution	0.1m/s for Speed; ±1 degree for Direction	
	$\pm 0.5$ m/s or better for wind speed; $\pm 5^{\circ}$ or better for	
Accuracy	wind direction	
,		
D .:	T 4 1 11 2	
Response time	Less than 1 second lag in operating range	
	All accessories for mounting the instrument e.g.	
3.6	special cross arm clamps or flag if any shall be	
Mounting	provided.	
Air Pressure Sensor		

Sensor Type	Temperature Compensated	
Range	600 to 1100 hPa	
Resolution	± 0.1 hPa	
Accuracy	±0.2hPa	
Power Supply	To be powered by PLC Located at BCR	
<b>Solar Radiation Sensor</b>		
Sensor Type	Silicon Pyranometer	
Threshold	120 W/m2 of direct solar irradiance	
	Alternate shading of sensor to account for sky	
	radiation or sunshine duration shall be computed in	
Methodology	PLC/SCADA system	
Spectral Range	400nm to 1100 nm	
Range	0-2000 W/Square meter	
Resolution	1 W/Square meter	
Accuracy (Including		
Temperature		
Compensation)	3% or better	
General Features		
Output Interface	SDI12/ RS 485 / 4-20 mA/Switch closure output	
Power Supply	To be powered by PLC/RTU	
	Corrosion Resistance Metal (Stainless steel/	
Material	Aluminum)	
Enclosure	NEMA 4 or IP65	
	Complete tool kit for operation and routine	
Tools	maintenance	
	Full Documentation and maintenance manual in	
Manuals	English	
	Sensor Mounting support, cables and other	
Accessories	accessories as required	
Certification	IMD/ WMO certification shall be provided.	

## 4.4 Surveillance System

Primary Purpose of Surveillance system is to view gate movement from Control room. Operator should be able to see that the gates moves up/down or stop when the appropriate command is given.

Bullet cameras IP based shall be placed to monitor the position of all the gates & PTZ cameras shall be installed on the main barrage in a way to ensure the complete monitoring of the Barrage. The same shall be connected with NVR (Network Video Recorder) which shall have a memory of at least 30 days. Cameras shall be connected to internet, to have its accessibility from farthest point through IP address.

The cameras shall have a provision of connecting with NVR through hardwiring using video cable (RG-6 coaxial cable)/OFC and simultaneously through wireless connectivity

The following minimum features shall be available in CCTV system

The following minimum features shall be available in Cell v system			
Make & Model No.			
i) Bullet Camera (Fixed Type)- IP based Night Vision (I.R.) Out door			
Weather Resistant, 2 Mega Pixel,72 LED Color Camera.6 or 8 or 12 MM			
(According to site suitability) 2 MP Auto Iris Lens in Elegant Metal Die Cast			

Housing. Outdoor wea	ther resistant IP 66.	
Make & Model no.		
(DIGITAL) Sensor, 500 r	36 X Optical and 12 X Digital Zoom; 2 Mega Pixel IP mtrs. Night Vision (Multiple Intelligent Array system) t Outdoor Metallic Housing.	
Make & Model no.		
Full HD, Real time Reco With HDD. Remote View App Xmeye /CMS softwa	RK VIDEO RECORDER (NVR) 32 Channel 1080 P ording and Reviewing in H.264 Compression Format. wing Capability thru Internet /Android /Apple /Mobile are with password protection & user name.	
Medium Grade Pipe of St	g arrangement like MS/ GI Poles 4/6/8 1nch Día - candard Make with suitable length along with junction s per the suitability shall be provided by the bidder for tem.	
4.5 Data Logger wit	th 2 channel Inputs	
The datalogger with bidder at Remote	h 2 channel input shall be provided by monitoring stations for data logging & eal time basis with following minimum	
Feature	Value	
Make		
Model No.		
<b>Site Conditions</b>		
Ambient Temperature	From 0 to +50 Degree C	
Humidity	5 to 95 % (non condensing)	
Sensor Interface		
	2 channels, compatible with outputs of sensors as	
Input type	specified in BOQ	
Input type Input - Output Interface	specified in BOQ	
* **	specified in BOQ	
Input - Output Interface	specified in BOQ  S  USB stick option for Data transfer One Serial Port (RS232) for communication with Laptop for programming	
Input - Output Interface Data Transfer  Port for Configuration  Port for Telemetry	specified in BOQ  S  USB stick option for Data transfer One Serial Port (RS232) for communication with	
Input - Output Interface Data Transfer  Port for Configuration	specified in BOQ  SUSB stick option for Data transfer  One Serial Port (RS232) for communication with Laptop for programming  1 Ports for Communication with Telemetry (GPRS/GSM) device	
Input - Output Interface Data Transfer  Port for Configuration  Port for Telemetry	specified in BOQ  S  USB stick option for Data transfer One Serial Port (RS232) for communication with Laptop for programming  1 Ports for Communication with Telemetry	

Licenses	All required licenses shall be included	
<b>Analog to Digital Converte</b>	·	
Resolution	16 bit or better	
Sample intervals	1 Sec to 24 hours (user scalable)	
General Features		
Flash memory	Minimum 1GB Non-volatile Flash memory that can store one year of data and shall be expandable	
Resolution	A/D resolution ≥16 bit	
Firmware Operating	Multi-tasking operating system - must log data and	
System	transmit at same time	
	Inbuilt Digital Display for viewing current data	
Display	and setting values	
D 0 1	Shall be powered by solar Power supply to be	
Power Supply	provided by bidder	
Battery Voltage	Monitoring of battery voltage level	
T , 11	Internal battery backup for clock, lithium battery,	
Internal battery	storage 2 years	
Charge Controller	Internal or External	
User Permissions	Different user levels, system of user rights / passwords, access restricted to authorized personnel	
C SCI T CITIISSIONS	For displaying or transferring data to memory	
Keypad	stick, configuration of data logger and sensors	
Real time clock	GPS synchronized	
	for wall-mounting in a shelter / enclosure with	
Enclosure	IP65 protection or better	
Accessories	Serial cable + adaptor. All accessories (fixing units, etc.) as required	
Tools	complete tool kit for installation and routine maintenance giving full detail (number of pieces and type)	
	full documentation and maintenance instructions in	
Manuals	English (1 copy per station).	
GPRS MODEM	F	
Operating Temperature	From 0 to +50 Degree C	
Performance	Data Reception availability of 95% or better	
Form factor	The GSM /GPRS modem should either be integral part of data logger specified above, or it should be supplied as independent unit compatible with supplied data logger	
Specific Features	00-4	
Communication Direction	Utilize network for two-way TCP/IP (INTERNET) connection and SMS	
Transmission trigger	Data collection to be triggered by interrogation from	
2	Data Center, or by event-based transmission triggered by remote site	
Power Saving	Ability to disable interrogation system in order to save power at remote site	

Communication Protocol	Data transmission to execute HTTP Post, FTP, SMS to	
	transmit and receiving data to the Data Center	
Accessories	All associated equipment, including Antenna all cables	
	and mounting hardware	
Antenna features		
Frequency range	900 MHz: 824-960 MHz/1800MHz:1710-1880 MHz,	
	4G and better	
Radiation	Omni-directional	
Operating temperature	0 to + 50 degrees Celsius	
Connector	SMA or suitable RF connector adaptable to GSM/GPRS	
	modem	
Cable length	As required at site	

## 4.6 Remote PLC/RTU:

## Make

#### Model No.

CE/UL approved manufacturer's Remote Terminal Unit/Programmable Logic Controller (RTU/PLC) in IP54 enclosure having modular PLC/RTU (Plug and play type) for control & monitoring with Modular Controller and should have modular communication. The PLC should be able to communicate to the master controller on an open protocol such as Profibus / Modbus over ethernet TCP/IP using OFC cable & bidder shall provide the memory map of the same for III party etc. simultaneously the remote PLC/RTU shall be able to communicate with BCR via GPRS based wireless technology in order to create redundancy in telemetry to avoid loss of communication & Data. It should be possible to view the reports of SCADA system without requiring any software, from any PC, using web-based protocols. Data logs should be stored inside the CPU and should be downloadable in CSV format. It should be possible to increase the I/O handling capacity of the PLC/RTU, without changing the CPU. Maximum number of gates that shall be controlled by a single PLC/RTU shall be 4. The remote PLC/RTU shall communicate to the central monitoring station on Optical Fibre Cable. It should be possible to remotely program the PLC/RTU from the control room. Each CPU shall be shall be tested to work in a temperature range of 0 to +50 degree Celsius. The CPU shall have integrated non-volatile memory capacity of not less than 1MB & expandable memory up to 4MB using memory card. All must be complied with IEC-611131-03 and IEC 61158(4-20Amp). Suitable industrial grade AC to DC Power Supplies shall be mounted inside each PLC/RTU. Each PLC/RTU shall have separate power supplies for electronics and field. Surge Protection Device shall be provided inside each PLC/RTU, to safeguard against transient & lightening surges.

- iii) Industrial grade Fibre Optic convertor shall be housed in each PLC/RTU for optical communication between PLC/RTU & central controller. Each PLC/RTU shall have integrated GPRS modem for wireless based communication with BCR.
- iv) Each PLC/RTU shall also be integrated with up to 4 no. digital drive starters panel and capable of operation at up to 50 degrees Celsius. The PLC/RTU

equipment shall be housed in a properly sized, weather-proof panel and must be protected with lightening & surge arrestor.

The PLC/RTU shall be designed as per following specifications

## A. Panel in Climatic Conditions:

The panel shall be fitted with two cooling Fan with filters, and protection, for better control of internal temperature. The individual cooling fans shall be controlled /switched ON/OFF by the PLC/RTU according to the application requirement.

# B. Temperature Monitoring

The PLC panel shall be fitted with the temperature sensor/thermostat and shall be connected to the monitoring system. The monitoring system shall continuously monitor the panel temperature, and if it exceeds the set value, it shall automatically switch ON the cooling Fan's. The cooling

FAN shall be Switched OFF after the temperature of the panel is brought back to normal level.

In case of Emergency Sequence of power back-up, the cooling FAN shall be switched OFF to save the power.

The PLC/RTU shall be capable of monitoring and controlling the temperature inside the panel and shall transmit the following information to the central control room.

- i. Panel temperature
- ii. Status of cooling Fan's

#### C. Power Supply Scheme

Protection shall be provided in the input side of the mains power supply as follows:

## i) Input mains Fault Protection MPCB:

The proposed system mains power supply fault level protection shall be 100kA. The mains input shall be protected using MPCB (with adjustable current limiting) and auxiliary signaling contact. Auxiliary signaling contacts shall monitor the Healthy/Trip condition of the MPCB. The signaling contact status information shall be updated in the control room.

PLC can be provided with Isolation transformer for 415 to 230 Vac. Also, the relay board/contactor switches to be installed for acquiring the status of electrical parameters shall be from reputable manufacturers with better standability against voltage fluctuations.

## ii)Control Voltage:

Control Voltage: The proposed PLC/RTU system control power supply voltage shall be 24V-48VDC and the same shall be derived with the use of SMPS Power Supply Unit. The SMPS input power shall be protected with suitable MCB. The power to the input of the SMPS shall be switched ON/OFF from the PLC through Auxiliary relay contact. The panel control switch gear, PLC unit, Communication unit, HMI Screen Panel, indication lamp, hooter, instruments, Auxiliary Relays, Signal

Conditioners/isolators, etc shall be energized by control voltage of 24V -48V DC. D. Power Supply On/Off All the field instruments integrated with each remote PLC/RTU, shall be connected to the single power supply bus and energized with the control voltage supply of 24V-48 VDC. The PLC/RTU according to the application program (periodically) shall switch OFF the control voltage supply via the DC contactor, and Switch ON the control voltage supply after a programmable time delay by actuating the DC Power contactor and the use of programmable mechanical/electrical timer switch gear unit automatically to clear the memory and other floating memory locations errors, warning, faults, etc. Ultimately it shall Reset (Power-ON-Reset) the PLC/RTU. The Power Supply ON/OFF function command shall be activated manually locally, or from the remote central control room PLC and/or through timer fitted in PLC. The event shall be recorded in the database and suitable reporting system shall be implemented. **E. GPRS Communication Network** The proposed Intelligent GPRS communication unit shall have GPRS communication network capability. Reliable Integration: The modem should be tightly integrated with the PLC/RTU network. Failure of Global System for Mobile Communications: The PLC/RTU should store data in buffer memory of at least 2MB if unable to transfer due to maintenance of Global Packet Radio Service of the service provider or power failure in the cell towers etc. Data shall be transferred to central location in secure manner, i.e. No data loss in case of no connectivity. F. PLC / RTU: The PLC should have inbuilt RTU functionality with a support for USB/RS 485/RS232/Ethernet port Modem connection. The PLC/RTUs shall have minimum communication ports as follows: i) Two Ethernet ports for connectivity to Master Station ii) 1x RS232 ports for the PLC/RTU maintenance and configuration terminal. It shall be possible to increase the number of communication ports in the PLC/RTU by addition of cards, if required in future. v) PLC/RTU shall be designed with cyber security features based on IEC 62443-4-1 & shall have international certification (for ex. certification Level II or equivalent). vi)The access to the Server shall be restricted with passwords both at Windows level and at Application Level. Also, all the data should be stored in a separate file system which can be independently accessed by the Remote Network without disturbing the PLC/RTU operation and thereby maximizing

the cyber security.	
v) The PLC/RTU should support for follow minimum features:	
• Should have the facility for the Force Simulation	
• Facility of Forcing Input /output variables when the physical devices are not functional	
• Should have user access with pass word protection	
<ul> <li>Should have the facility to program the PLC/RTU for all the different phases</li> <li>a) Startup phase</li> <li>b) Normal operation phase</li> <li>c) Shut down phase</li> </ul>	
• The PLC based SCADA system should have the facility of the Web Server, the same shall be audited by NIC & hosted by NIC server in order to minimize the cyber security issues.	
• The PLC/RTU should support firmware upgrades through network.	
The PLC/RTU should have facility of storing intermediate variables	
• Program protection feature, network filter setup, Operation log function, function removal feature should be available	
• User authentication, user-based operation restriction, and CPU operation restriction should be available.	
• The CPU should be fast enough and capable of multi-tasking capabilities like running various tasks at different programmable cycle times.	
• The CPU should have minimum 1MB RAM to cater to current and future program additions.	
• The PLC/RTU shall support all the file operating functions so that CSV file log can be stored in the basic CPU memory/buffer memory of GPRS modem for maintaining the log in case of network connection failure.	
• The PLC /RTU shall be designed to a modular concept, with separate modules for each function. The modules shall be rack mounted and may be quickly exchanged for field repair. It shall not be necessary to remove field wiring in order to exchange a module. The PLC/RTU shall support a wide range of input /output signals including status inputs, pulse (accumulator) inputs, analogue inputs, analogue outputs, and control outputs. The PLC/RTU shall support any combination of the above I/O points.	

• It shall be possible to add PLC/RTU's and software enhancements in the future, without taking the system out of service. The design and physical layout of the PLC/RTU equipment shall be on a modular basis, so that extra facilities, such as an increase in the number of status points or analogues, may be added with minimum of disturbance.	
• The PLC/RTU shall be expandable by simply adding I/O modules to the system bus. Other than user-friendly configuration of the new modules, no additional PLC/RTU software or firmware shall be required.	
• The operational status of the PLC/RTU shall be indicated on the front panel of the processor module by means of LED lamps. In addition, each I/O card shall have LED status indication.	
Modbus TCP/IP on Ethernet /Profibus (IEEE 802-3) communication shall be provided for PLC/RTU network interconnection towards Master station.	
SCADA System is to be capable for configuring and programming of PLC/RTU remotely, from Control room.	
G. Microprocessor /Microcontroller Module (CPU)	
• Built-in minimum 1 MB RAM should be available for storing Data and log records as files. Memory Card of minimum 4 MB is supported for storing data, programs and log records as files Built-in Ethernet port should be available;	
• In addition to normal scanning, CPU module should have an independent multiple constant scan function capable of a maximum scan speed i.e fast response should also be achievable.	
<ul> <li>CPU should have a compact body</li> <li>CPU should have facility to be programmed in minimum 4 different languages like Ladder, Function Block, Sequential Flow Chart, Instruction List</li> </ul>	
<ul> <li>Large-capacity programs and large device sizes should be supported to cope with advanced, complex control applications</li> </ul>	
A rich set of functions should be provided to facilitate program debugging and maintenance. For example, a forced SET/RESET function independent of program processing results.	
PLC/RTU shall employ solid-state technology and use an industrial standard, suitable for operation in an aggressive environment with high levels of temperature, humidity and dust being common. It shall operate correctly up to a temperature of 50 degrees Celsius and up to 95% non-condensing humidity.	
<ul> <li>On-board battery backed Real Time Clock (RTC) is required. The RTC will operate on the battery power even when the main power is</li> </ul>	

	lost.	
-	The PLC shall have a separate watchdog circuit independent from the main	
	processor, which will reset the system if the firmware program fails in any way. The watchdog circuit shall be capable of being enabled or disabled by means of a jumper or by software.	
Н.	Communications Interfaces	
•	Communication interfaces shall correspond communications between the central PLC and distributed PLC/RTU units, via hardwired OFC cable and GPRS wireless technology.	
•	Adequate number of process Bus (Profibus/Modbus over ethernet TCP/IP) Communication Ports shall be configured for communication interfacing to intelligent Instrumentation. Serial communication RS232 Port/Ethernet for local laptop connection shall be available as well.	
•	The RTU/PLC at gates shall be communicating to BCR primarily through Optical Fiber Cable (OFC). It should possible to remotely program RTU/PLC from the control room. Industrial grade optical fiber convertor shall be housed in each RTU/PLC at gates for optical communication between RTU/PLC and central controller.	
1. 1	PLC/RTU I/O Facilities	
a)	General	
•	PLC analogue and digital inputs and outputs shall meet the requirements of test voltage of class II of IEC 255-4 appendix E.	
•	The PLCs should be of modular structure, equipped with separate I/O modules foreach type of I/O signals, as follows.	
b)	Analogue Inputs	
•	Analogue inputs shall be capable of accepting current signals of, (4-20) mA, with overrange capabilities and support for 2/4 wire communications.	
•	All components used in measuring circuits that affect accuracy shall be of high stability and low temperature coefficient.	
•	A/D conversion shall be provided on each analogue module. The module scan cycle shall be rapid so as to satisfy the overall analogue response time specified to the master workstations.	
•	It shall be possible by means of the PLC/RTU configuring software, to modify the signal dead-band, so that fluctuating signals are not continuously reported to the Master Station.	

### c) Digital Inputs Digital input modules shall be optically isolated. Digital filtering to suppress contact bounce shall be provided. In addition, software filtering of two successive cycles shall enable confirmation of state. To reduce data transmission, time tagging shall be selectively applied. Only some inputs shall be time tagged at the PLC/RTU, but other inputs shall be time tagged on arrival at the Master Station. d) Digital Outputs • The digital output modules shall support isolated outputs in, latched and BCD mode. Individual LEDs will indicate the status of each output. The outputs shall be isolated to at least 500VDC Controls transmitted between the control station and the PLC/RTU shall comprise a select, check-back, execute sequence (or other means of providing high message security). On receipt of a select message, the PLC shall prepare to operate the output relay, and then return confirmation of correct selection of the relay to the Control Station. This signal shall be obtained as far as possible and shall be generated locally, not derived from the incoming signal. On receipt of the execute command, the output relay shall operate and confirmation of execution shall be returned to the SCADA Control Station. • Not more than one digital output shall be possible at a time. Selection of two or more contacts simultaneously or in quick succession without one having been completed, shall result in cancellation of both requests and return an alarm to the Master Station. • Software interlocking schemes shall be applied with reference to process requirements. e) Analog Outputs • The PLC shall support analogue set point outputs. These may be used to issue controls directly to controllers, or to drive displays. • Analogue outputs shall generate (4-20) mA DC output signals into a minimum load of 500 Ohms at a nominal operating voltage of 24V DC. Simultaneous operation of individual digital outputs shall be provided, where this facility is required. Set point outputs shall provide the security to ensure that false selection of controls is minimized, similar to individual digital outputs. f. Dummy Control

To provide test facilities, a remote dummy control shall be provided. The dummy controls and associated status indications shall be allocated with discrete addresses and operate as if they are real equipment. To set up a dummy control a PLC with dummy control set up for training of operational staff shall be provided. J. PLC/RTU Operation Features a) Operation with Control Station • PLCs shall have their own unique address and not transmit information to the Control Station without the request. In order to reduce communications channel load, PLCs/RTU shall incorporate data transmission reduction methods. PLC/RTU shall reply to each interrogation on a "Report-byexception" basis with the Control Station, also being fully updated on a regular basis. Digital input data shall only be transmitted when the status has changed since the last pool interrogation. Analog values shall be transmitted when a defined percentage change occurs from the last transmitted value. Each PLC/RTU reply shall automatically include the verification of the address in the response Full details of the management of digital and analogue data input shall be submitted for approval. • PLC/RTU's shall be also available to be polled at any time from the Control Station, either on a periodic basis or on operator command. In case of polling, all inputs may be scanned. • Control messages from the Control Station, shall be capable of being initiated at any time to control the barrage, and shall have priority over all other messages. b) Automatic Restart Following power interruption and /or communications failure, the PLC/RTU shall be arranged to restart automatically. This may be accomplished by retaining memory in non-volatile store. K. Local HMI Facilities The remote PLC/RTU system shall be equipped with adequate operator panel to enable monitoring and control for the operator at the barrage level. The operator panel shall be preferably accomplished by means of LED/LCD backlit display of 7 inches or above at Local Control Stations & 12" at Central PLC. The graphical LED/LCD should be easily detachable such that its failure does not affect the PLC/RTU functionality. L. PLC Programming

• PLCs shall be reconfigurable from either a programming device /laptop, or remotely over the the control station.	· · · · · · · · · · · · · · · · · · ·
• Configuration changes shall be protected by download & reconfiguring of PLC/RTU softwarequired.	
<ul> <li>User-friendly designed PLC/RTU programming 61131-3 programming languages shall be include software. For local process control, the PLC shaprogramming standard, according to IEC 611 programming methodologies:</li> </ul>	led in the set of engineering nall support open PLC/RTU
Ladder Diagram (LD)     Function Block Diagrams (EBD)	
<ul><li>Function Block Diagrams (FBD)</li><li>Instruction List (IL)</li></ul>	
Structured Text (ST)	
Sequential Function Charts (SFC)	
<ul> <li>PLC/RTU application software shall be installed memory data area, in order to ensure sufficient?</li> </ul>	
The PLC memory shall be sized to ensure it is r	
and that maximum occupancy does not sig	
computing functions.	
M. PLC/RTU Process Operation	
PLC/RTU shall be enabled for effective SCADA	monitoring, control and data
transfer with control station, as well as for local	PLC /RTU level closed loop
process control, control logic and other local auto	
The PLCs shall be controlled by applications applied of the following minimum functions:	ation software making it
<ul><li>capable of the following minimum functions:</li><li>Command outputs</li></ul>	
Select before operate feature	
Digital filter	
<ul> <li>Adjustable chatter frequency</li> </ul>	
Time-tagging of events	
<ul> <li>Alarm handling</li> <li>The PLC shall be of Industrial grade with the IEO</li> </ul>	C Cortifications
The PLC shall be of industrial grade with the IEV	C Certifications
4.7 1KVA UPS for each remote RTU/PLC as	a power back up
1 KVA Ups shall be installed in each Local	
provide a power back up of minimum 2 ho	urs, with following
minimum specifications:	
Make & Model No.	
Features	Value
Capacity	1000VA / 600W

Voltage Range	140VAC-290VAC	
Compact Size	YES	
•	YES	
Boost and buck AVR for voltage stabilization Auto restart while AC is recovering	YES	
Simulated sine wave	Modified sine wave	
	YES	
Off-Mode charging & Cold start function INPUT-	1123	
	230Vac	
Nominal Voltage Frequency Range	50Hz	
OUTPUT-	5UHZ	
	2201/40 + 400/	
AC Voltage Regulation (Batt. Mode)	230VAC ± 10%	
AC Mains Frequency (Batt. Mode)	50Hz ± 1%	
Transfer Time	Typical 4-8ms	
Waveform (Batt. Mode)	Modified sinewave	
BATTERY-	140)//741 0	
Battery Type	12V/ 7Ah x2	
Minimum Backup Time	2 Hour	
Typical Recharge Time	Shall be less than 8	
	hours up to 90%	
	capacity	
INDICATORS-		
Battery Mode	Yellow flashing	
AC Mode	Green lighting	
ALARM-	1	
Battery Mode	Sounding every 1	
	minute	
Low Battery	Sounding every second	
Overload	Sounding every 1	
	second	
Fault	Continuously Sounding	
Output Sockets	India output	
ENVIRONMENT-		
Humidity	0-90% RH @ 0-40degC	
	(non-condensing)	
40 DTU/DI 0 E   1   1   1   1   1   1   1   1   1		
4.8 RTU/PLC Enclosures / Housing boxes	or protection protocol of	
IP54 and above		
A. Enclosure for PLC/RTU		
<ul> <li>Factory fabricated to requirements, lockab supporting.</li> </ul>	ie doors, dead-front, self-	
Cabinets shall consist of a rigid self-support of not lighter than 2 mm thick, cold rolled steel, braced rigidly where required with stand doors shall be constructed of the samaterial as the housing. Housings, including show no evidence of warping, weaving, or expense.	d, stretcher levelled sheet cructural members. Panels ame weight and type of g doors and panels, shall	
of installations.		

• All cable entry in to the panel shall be form bottom using cable glands	
of adequate size.	
The panel shall be provided with forced fan cooling system as a standard	
<ul> <li>The internal panel layout must be designed considering proper approach to the PLC/RTU, instruments, relays, terminals and other accessories for maintenance</li> </ul>	
• The Cubicles should be in sheet steel construction, free floor mounting with front and back access. The doors and side covers should be of 2-mm thick sheet and all load-bearing members are 2 mm thick.	
Arrange doors with minimum 90-105 degrees open position and with stops. Construct doors so that they neither weave nor warp; provide stiffening members where necessary to ensure rigidity.	
<ul> <li>Provide ample duct space for adding and removing wiring from the top.</li> </ul>	
Dimensions – As per site requirement & as approved by Engineer-in- charge	
Lock System: Slam lock /Screw Fixed - with common key or unique key	
The cabin shall be provided with power distribution units with sufficient number of sockets to provide power to equipment's hosted inside the cabin.	
Provide channel base for mounting.	
B. Equipment Arrangement:	
Wiring ducts to provide easy access for inspection and maintenance.	
<ul> <li>Design and arrange ducts and terminal blocks to accommodate bottom entry to cabinet for control, alarm, status, power, and instrumentation cables, as required.</li> </ul>	
C. Ground Bus	
<ul> <li>Provide continuous copper bar ground bus, size not less than 6 mm by 25 mm along the full length at the rear of the panel.</li> </ul>	
D. Nameplates	
• Engraved 20-gauge metal/baked enamel or phenol plastic, black background/white letters, drilled for screw mounting with round head screws.	
<ul> <li>Provide nameplates for all equipment, instruments, power supplies, relays, circuit breakers, fuses and other devices furnished and mounted in the cabinet. Provide nameplates for each device on panel interior door.</li> </ul>	
• Submit size, type, and wording for Authorities approval. All nameplates shall be in English.	
E. Terminal blocks	
Terminal blocks for switchboard control wiring shall be rack mounted/	
screw clamp type.	
• Provide white or other light-colored markers to the terminal block, for terminal designations.	

- Make no more than two connections at each terminal point.
- Confine switchboard internal wiring to one side only of the terminal block. The other side shall be reserved for incoming leads.
- Twenty percent of terminal points in each panel section shall have no connections and shall be designated as spare terminals.
- Form control wire bundles without sharp bends and support adequately.

### F. Indicating Lamps

The indicating lamp assemblies shall be a heavy-duty type with color caps. Indicating lamps shall be suitable for AC/DC power supplies, utilizing long life incandescent type lamps.

### **G.** Lighted Pushbuttons

Each lighted pushbutton shall be mechanically interlocked, illuminated type. Lighted buttons shall be the recessed guarded type to preclude inadvertent operation. Gate control lighted pushbuttons shall be furnished with a flasher so the lamps will blink at a 1-second on and off rate when the maintained pushbutton is operated.

### **H. Push Buttons**

Each unit shall be a maintained contact type. Pushbuttons shall be the recessed guarded type to preclude inadvertent operation.

### I. Relays / contractor

**Auxiliary relays**: The auxiliary relays shall be in accordance with IS standards and shall be industrial type. The relays shall have convertible contacts and shall be self-resetting. A minimum of two spare contacts shall be furnished on each relay.

### J. Special Tools

The bidder shall furnish any special tools that may be required to allow proper connections of wiring to devices and all terminal blocks.

#### K. Surface Finish

Cabinet has to be Nano-Ceramic/Epoxy Powder coated with RAL 7035 after proper pretreatment as per the best industry practice with thickness 80 to 120 Microns.

### L. Test Procedure

After the cabinets are completely assembled and wired, perform the following tests and procedures.

- Dielectric test on all circuits in accordance with standard test requirements. Instruments or other devices that cannot withstand test voltage shall be disconnected.
- Circuit continuity test to verify connections.
- Functional tests of all control switches and indicating lamps.
- Verify operation of Operator Interface Unit on cabinets.
- Temperatures testing to ensure that operational temperature of all equipment's are maintained

#### 4.9 VFD Starter Panels

### Make & Model No.

3Phase VFD Starter panel shall consists of S.P.P, MCB, OLR, Timer, Main

Switches of reputed makes including wiring and Electronic Digital Indicator etc.

The control module must be able to drive motors with the following control modes: linear, parabolic and parameterizable V/f characteristic, V/f characteristic with forward/reverse current control, linear and parabolic V/f characteristics with eco mode for additional power saving, vector control without sensor, torque control without sensor. The drive system must be protected through thermal motor protection, thermal converter protection, monitoring for under voltage and overvoltage, overloading, grounding, short circuiting, stalling and blocking of the motor. All digital and analogue inputs and outputs must be freely parameterizable and assigned to a specific function in the factory setting.

To parameterize the drive, an integrated USB interface for PC/Laptop connection is needed, saving and loading parameter records and firmware updates must be possible by a memory card. The terminals have to be identified by replaceable labelling strips for individual marking.

### 4.10 Equipment's at BCR

Hardware at BCR shall be provided by bidder which will mainly comprise of following major items:

- a) Main Server and Server as Workstation (operating Station)
- b) Necessary data switch, router, Static IP, and fire wall for System
- c) 3KVA online UPS with 4 hours backup time
- d) External memory for data storage of 8TB for 5 years.
- e) A3 size Color printer
- f) 110" LED display/video wall/(70",2X1) DLP based system
- g) Master PLC Controller

### 4.11 Central Control Panel (Main PLC Controller at BCR)

#### Make & Model no.

The central controller shall be based on modular PLC with firm ware based hot redundancy. Main and Redundant CPU shall be mounted in two separate racks. Event-driven synchronization method shall be provided for fast and bump less changeover to the redundant CPU in the event of a fault, without any loss of information and control. When a CPU is replaced, all the current programs and data are automatically to be synchronized by master CPU with standby CPU. The central PLC controller & SCADA shall be of the same make/manufacturer as the PLC/RTU controller in the remote station. The central controller & the PLC/RTUs shall be able to exchange data with each other freely & seamlessly, without requirement of any intervening hardware, apart from Optical convertors. The central controller shall have a 12" HMI colored screen for indicating the diagnostic & other information. It should be possible to view detailed

information	by	using	buttons	on	the	screen,	to	drill-down	to	the	appropriate
page.											

The remote PLC/RTU shall pass-on all the I/O information directly to the central controller, and shall act as a slave.

The controller should be able to communicate over an open protocol such as Profibus / Modbus over ethernet TCP/IP and GPRS wireless technology etc. The communication should be integrated in the CPU and should not require any additional cards or gateways. It should be possible to view, control & troubleshoot the PLC without requiring any additional software apart from SCADA software. Data logs should be stored inside the CPU and should be downloadable in CSV format using a web browser. It should be possible to increase the I/O handling capacity of the PLC, without changing the CPU, by the addition of appropriate I/O cards. The central controller should have a non-volatile memory of at least 4 MB & with 16 MB RAM memory card and should be tested for operation from region to region change in temperature range of 0 to 50 degrees Celsius. The central controller shall have high immunity to electromagnetic interference according to IEC 61000-6-2 and vibrations according to EN 60068-2-6.

### 4. 12 Computer Servers

Server shall be industrial grade PC with USB, RS232/RS485, Ethernet Ports, OS Windows 8 or higher compatible to SCADA System. BCR shall have Master server with SCADA Software.

110" LED display/ (70", 2X1) DLP based System/video wall Unit to be connected to server with separate USB Port/ Ethernet Port.

There will be two servers with monitors required (one as work station), with the Master Controller (PLC) placed at the BCR. These Computer servers are expected to operate the SCADA software as well as all software required for the project. The computer servers will be managed and operated by the successful bidder and his skilled trained experienced operators/engineers till the end of 5 years warranty period. The minimum specifications for the servers are given in Table below:

Features	Value	
Make & Model no.		
Form Factor	Rack Mount Server	
Processor	Intel XEON ES-2440 or higher compatible configuration	
DIMM Memory	Speed: 1600MT/s RDIMMS or higher compatible configuration, 8GB RDIMM, 1600MT/s, Low Volt, Dual Rank or higher compatible configuration	
Hard Drive	RAID 5 Software or Hardware Controller compatible 5-1TB 7.2K RPM Near-Line SAS 6Gbps 2.5in Hot-plug Hard Drive or higher	

	compatible configuration	
Network Adapter	2 GB or higher compatible	
Power Supply	Dual, Hot-plug, Redundant Power Supply/Solar Power and battery backup as compatible configuration	
Electrical Supply	220V AC and supply from AC distribution, DC of DG Set	
Devices	Soft touch Keyboard, Optical Mouse, Monitor	
	(23" TFT)	
	110" LED screen (combination of more than one permitted) monitors/Video Wall/(70", 2X1) DLP based.	
Software	SCADA compatible as per specification and OS Windows 8 or higher compatible.	
Additional Memory Rack	Additional memory Rack of minimum 8TB that shall be suitable for data logging for a period of at least 5 years.	
Accessories	Power Cord, Rack Rail with cable management system  Power Points as needed	
Computer Rack and re		
	o procure full height Server racks that will hold the	
servers and UPS syster		
4.13 Laptop		
Make & Model No.		
programming & configu	n all allied software and hardware accessories, for uration & monitoring of SCADA system shall be 4 licensed version client SCADA software	
4.14 Color A3 size Pri	nter	
Make & Model No.		
i. Functions: Print, ii. Printing Up to 20 iii. Black Print Spee	page/minute	
iv. Up to 8000 page		
v. Recommended r vi. Processor speed		
vii. Connectivity: e p	orint capability	
Paper Handling: -	nput, standard: 100 sheet input trays	
	output, standard: 100-sheet face-down bin capacity (sheets): Up to 100 sheets	
I	Manual (Driver support provided)	
	Power Supply Systems	

### (3 KVA UPS System) Make & Model No. i) General Design • The UPS System shall be Single Phase LVAC 50Hz output with the charger and inverter normally supplying the load. • The charger shall be of thyristor-controlled type. The battery shall be of Nickel Cadmium/ SMF type. The inverter shall be of the Pulse Width Modulated (PWM) type, providing a single-phase output. Configuration with galvanic isolation transformer at the mains supply shall be supported. • UPS 3 KVA minimum capacity and all its consisting elements shall cover the required Station load, together with 20% spare for future use. ii) Operation Requirements • UPS charger shall continuously supply the load via the UPS inverter, while simultaneously maintaining the battery charge in the float charge mode. In the event of interruption or depression in the AC mains voltage to the charger, the battery shall supply the load requirements via inverter. • Upon restoration of the AC mains voltage, the UPS charger shall take over the power supply of the load via the inverter, while simultaneously recharging the battery. • UPS shall be capable of energizing the load within the permissible tolerances, without the battery connected. iii) Charger and Battery • The charger shall operate according to the constant voltage, current limiting principle, and shall incorporate a soft- start feature to gradually accept load on initial energizing. • UPS charger output characteristic shall provide an output voltage regulation of + 1%, for load changes 0-100 % and mains voltage supply and frequency within the tolerance ranges. Automatic compensation feature related on battery temperature shall be provided in case if lead-acid battery is installed. iv) Inverter

• The UPS inverter output voltage shall be maintained to + 1% of the nominal value for load changes 0-100 % and mains voltage supply and frequency within the tolerance ranges. The dynamic output voltage variations shall not exceed + 10% of the rated output voltage under any circumstances of instantaneous load changes

### v) Readings/Instrumentation and Alarms

• The following readings /instrumentation/LED indication shall be supplied as a minimum:

Battery voltage

UPS output voltage

• The following alarms/LED Indication shall be supplied as a minimum:

Charger fails

Inverter input voltage high /low

Inverter fails

### vi) UPS Distribution

• The distribution system shall be designed for incoming and outgoing AC supplies. Double pole miniature or moulded case circuit breakers complying to IEC 60157 shall be supplied, fitted with auxiliary contacts that operate when the circuit breaker trips. MCBs shall be rated to meet the load requirements and shall be labelled with the destination of the load.

### 4.16 Display Units

The 110" industrial grade LED video wall/ (70", 2X1) DLP based to be provided by Bidder in BCR for monitoring of SCADA system. The Workstation shall be connected to the screen LED /DLP display panel through communication bus. All the required information from the PLC panel shall be continuously updated in the screen LED/DLP display panel. The screen LED/DLP display panel shall map and display the vital information like, all reservoir levels, discharge, panel status, power availability, energy meter reading, Motor data etc. Specifications as below or better for 110" LED/ video wall/DLP based system shall be provided

Display Unit for 110" I		
Features	Value	
Make		
Model no.		
Each Screen Size	55" class (54.64" diagonal)	
Native Resolution	1920 x 1080 (FHD)	
Pixels (H x V x 3)	6,220,800	
Brightness	700 cd/m <sup>2</sup>	
Contrast Ratio	1400:1	
Viewing Angle	178°/178°	

Running Time	24Hr					
Orientation	Portrait & Landscape					
INPUT						
HDMI	Yes					
RS232C IN	Yes					
RJ45	Yes					
IR Receiver	Yes					
USB (USB3.0,	Yes					
USB2.0)	100					
OUTPUT						
DP Out	Yes					
Audio Output	Yes					
RS232C Output	Yes					
SPECIAL FEATURES	100					
Temperature Sensor	Yes					
Check Screen	Yes					
Embedded Template	Yes					
Set ID Setup	Manual, Auto					
Password Change	Yes					
Intelligent Auto	Yes					
Digital Audio Input	Yes					
Local Time Auto	Yes					
Setting	1 00					
Sync Mode	Time sync, Content sync					
Calibration Mode	Yes					
Internal Memory	8GB (System 4GB + Available 4GB)					
Brightness/Contrast	Yes					
/Backlight						
Energy Saving	Yes, Off / Minimum / Medium / Maximum /					
	Screen Off					
Auto Config/Phase	Yes					
Basic	Remote Controller, Power cable, DP Cable,					
	Manual, IR Receiver, RS-232C Cable, LAN					
	Cable, Guide Bracket, Screw					
POWER						
Power Supply	100-240V AC 50/60Hz					
<b>ENVIRONMENT COND</b>	DITIONS					
Operation	0 to 50 degrees Celsius					
Temperature						
Operational Humidity	10% to 90%					
4.17 SCADA SYSTEM	FOR BARRAGE AUTOMATION					
Make						
_	The Barrage control room will have two servers (one as a workstation), Monitor					
with internet connection with static IP & firewall system in combination with						
	CADA software will accept information sent by all the					
	ne information in a data base, display the information in					
appropriate mimic displ	ays, analyze past data and trends, will have the					

authentication feature by way of user name and password for operating the software; Updating of parameters of the PLC/RTU along with instrument can be done interactively from this software.  The development of software has to be customized with end user.  The control room will have main PLC system with IOs, main SCADA system, GPRS Modem, gateway software etc.  The control system along-with SCADA Software shall be provided in the Barrage control room (BCR) and the information available at control room (BCR) should also be available on any other PC/Laptop and on mobile located at any place through web. The Data provided in BCR should be displayed in complete explicit way and can be extracted in different formats.	
In Head Office located at Salt Lake, Kolkata three sets of laptops installed with licensed version client SCADA software, internet (4G/3G dongles) shall be provided by bidder for monitoring of system by Executive engineer, SE office, CE office in Salt Lake.	
The local control and computing system for the gates shall be able to calculate the actual spillway discharge depending on reservoir water level and gate opening.	
The local computing system shall be interconnected with the latest industrial grade Server with monitor and LED video wall not less than 110" size / (70", 2X1) DLP based system via master PLC Controller in the BCR, from which the command for the necessary discharge, to spillway gates shall be provided. All signals shall be sent and received to/from the BCR. Operating system shall be based on Windows server 2008 or latest.	
A master controller shall define the required total gate opening. The PLC/RTU shall compare the required value with the total actual opening found by adding up the individual opening values, if the deviation of one or more gates from the required value is large enough, an 'Open'- or 'Close'- instruction shall be given to the respective gate(s). However, to prevent hunting of hoist the deviation should be beyond the preselected tolerance band.	
In a selection circuit the 'open'- instruction shall be transferred to that gate, which at the time of the comparison controls the smallest opening. Similarly, a 'close' - instruction shall be given to the gate controlling the largest opening.  For the gate selection, only the gates shall be considered, of which the manual switches are in the 'Automatic 'position, and where no alarm signal has been received from, the 'open'- or 'close'- instruction shall remain with the selected gate, unless any of the following conditions is met:	
<ul> <li>The required and actual openings agree and the positioner cancels the instruction, or</li> <li>The gate had previously reached its limit position, or,</li> </ul>	

	_
• The max. Permissible deviation (pre-set difference in position between	
controlled gate and average of all gates available) has been reached previously.	
Survey of the su	
• The selected gate is not in operating condition.	
The selected gate is not in operating condition.	
In the event of major changes in required size of opening, the gates shall be	
moved successively one step each, i.e. after re-setting all gates again agree	
within the pre-set margin in size of opening. After all available gates have	
reached their limit positions a corresponding signal shall be given.	
At any time, individual gates shall be allowed to be switched over from the	
automatic mode to manual mode of operation, and vice versa, however, the	
operation from the local panel cannot be overruled by the remote/automatic	
operation stage. Adjustments made manually are to be automatically	
compensated for with the other gates by the automatic control system.	
Manually adjusted gates shall, when returned to automatic mode of operation, be	
adapted to their normal functioning in the automatic mode. The automatic	
system shall work independent of the number of available gates with the same	
characteristic. If all gates have been changed over to MANUAL, the master	
controller shall be reset so as to permit a smooth switching-over to AUTO	
operation.	
The system is to be designed to monitor the duration of the instruction. The	
monitoring is to prevent, that an instruction is maintained over a period, that is	
longer than a pre-select e.g. in the event of a malfunction of a gate selected by	
the controller, if the monitoring system is actuated, the particular gate is to be	
cancelled from the group of gates available for selection.	
Electronic attenuation is to be included to provide against unsteady level signals.	
The system should be compatible with flood fore-casting system to be provided	
by the employer for the monsoon period.	
B. Functions/ Features of SCADA Software	
• Normally Dynamic Gate Operation Scheduling Program will decide position of	
each Gate depending on the Water Discharge requirement.	
• Development of Dynamic Scheduling Program is included in the scope of	
work.	
• Operator in Control room should be able to control movement of individual	
gates via. SCADA software. This is needed for testing and emergency handling.	
• The customized, with life time licensed version SCADA software shall be	
designed, developed, Supplied, installed & commissioned by bidder based on the	
inputs provided by Engineer-in- Charge which shall have following minimum	
features:	
i. It will accept information send by all the remote locations /sites	
ii. Stores the information in a data base	
iii. Display the information in appropriate mimic displays	
iv. Will have a provision to analyse past data and trends	
v. Will have the authentication feature by way of user name and	
The state of the district teachers by may of door famous and	

password for operating the software.

- vi. Updating of parameters of the PLC/RTU along with instrument can be done Interactively from this software.
- vii. SCADA software shall be of at least 5000 tags & screens shall be provided as per user requirement.
- viii. Automatic alarm generation
- ix. Automatic report generation
- x. Auto e mail and SMS with Web server facility

## SCADA Software should mandatorily provide Graphical User Interface from Main menu with:

- 1. Parameterization and configuration setting of Sensor
- 2. Programming of PLC/RTU.
- 3. Real time data monitor on GUI and LED display.
- 4. File creation and Storage controller.
- 5. External Data transmission controller.
- 6. Burglar and alarm warning system controller.
- 7. Power status monitor and logging.
- 8. Motor status monitor and logging.
- 9. Data exporting features
- 10. Integration of rating curves
- 11. Manual data entry and input programmes
- 12. Printing graphical and tabular data

The Successful bidder shall upgrade all such developed software during the O & M period on need basis and provide the latest versions of all such software including Source Codes, while handing over the facilities to Authority. In addition, it shall be possible to export SCADA data to Hydrological Information System (HIS)

To be developed under National Hydrology Project in Future.

### 4.18 Tele-metering and Supervisory Control

The bidder shall provide Broadband with minimum internet speed of 8mbps for uploading and downloading along with necessary router with modem, static IP, firewall system & switches for GPRS communication. The bidder shall also provide the digital transmitters and their indications via the bus system. The SCADA System software should have the facility to track the non-functional sensors on daily basis and display on the web.

### i) Tele-metering Items

- Digital type gate position indications.
- Digital type water level indication.
- Digital type discharge indication of spillway.

Automatic weather station

### i) Supervisory Items

Alarms & Indications shall be provided at BCR. These shall include, but not limited to, the following:

- A.C. fault
- Common Alarm
- Over Load & Trip
- Open
- Close
- Stop
- Remote/Local

### 4.19 Solar Power System for Dataloggers

- i) Supply, Erection and commissioning of Solar power system with all allied ancillaries for providing un interrupted power supply to dataloggers located at canal systems for Minimum 5 days Backup without sunshine. The Solar Panels shall be provided in anodized aluminium frame with batteries, Solar panel should conform to IEC- 61730, 61215 and 61701.
- ii) The Bidder shall supply a pole mounted arrangement including a standard pole and necessary foundation and fixing arrangements. The location of solar power installation shall be indicated by the concerned engineer in charge.
- iii) The batteries required for the equipment above shall be maintenance free, rechargeable sealed batteries with Overcharge and deep discharge protection Leak-proof Easy handling, Excellent recharge ability.
- iv) The battery pack shall also include arrangements of charging through a standard AC power supply available at canal system and also from solar panels established as above.
- v) The power supply unit shall have audio or visual alarms for overcharging and deep discharging conditions. The sealed construction shall allow trouble-free, safe operation in any position. The battery case shall be high-impact, with sufficient resistance to shock, vibration, chemicals and heat.
- vi) The battery system shall be installed in the site building located near the Cross/Head regulator of Canal system
- vii) Successful bidder shall provide the necessary calculations to ensure the battery backup time of 5 days considering the transmission of data in every 30 minutes & event based.

### 4.20 Standards

The design, manufacture and testing of all works and installations shall strictly comply with the latest edition of the relevant IEC publications/IEEE/IS standards.  All the instruments/ transmitters shall be UL/CE certified.	
4.21 Wiring/Cabling requirements Shielded OFC cables complying with IEC 60793-1-1 shall be used for external Cabling from the RTU/PLC to Master controller & for entire instrumentation system to ensure the reliable operation of the SCADA system with necessary conduiting/ cable trays as per site requirement. These are minimum requirements. Bidder is free to propose improved cabling technology which shall be subjected to approval from Engineer in Charge.  The cabling system design criteria shall be as follows.	
i). The term cable shall always include necessary type of connectors at both the ends for connecting between two equipment. The connectors shall be properly anchored with protective sheathing of the cable in such a way that the loads due to pulling and twisting shall be borne by the protective sheathing and the conductors shall not be subjected to any stress.	
ii). The connectors shall be so fixed on the individual components of the system that the metal/ plastic connector shall always transfer the loads due to pulling and twisting directly to the protective body of the component and the internal interface cards/ connections shall not be subjected to any load.	
<b>iii).</b> Laying of necessary data and power supply cables for connecting various components and embedding them or protecting them with necessary conduits shall be carried out as per directions of engineer-incharge.	
iv). Wherever the cables are to be laid indoors and the length of the individual cable run exceeds 1 meter, the cable shall be housed in a protective conduit made of electrical supply grade conduit of appropriate diameter and the conduit shall be fixed with the wall at a height not less than 1 meter above the floor surface. Whenever the indoor cable is required to cross the floor, it shall be housed in a HDPE /GI flexible conduits pipe of 25 mm internal diameter and the pipe shall be fixed to the floor with suitable protective covering to avoid tripping of personnel using the area or disturbance to the pipe due to such movement.	
v). Wherever cables are to run through open ground including the public road and pathways, the cable shall be armoured and shall be water ingress proof up to static water pressure of 5 kg/cm2. All joints made in cable shall also meet the water proofing criteria. In addition, the cable	

shall be protected by housing the same in 25 mm galvanized iron pipe embedded at a depth of not less than 1.0 meter below the ground surface with a warning brick on the same. A sketch of the cable layout with respect to the identifiable marks of the area shall be prepared and handed over to the Engineer-in-charge for each such cable run on completion of the work of cable laying operation.

- vi). The joints in the cable connecting between the sensor and data collection unit shall be avoided by measuring the appropriate length of the cable required and attaching the same in one piece. If the cable joints become necessary, prior permission of the Engineer-in-charge shall be obtained before executing the same. The joint fabricated through a splicing and jointing kit shall be stronger than the parent cable.
- vii). The cable carrying data and electrical power shall be housed separately in different conduits separated by adequate distance to prevent leakage currents. The data cables shall also be laid out in such a way that the data integrity is not compromised due to mutual interference.

### **4.22 Discharge Measurement**

### 4.23 Manufacturer

Only CE/UL certified Sensors, RTU/PLC shall be used. The Remote-Control system is to be sourced from a reputed designer cum manufacturer.

Following names are given as reference for PLC/RTU & SCADA system

- a) Allen Bradley/Rockwell
- b) GE
- c) Siemens
- d) Schneider electric
- e) ABB
- f) Mitsubishi

If the bidder proposes alternative sourcing from an equally reputed and expert Remote-Control System manufacturer, he can propose the same with complete details, references, lists of successful Remote-Control Systems supplied/installed for prior approval from Engineer-In-Charge before placement of order with any of the manufacturer.

The Employer reserves the right to reject any or all of such proposed manufacturers including manufacturers named above.	
4.24 DIESEL GENERATOR SET 10 KVA	
Make & Model no.	
<ul> <li>Supply, Installation, Testing and Commissioning of Silent DG Set of 10 KVA for power supply to entire SCADA system in case of power failure for more than 2 hours.</li> </ul>	
<ul> <li>Alternator shall be self-regulated with Standard Alternator protection (Over Voltage, Over Speed, Under Voltage, Under Speed warning &amp; Shutdown).</li> </ul>	
<ul> <li>Engine shall have industrial silencer, Electronic/Mechanical Governor, Manual &amp; Electric Start, Batteries, Engine Instrument panel, AVM and with water proof powder coated Acoustic enclosure for DG Set.</li> </ul>	
A. ENGINE	
<ul> <li>Vertical, 2 cylinders, four stroke cycle Air / Water cooled cold starting compression / ignition, diesel engine under NTP conditions as per BS: 5514.</li> <li>The engine will have following standard accessories:         Heavy flywheel         Air cleaner dry type/Oil bath type.</li> </ul>	
Governor mechanical type Starter 12 volts DC	
12-volt Battery with leads	
Dynamo / Alternator	
Silencer Industrial (without piping) Fuel lift pump.	
B. Alternator	
415V, three Phase, 50 cycles/ sec., 1500 RPM, self-excited, self-regulated screen protected drip proof alternator in accordance with BS: 2613.	
C. Arrangement The Engine and Alternator will be close couple mounted on a common fabricated base plate.	
D. Control Panel	
M. S. / CRCA Steel fabricated L.T. switchboard suitable for indoor floor / wall mounting installation & for controlling the above generating set. The control panel will be equipped with.	

- Digital Energy Meter
- Main On/Off switch / MCB
- Set of indicating lamps.
- Set of instrument fuses.
- Set of current transformers.
- Over voltage Relay
- Suitable MPCB

The switchboard shall be complete with internal wiring, front cover, rust proof, powder coated paint and arrangement for receiving incoming and outgoing cables. The control panel shall have an automatic mains failure feature for remote automatic starting from the PLC based Control panel at the Field Station. Necessary equipment like solenoid coil etc. shall be provided for the same along with an IP54 or better panel.

### E. Fuel Tank

Eight hours continuous running capacity, fuel tank complete with inlet/outlet, air vent, drain plug, inlet arrangement for direct filling. The fuel tank level shall be displayed at the local panel and the RTU/PLC based control panel at the Field Station.

# **6.** PROFORMA OF CERTIFICATE FOR ISSUE BY THE PURCHASER AFTER

# SUCCESSFUL INSTALLATION AND STARTUP OF THE SUPPLIED GOODS

[This	is to be	attached for supply, erection, supervision of erection and startup contracts only]	1
No.		Date:	
M/s.			
Sub:	Certifi	icate of startup of the supplied Goods	
1.	This is to certify that the plant/s as detailed below has/have been received in good con along with all the standard and special accessories (subject to remarks in Para No. 2) set of spares in accordance with the Contract/Specifications. The same has been instand commissioned.		and a
	(a)	Contract Nodated	
	(b)	Description of the plant	
	(c)	Plant Nos	
	(d)	Quantity	
	(e)	Rail/Roadways Receipt Nodated	_
	(f)	Name of the consignee	
	(g)	Date of startup and proving test	
2.	Detail	s of accessories/spares not yet supplied and recoveries to be made on that accoun	ıt.
	<u>S. No.</u>	<u>Description</u> <u>Amount to be recovered</u>	
3.	The p	roving test has been done to our entire satisfaction and operators have been train	ned to

operate the plant.

4.	The supplier has fulfilled his contractual obl	ligations satisfactorily. *
or		
	The supplier has failed to fulfill his contract	ual obligations with regard to the following:
	(a)	
	(b)	
	(c)	
	(d)	
5.	The amount of recovery on account of non-Para No. 2.	-supply of accessories and spares is given under
6.	The amount of recovery on account of failure of the supplier to meet his contractual obligations is as indicated in endorsement of the letter.	
		Signature
		Name
		Designation with Stamp

### \* Explanatory notes for filling up the certificates:

- (a) He has adhered to the time schedule specified in the contract in dispatching the documents/drawings pursuant to Technical Specifications.
- (b) He has supervised the startup of the plan in time i.e., within the period specified in the contract from the date of intimation by the Purchaser in respect of the installation of the plant.
- (c) Training of personnel has been done by the supplier as specified in the contract
- (d) In the event of documents/drawings having not been supplied or installation and startup of the plant have been delayed on account of the supplier, the extent of delay should always be mentioned.

### PART 3 – CONTRACT

### SECTION VIII – GENERAL CONDITIONS OF CONTRACT

### **Table of Clauses**

1.	DEFINITIONS	171
2.	CONTRACT DOCUMENTS	
3.	CORRUPT &FRAUDULENTPRACTICES	172
4.	INTERPRETATION	172
5.	LANGUAGE	173
6.	DELETED	173
7.	ELIGIBILITY	174
8.	NOTICES	174
9.	GOVERNING LAW	
10.	SETTLEMENT OF DISPUTES	
11.	INSPECTIONS AND AUDIT BY THE BANK	175
12.	SCOPE OF SUPPLY	
13.	DELIVERY AND DOCUMENTS	175
14.	SUPPLIER'S RESPONSIBILITIES	175
15.	CONTRACT PRICE	175
16.	TERMS OF PAYMENT	
17.	TAXES AND DUTIES	176
18.	PERFORMANCE SECURITY	
19.	COPYRIGHT	
20.	CONFIDENTIAL INFORMATION	176
21.	SUBCONTRACTING	
22.	SPECIFICATIONS AND STANDARDS	178
23.	PACKING AND DOCUMENTS	178
24.	INSURANCE	178

### 

25.	TRANSPORTATION&INCIDENTAL SERVICES	179
26.	INSPECTIONS AND TESTS	179
27.	LIQUIDATED DAMAGES	180
28.	WARRANTY	181
29.	PATENT INDEMNITY	181
30.	LIMITATION OF LIABILITY	182
31.	CHANGE IN LAWS AND REGULATIONS	183
32.	FORCE MAJEURE	183
33.	CHANGE ORDERS AND CONTRACT AMENDMENTS	184
34.	EXTENSIONS OF TIME	184
35.	TERMINATION	185
36.	ASSIGNMENT	186

### **Section VIII. General Conditions of Contract**

### 1. **Definitions** The following words and expressions shall have the meanings hereby

assigned to them:

- (a) "Bank" means the World Bank and refers to the International Bank for Reconstruction and Development (IBRD) or the International Development Association (IDA).
- (b) "Contract" means the Contract Agreement entered into between the Purchaser and the Supplier, together with the Contract Documents referred to therein, including all attachments, appendices, and all documents incorporated by reference therein.
- (c) "Contract Documents" means the documents listed in the Contract Agreement, including any amendments thereto.
- (d) "Contract Price" means the price payable to the Supplier as specified in the Contract Agreement, subject to such additions and adjustments thereto or deductions therefrom, as may be made pursuant to the Contract.
- (e) "Day" means calendar day.
- (f) "Completion" means the fulfillment of the Related Services by the Supplier in accordance with the terms and conditions set forth in the Contract.
- (g) "GCC" means the General Conditions of Contract.
- (h) "Goods" means all of the commodities, raw material, machinery and equipment, and/or other materials that the Supplier is required to supply to the Purchaser under the Contract.
- (i) "Purchaser's Country" is India.
- (j) "Purchaser" means the entity purchasing the Goods and Related Services, as specified in the SCC.
- (k) "Related Services" means the services incidental to the supply of the goods, such as insurance, installation, start-up, training and initial maintenance and other such obligations of the Supplier under the Contract.

- (l) "SCC" means the Special Conditions of Contract.
- (m) "Subcontractor" means any natural person, private or government entity, or a combination of the above, to whom any part of the Goods to be supplied or execution of any part of the Related Services is subcontracted by the Supplier.
- (n) "Supplier" means the natural person, private or government entity, or a combination of the above, whose bid to perform the Contract has been accepted by the Purchaser and is named as such in the Contract Agreement.
- (o) "The Project Site," where applicable, means the place named in the **SCC**.

## 2. Contract Documents

2.1 Subject to the order of precedence set forth in the Contract Agreement, all documents forming the Contract (and all parts thereof) are intended to be correlative, complementary, and mutually explanatory. The Contract Agreement shall be read as a whole.

# 3. Corrupt Fraudulent Practices

- & 3.1 The Bank requires compliance with its policy in regard to corrupt and fraudulent practices as set forth in Appendix to the GCC.
  - 3.2 The Purchaser requires the Supplier to disclose any commissions or fees that may have been paid or are to be paid to agents or any other party with respect to the bidding process or execution of the Contract. The information disclosed must include at least the name and address of the agent or other party, the amount and currency, and the purpose of the commission, gratuity or fee.

### 4. Interpretation

- 4.1 If the context so requires it, singular means plural and vice versa.
- 4.2 Incoterms.
- (a) Unless inconsistent with any provision of the Contract, the meaning of any trade term and the rights and obligations of parties there under shall be as prescribed by Incoterms.
- (b) The terms EXW and other similar terms, when used, shall be governed by the rules prescribed in the current edition of Incoterms specified in the SCC and published by the International Chamber of Commerce in Paris, France.
- 4.3 Entire Agreement

The Contract constitutes the entire agreement between the Purchaser and the Supplier and supersedes all communications, negotiations and agreements (whether written or oral) of the parties with respect thereto made prior to the date of Contract.

#### 4.4 Amendment

No amendment or other variation of the Contract shall be valid unless it is in writing, is dated, expressly refers to the Contract, and is signed by a duly authorized representative of each party thereto.

### 4.5 Nonwaiver

- (a) Subject to GCC Sub-Clause 4.5(b) below, no relaxation, forbearance, delay, or indulgence by either party in enforcing any of the terms and conditions of the Contract or the granting of time by either party to the other shall prejudice, affect, or restrict the rights of that party under the Contract, neither shall any waiver by either party of any breach of Contract operate as waiver of any subsequent or continuing breach of Contract.
- (b) Any waiver of a party's rights, powers, or remedies under the Contract must be in writing, dated, and signed by an authorized representative of the party granting such waiver, and must specify the right and the extent to which it is being waived.

### 4.6 Severability

If any provision or condition of the Contract is prohibited or rendered invalid or unenforceable, such prohibition, invalidity or unenforceability shall not affect the validity or enforceability of any other provisions and conditions of the Contract.

### 5. Language

- 5.1 The Contract as well as all correspondence and documents relating to the Contract exchanged by the Supplier and the Purchaser, shall be English. Supporting documents and printed literature that are part of the Contract may be in another language provided they are accompanied by an accurate translation of the relevant passages in English language, in which case, for purposes of interpretation of the Contract, this translation shall govern.
- 5.2 The Supplier shall bear all costs of translation to the governing language and all risks of the accuracy of such translation, for documents provided by the Supplier.

### 6. Deleted

### 7. Eligibility

- 7.1 The Supplier and its Subcontractors shall have the nationality of an eligible country. A Supplier or Subcontractor shall be deemed to have the nationality of a country if it is a citizen or constituted, incorporated, or registered, and operates in conformity with the provisions of the laws of that country.
- 7.2 All Goods and Related Services to be supplied under the Contract and financed by the Bank shall have their origin in Eligible Countries. For the purpose of this Clause, origin means the country where the goods have been grown, mined, cultivated, produced, manufactured, or processed; or through manufacture, processing, or assembly, another commercially recognized article results that differs substantially in its basic characteristics from its components.

### 8. Notices

- 8.1 Any notice given by one party to the other pursuant to the Contract shall be in writing to the address specified in the SCC. The term "in writing" means communicated in written form with proof of receipt.
- 8.2 A notice shall be effective when delivered or on the notice's effective date, whichever is later.

### 9. Governing Law

9.1 The Contract shall be governed by and interpreted in accordance with the laws of the Union of India.

# 10. Settlement of Disputes

- 10.1 The Purchaser and the Supplier shall make every effort to resolve amicably by direct informal negotiation any disagreement or dispute arising between them under or in connection with the Contract.
- 10.2 If, after twenty-eight (28) days, the parties have failed to resolve their dispute or difference by such mutual consultation, then either the Purchaser or the Supplier may give notice to the other party of its intention to commence arbitration, as hereinafter provided, as to the matter in dispute, and no arbitration in respect of this matter may be commenced unless such notice is given. Any dispute or difference in respect of which a notice of intention to commence arbitration has been given in accordance with this Clause shall be finally settled by arbitration. Arbitration may be commenced prior to or after delivery of the Goods under the Contract. Arbitration proceedings shall be conducted in accordance with the rules of procedure **specified in the SCC.**
- 10.3 Notwithstanding any reference to arbitration herein,
  - (a) the parties shall continue to perform their respective obligations under the Contract unless they otherwise agree; and

(b) the Purchaser shall pay the Supplier any monies due the Supplier.

### 11. Inspections and Audit by the Bank

- 11.1 The Supplier shall keep, and shall make all reasonable efforts to cause its Subcontractors to keep, accurate and systematic accounts and records in respect of the Goods in such form and details as will clearly identify relevant time changes and costs
- 11.2 The Supplier shall permit, and shall cause its Subcontractors to permit, the Bank and/or persons appointed by the Bank to inspect the Supplier's offices and all accounts and records relating to the performance of the Contract and the submission of the bid, and to have such accounts and records audited by auditors appointed by the Bank if requested by the Bank. The Supplier's and its Subcontractors and consultants' attention is drawn to Clause 3 [Fraud and Corruption], which provides, inter alia, that acts intended to materially impede the exercise of the Bank's inspection and audit rights provided for under this Sub-Clause 11.1 constitute a prohibited practice subject to contract termination (as well as to a determination of ineligibility pursuant to the Bank's prevailing sanctions procedures)

### 12. Scope of Supply

12.1 The Goods and Related Services to be supplied shall be as specified in the **Special Conditions of Contract**.

### **13. Delivery** and 13.1 **Documents**

3.1 Subject to GCC Sub-Clause 33.1, the Delivery of the Goods and Completion of the Related Services shall be in accordance with the Delivery and Completion Schedule specified in the Schedule of Requirements. The details of shipping and other documents to be furnished by the Supplier are specified in the SCC.

# 14. Supplier's Responsibilities

14.1 The Supplier shall supply all the Goods and Related Services included in the Scope of Supply in accordance with GCC Clause 12, and the Delivery and Completion Schedule, as per GCC Clause 13.

#### 15. Contract Price

15.1 Prices charged by the Supplier for the Goods supplied and the Related Services performed under the Contract shall not vary from the prices quoted by the Supplier in its bid, with the exception of any price adjustments authorized in the **SCC**.

### 16. Terms Payment

of 16.1 The Contract Price, including any Advance Payments, if applicable, shall be paid as specified in the SCC.

16.2 The Supplier's request for payment shall be made to the Purchaser in writing, accompanied by invoices describing, as appropriate, the Goods delivered and Related Services performed, and by the documents submitted pursuant to GCC Clause 13 and upon fulfillment of all other obligations stipulated in the Contract.

- 16.3 Payments shall be made promptly by the Purchaser, but in no case later than sixty (60) days after submission of an invoice or request for payment by the Supplier, and after the Purchaser has accepted it.
- 16.4 The payments shall be made in Indian Rupees to the Supplier under this Contract.
- 16.5 In the event that the Purchaser fails to pay the Supplier any payment by its due date or within the period set forth in the SCC, the Purchaser shall pay to the Supplier interest on the amount of such delayed payment at the rate shown in the SCC, for the period of delay until payment has been made in full, whether before or after judgment or arbitrage award.

## 17. Taxes and 17.1 Duties

17.1 The Supplier shall be entirely responsible for all taxes, duties, license fees, etc., incurred until delivery of the contracted Goods to the Purchaser.

# 18. Performance Security

- 18.1 If required as specified in the SCC, the Supplier shall, within twenty-one (21) days of the notification of contract award, provide a performance security for the performance of the Contract in the amount specified in the SCC.
- 18.2 The proceeds of the Performance Security shall be payable to the Purchaser as compensation for any loss resulting from the Supplier's failure to complete its obligations under the Contract.
- 18.3 As specified in the SCC, the Performance Security shall be denominated in the Indian Rupees, and shall be in the format stipulated by the Purchaser in the SCC, or in another format acceptable to the Purchaser.
- 18.4 The Performance Security shall be discharged by the Purchaser and returned to the Supplier not later than twenty-eight (28) days following the date of Completion of the Supplier's performance obligations under the Contract, including any warranty obligations, unless specified otherwise in the **SCC**.

### 19. Copyright

19.1 The copyright in all drawings, documents, and other materials containing data and information furnished to the Purchaser by the Supplier herein shall remain vested in the Supplier, or, if they are furnished to the Purchaser directly or through the Supplier by any third party, including suppliers of materials, the copyright in such materials shall remain vested in such third party.

### 20. Confidential

20.1 The Purchaser and the Supplier shall keep confidential and shall not, without the written consent of the other party hereto,

#### Information

divulge to any third party any documents, data, or other information furnished directly or indirectly by the other party hereto in connection with the Contract, whether such information has been furnished prior to, during or following completion or termination of the Contract. Notwithstanding the above, the Supplier may furnish to its Subcontractor such documents, data, and other information it receives from the Purchaser to the extent required for the Subcontractor to perform its work under the Contract, in which event the Supplier shall obtain from such Subcontractor an undertaking of confidentiality similar to that imposed on the Supplier under GCC Clause 20.

- 20.2 The Purchaser shall not use such documents, data, and other information received from the Supplier for any purposes unrelated to the contract. Similarly, the Supplier shall not use such documents, data, and other information received from the Purchaser for any purpose other than the performance of the Contract.
- 20.3 The obligation of a party under GCC Sub-Clauses 20.1 and 20.2 above, however, shall not apply to information that:
- (a) the Purchaser or Supplier need to share with the Bank or other institutions participating in the financing of the Contract;
- (b) now or hereafter enters the public domain through no fault of that party;
- (c) can be proven to have been possessed by that party at the time of disclosure and which was not previously obtained, directly or indirectly, from the other party; or
- (d) otherwise lawfully becomes available to that party from a third party that has no obligation of confidentiality.
- 20.4 The above provisions of GCC Clause 20 shall not in any way modify any undertaking of confidentiality given by either of the parties hereto prior to the date of the Contract in respect of the Supply or any part thereof.
- 20.5 The provisions of GCC Clause 20 shall survive completion or termination, for whatever reason, of the Contract.

### 21. Subcontracting

21.1 The Supplier shall notify the Purchaser in writing of all subcontracts awarded under the Contract if not already specified in the bid. Such notification, in the original bid or later shall not relieve the Supplier from any of its obligations,

duties, responsibilities, or liability under the Contract.

21.2 Subcontracts shall comply with the provisions of GCC Clauses 3 and 7.

### 22. Specifications and Standards

- 22.1 Technical Specifications and Drawings
- (a) The Goods and Related Services supplied under this Contract shall conform to the technical specifications and standards mentioned in Section VII, Schedule of Requirements and, when no applicable standard is mentioned, the standard shall be equivalent or superior to the official standards whose application is appropriate to the Goods' country of origin.
- (b) The Supplier shall be entitled to disclaim responsibility for any design, data, drawing, specification or other document, or any modification thereof provided or designed by or on behalf of the Purchaser, by giving a notice of such disclaimer to the Purchaser.
- (c) Wherever references are made in the Contract to codes and standards in accordance with which it shall be executed, the edition or the revised version of such codes and standards shall be those specified in the Schedule of Requirements. During Contract execution, any changes in any such codes and standards shall be applied only after approval by the Purchaser and shall be treated in accordance with GCC Clause 33.

# 23. Packing and Documents

- and 23.1 The Supplier shall provide such packing of the Goods as is required to prevent their damage or deterioration during transit to their final destination, as indicated in the Contract. During transit, the packing shall be sufficient to withstand, without limitation, rough handling and exposure to extreme temperatures, salt and precipitation, and open storage. Packing case size and weights shall take into consideration, where appropriate, the remoteness of the goods' final destination and the absence of heavy handling facilities at all points in transit.
  - 23.2 The packing, marking, and documentation within and outside the packages shall comply strictly with such special requirements as shall be expressly provided for in the Contract, including additional requirements, if any, specified in the SCC, and in any other instructions ordered by the Purchaser.

#### 24. Insurance

24.1 Unless otherwise specified in the **SCC**, the Goods supplied under the Contract shall be fully insured—against loss or damage incidental to manufacture or acquisition, transportation, storage, and delivery, in accordance with the

applicable Incoterms or in the manner specified in the SCC.

### 25. Transportation &Incidental Services

- 25.1 Unless otherwise specified in the SCC, responsibility for arranging transportation of the Goods shall be in accordance with the specified Incoterms.
- 25.2 The Supplier may be required to provide any or all of the following services, including additional services, if any, specified in Schedule of Requirements and SCC:
  - performance or supervision of on-site assembly and/or (a) start-up of the supplied Goods;
  - furnishing of tools required for assembly and/or maintenance of the supplied Goods;
  - furnishing of a detailed operations and maintenance manual for each appropriate unit of the supplied Goods;
  - performance or supervision or maintenance and/or repair of the supplied Goods, for a period of time agreed by the parties, provided that this service shall not relieve the Supplier of any warranty obligations under this Contract; and
  - training of the Purchaser's personnel, at the Supplier's plant (e) on-site, in assembly, start-up, operation, maintenance, and/or repair of the supplied Goods
- 25.3 Prices charged by the Supplier for incidental services, if not included in the Contract Price for the Goods, shall be agreed upon in advance by the parties and shall not exceed the prevailing rates charged to other parties by the Supplier for similar services.

### **Tests**

- **26.** Inspections and 26.1 The Supplier shall at its own expense and at no cost to the Purchaser carry out all such tests and/or inspections of the Goods and Related Services as are specified in the SCC.
  - 26.2 The inspections and tests may be conducted on the premises of the Supplier or its Subcontractor, at point of delivery, and/or at the Goods' final destination, or in another place in the Purchaser's Country as specified in the SCC. Subject to GCC Sub-Clause 26.3, if conducted on the premises of the Supplier or its Subcontractor, all reasonable facilities and assistance, including access to drawings and production data, shall be furnished to the inspectors at no charge to the Purchaser.
  - 26.3 The Purchaser or its designated representative shall be entitled to attend the tests and/or inspections referred to in GCC Sub-Clause 26.2, provided that the Purchaser bear all of its own costs and expenses incurred in connection with such attendance including, but not limited to, all traveling and board

and lodging expenses.

- 26.4 Whenever the Supplier is ready to carry out any such test and inspection, it shall give a reasonable advance notice, including the place and time, to the Purchaser. The Supplier shall obtain from any relevant third party or manufacturer any necessary permission or consent to enable the Purchaser or its designated representative to attend the test and/or inspection.
- 26.5 The Purchaser may require the Supplier to carry out any test and/or inspection not required by the Contract but deemed necessary to verify that the characteristics and performance of the Goods comply with the technical specifications codes and standards under the Contract, provided that the Supplier's reasonable costs and expenses incurred in the carrying out of such test and/or inspection shall be added to the Contract Price. Further, if such test and/or inspection impedes the progress of manufacturing and/or the Supplier's performance of its other obligations under the Contract, due allowance will be made in respect of the Delivery Dates and Completion Dates and the other obligations so affected.
- 26.6 The Supplier shall provide the Purchaser with a report of the results of any such test and/or inspection.
- 26.7 The Purchaser may reject any Goods or any part thereof that fail to pass any test and/or inspection or do not conform to the specifications. The Supplier shall either rectify or replace such rejected Goods or parts thereof or make alterations necessary to meet the specifications at no cost to the Purchaser, and shall repeat the test and/or inspection, at no cost to the Purchaser, upon giving a notice pursuant to GCC Sub-Clause 26.4.
- 26.8 The Supplier agrees that neither the execution of a test and/or inspection of the Goods or any part thereof, nor the attendance by the Purchaser or its representative, nor the issue of any report pursuant to GCC Sub-Clause 26.6, shall release the Supplier from any warranties or other obligations under the Contract.

# 27. Liquidated Damages

27.1 Except as provided under GCC Clause 32, if the Supplier fails to deliver any or all of the Goods by the Date(s) of delivery or perform the Related Services within the period specified in the Contract, the Purchaser may without prejudice to all its other remedies under the Contract, deduct from the Contract Price, as liquidated damages, a sum equivalent to the percentage specified in the SCC of the delivered price of the delayed Goods or unperformed Services for each week or part thereof of delay until actual delivery or performance, up to a maximum deduction of the percentage specified in those SCC. Once the

maximum is reached, the Purchaser may terminate the Contract pursuant to GCC Clause 35.

#### 28. Warranty

- 28.1 The Supplier warrants that all the Goods are new, unused, and of the most recent or current models, and that they incorporate all recent improvements in design and materials, unless provided otherwise in the Contract.
- 28.2 Subject to GCC Sub-Clause 22.1(b), the Supplier further warrants that the Goods shall be free from defects arising from any act or omission of the Supplier or arising from design, materials, and workmanship, under normal use in the conditions prevailing in the country of final destination.
- 28.3 Unless otherwise specified in the **SCC**, the warranty shall remain valid for twelve (12) months after the Goods, or any portion thereof as the case may be, have been delivered to and accepted at the final destination indicated in the **SCC**, or for eighteen (18) months after the date of shipment from the port or place of loading in the country of origin, whichever period concludes earlier.
- 28.4 The Purchaser shall give notice to the Supplier stating the nature of any such defects together with all available evidence thereof, promptly following the discovery thereof. The Purchaser shall afford all reasonable opportunity for the Supplier to inspect such defects.
- 28.5 Upon receipt of such notice, the Supplier shall, within the period specified in the SCC, expeditiously repair or replace the defective Goods or parts thereof, at no cost to the Purchaser.
- 28.6 If having been notified, the Supplier fails to remedy the defect within the period specified in the SCC, the Purchaser may proceed to take within a reasonable period such remedial action as may be necessary, at the Supplier's risk and expense and without prejudice to any other rights which the Purchaser may have against the Supplier under the Contract.

## 29. Patent Indemnity

29.1 The Supplier shall, subject to the Purchaser's compliance with GCC Sub-Clause 29.2, indemnify and hold harmless the Purchaser and its employees and officers from and against any and all suits, actions or administrative proceedings, claims, demands, losses, damages, costs, and expenses of any nature, including attorney's fees and expenses, which the Purchaser may suffer as a result of any infringement or alleged infringement of any patent, utility model, registered design, trademark, copyright, or other intellectual property right registered or otherwise existing at the date of the Contract by

reason of:

- (a) the installation of the Goods by the Supplier or the use of the Goods in the country where the Site is located; and
- (b) the sale in any country of the products produced by the Goods.

Such indemnity shall not cover any use of the Goods or any part thereof other than for the purpose indicated by or to be reasonably inferred from the Contract, neither any infringement resulting from the use of the Goods or any part thereof, or any products produced thereby in association or combination with any other equipment, plant, or materials not supplied by the Supplier, pursuant to the Contract.

- 29.2 If any proceedings are brought or any claim is made against the Purchaser arising out of the matters referred to in GCC Sub-Clause 29.1, the Purchaser shall promptly give the Supplier a notice thereof, and the Supplier may at its own expense and in the Purchaser's name conduct such proceedings or claim and any negotiations for the settlement of any such proceedings or claim.
- 29.3 If the Supplier fails to notify the Purchaser within twenty-eight (28) days after receipt of such notice that it intends to conduct any such proceedings or claim, then the Purchaser shall be free to conduct the same on its own behalf.
- 29.4 The Purchaser shall, at the Supplier's request, afford all available assistance to the Supplier in conducting such proceedings or claim, and shall be reimbursed by the Supplier for all reasonable expenses incurred in so doing.
- 29.5 The Purchaser shall indemnify and hold harmless the Supplier and its employees, officers, and Subcontractors from and against any and all suits, actions or administrative proceedings, claims, demands, losses, damages, costs, and expenses of any nature, including attorney's fees and expenses, which the Supplier may suffer as a result of any infringement or alleged infringement of any patent, utility model, registered design, trademark, copyright, or other intellectual property right registered or otherwise existing at the date of the Contract arising out of or in connection with any design, data, drawing, specification, or other documents or materials provided or designed by or on behalf of the Purchaser.

## 30. Limitation Liability

- of 30.1 Except in cases of criminal negligence or willful misconduct,
  - (a) the Supplier shall not be liable to the Purchaser, whether

in contract, tort, or otherwise, for any indirect or consequential loss or damage, loss of use, loss of production, or loss of profits or interest costs, provided that this exclusion shall not apply to any obligation of the Supplier to pay liquidated damages to the Purchaser, and

- the aggregate liability of the Supplier to the Purchaser, whether under the Contract, in tort or otherwise, shall not exceed the total Contract Price, provided that this limitation shall not apply to the cost of repairing or replacing defective equipment, or to any obligation of the supplier to indemnify the purchaser with respect to patent infringement.
- and Regulations
- 31. Change in Laws 31.1 Unless otherwise specified in the Contract, if after the date of 28 days prior to date of Bid submission, any law, regulation, ordinance, order or bylaw having the force of law is enacted, promulgated, abrogated, or changed in India, where the Site is located (which shall be deemed to include any change in interpretation or application by the competent authorities) that subsequently affects the Delivery Date and/or the Contract Price, then such Delivery Date and/or Contract Price shall be correspondingly increased or decreased, to the extent that the Supplier has thereby been affected in the performance of any of its obligations under the Contract. Notwithstanding the foregoing, such additional or reduced cost shall not be separately paid or credited if the same has already been accounted for in the price adjustment provisions where applicable, in accordance with GCC Clause 15.

#### 32. Force Majeure

- 32.1 The Supplier shall not be liable for forfeiture of its Performance Security, liquidated damages, or termination for default if and to the extent that its delay in performance or other failure to perform its obligations under the Contract is the result of an event of Force Majeure.
- 32.2 For purposes of this Clause, "Force Majeure" means an event or situation beyond the control of the Supplier that is not foreseeable, is unavoidable, and its origin is not due to negligence or lack of care on the part of the Supplier. Such events may include, but not be limited to, acts of the Purchaser in its sovereign capacity, wars or revolutions, fires, floods, epidemics, quarantine restrictions, and freight embargoes.
- 32.3 If a Force Majeure situation arises, the Supplier shall promptly notify the Purchaser in writing of such condition and the cause thereof. Unless otherwise directed by the Purchaser in writing, the Supplier shall continue to perform its obligations under the Contract as far as is reasonably practical, and shall seek all

reasonable alternative means for performance not prevented by the Force Majeure event.

# 33. Change Orders and Contract Amendments

- 33.1 The Purchaser may at any time order the Supplier through notice in accordance GCC Clause 8, to make changes within the general scope of the Contract in any one or more of the following:
- (a) drawings, designs, or specifications, where Goods to be furnished under the Contract are to be specifically manufactured for the Purchaser;
- (b) the method of shipment or packing;
- (c) the place of delivery; and
- (d) the Related Services to be provided by the Supplier.
- 33.2 If any such change causes an increase or decrease in the cost of, or the time required for, the Supplier's performance of any provisions under the Contract, an equitable adjustment shall be made in the Contract Price or in the Delivery/Completion Schedule, or both, and the Contract shall accordingly be amended. Any claims by the Supplier for adjustment under this Clause must be asserted within twenty-eight (28) days from the date of the Supplier's receipt of the Purchaser's change order.
- 33.3 Prices to be charged by the Supplier for any Related Services that might be needed but which were not included in the Contract shall be agreed upon in advance by the parties and shall not exceed the prevailing rates charged to other parties by the Supplier for similar services.
- 33.4 Subject to the above, no variation in or modification of the terms of the Contract shall be made except by written amendment signed by the parties.

## 34. Extensions Time

of 34.1 If at any time during performance of the Contract, the Supplier or its subcontractors should encounter conditions impeding timely delivery of the Goods or completion of Related Services pursuant to GCC Clause 13, the Supplier shall promptly notify the Purchaser in writing of the delay, its likely duration, and its cause. As soon as practicable after receipt of the Supplier's notice, the Purchaser shall evaluate the situation and may at its discretion extend the Supplier's time for performance, in which case the extension shall be ratified by the parties by amendment of the Contract.

34.2 Except in case of Force Majeure, as provided under GCC Clause 32, a delay by the Supplier in the performance of its Delivery and Completion obligations shall render the Supplier liable to the imposition of liquidated damages pursuant to GCC Clause 26, unless an extension of time is agreed upon, pursuant to GCC Sub-Clause 34.1.

#### **35. Termination** 35.1 Termination for Default

- (a) The Purchaser, without prejudice to any other remedy for breach of Contract, by written notice of default sent to the Supplier, may terminate the Contract in whole or in part:
  - (i) if the Supplier fails to deliver any or all of the Goods within the period specified in the Contract, or within any extension thereof granted by the Purchaser pursuant to GCC Clause 34;
  - (ii) if the Supplier fails to perform any other obligation under the Contract; or
  - (iii) if the Supplier, in the judgment of the Purchaser has engaged in fraud and corruption, as defined in GCC Clause 3, in competing for or in executing the Contract.
- (b) In the event the Purchaser terminates the Contract in whole or in part, pursuant to GCC Clause 35.1(a), the Purchaser may procure, upon such terms and in such manner as it deems appropriate, Goods or Related Services similar to those undelivered or not performed, and the Supplier shall be liable to the Purchaser for any additional costs for such similar Goods or Related Services. However, the Supplier shall continue performance of the Contract to the extent not terminated.

#### 35.2 Termination for Insolvency.

(a) The Purchaser may at any time terminate the Contract by giving notice to the Supplier if the Supplier becomes bankrupt or otherwise insolvent. In such event, termination will be without compensation to the Supplier, provided that such termination will not prejudice or affect any right of action or remedy that has accrued or will accrue thereafter to the Purchaser.

#### 35.3 Termination for Convenience.

(a) The Purchaser, by notice sent to the Supplier, may terminate the Contract, in whole or in part, at any time for its

convenience. The notice of termination shall specify that termination is for the Purchaser's convenience, the extent to which performance of the Supplier under the Contract is terminated, and the date upon which such termination becomes effective.

- (b) The Goods that are complete and ready for shipment within twenty-eight (28) days after the Supplier's receipt of notice of termination shall be accepted by the Purchaser at the Contract terms and prices. For the remaining Goods, the Purchaser may elect:
  - (i) to have any portion completed and delivered at the Contract terms and prices; and/or
  - (ii) to cancel the remainder and pay to the Supplier an agreed amount for partially completed Goods and Related Services and for materials and parts previously procured by the Supplier.

#### 36. Assignment

36.1 Neither the Purchaser nor the Supplier shall assign, in whole or in part, their obligations under this Contract, except with prior written consent of the other party.

.

# **APPENDIX TO GENERAL CONDITIONS Bank's Policy- Corrupt and Fraudulent Practices**

(text in this Appendix shall not be modified)

Guidelines for Procurement of Goods, Works, and Non-Consulting Services under IBRD Loans and IDA Credits & Grants by World Bank Borrowers, dated January 2011:

#### "Fraud and Corruption:

- 1.16 It is the Bank's policy to require that Borrowers (including beneficiaries of Bank loans), bidders, suppliers, contractors and their agents (whether declared or not), sub-contractors, sub-consultants, service providers or suppliers, and any personnel thereof, observe the highest standard of ethics during the procurement and execution of Bank-financed contracts. <sup>13</sup> In pursuance of this policy, the Bank:
  - (a) defines, for the purposes of this provision, the terms set forth below as follows:
    - (i) "corrupt practice" is the offering, giving, receiving, or soliciting, directly or indirectly, of anything of value to influence improperly the actions of another party;<sup>14</sup>;
    - (ii) "fraudulent practice" is any act or omission, including a misrepresentation, that knowingly or recklessly misleads, or attempts to mislead, a party to obtain a financial or other benefit or to avoid an obligation; 15
    - (iii) "collusive practice" is an arrangement between two or more parties designed to achieve an improper purpose, including to influence improperly the actions of another party;<sup>16</sup>
    - (iv) "coercive practice" is impairing or harming, or threatening to impair or harm, directly or indirectly, any party or the property of the party to influence improperly the actions of a party;<sup>17</sup>

<sup>&</sup>lt;sup>13</sup> In this context, any action to influence the procurement process or contract execution for undue advantage is improper.

For the purpose of this sub-paragraph, "another party" refers to a public official acting in relation to the procurement process or contract execution. In this context, "public official" includes World Bank staff and employees of other organizations taking or reviewing procurement decisions.

For the purpose of this sub-paragraph, "party" refers to a public official; the terms "benefit" and "obligation" relate to the procurement process or contract execution; and the "act or omission" is intended to influence the procurement process or contract execution.

For the purpose of this sub-paragraph, "parties" refers to participants in the procurement process (including public officials) attempting either themselves, or through another person or entity not participating in the procurement or selection process, to simulate competition or to establish bid prices at artificial, non-competitive levels, or are privy to each other's bid prices or other conditions.

For the purpose of this sub-paragraph, "party" refers to a participant in the procurement process or contract execution.

- (v) "obstructive practice" is:
  - deliberately destroying, falsifying, altering, or concealing of evidence material to the investigation or making false statements to investigators in order to materially impede a Bank investigation into allegations of a corrupt, fraudulent, coercive or collusive practice; and/or threatening, harassing or intimidating any party to prevent it from disclosing its knowledge of matters relevant to the investigation or from pursuing the investigation, or
  - (bb) acts intended to materially impede the exercise of the Bank's inspection and audit rights provided for under paragraph 1.16(e) below.
- (b) will reject a proposal for award if it determines that the bidder recommended for award, or any of its personnel, or its agents, or its sub-consultants, sub-contractors, service providers, suppliers and/or their employees, has, directly or indirectly, engaged in corrupt, fraudulent, collusive, coercive, or obstructive practices in competing for the contract in question;
- (c) will declare misprocurement and cancel the portion of the loan allocated to a contract if it determines at any time that representatives of the Borrower or of a recipient of any part of the proceeds of the loan engaged in corrupt, fraudulent, collusive, coercive, or obstructive practices during the procurement or the implementation of the contract in question, without the Borrower having taken timely and appropriate action satisfactory to the Bank to address such practices when they occur, including by failing to inform the Bank in a timely manner at the time they knew of the practices;
- (d) will sanction a firm or individual, at any time, in accordance with the prevailing Bank's sanctions procedures, including by publicly declaring such firm or individual ineligible, either indefinitely or for a stated period of time: (i) to be awarded a Bank-financed contract; and (ii) to be a nominated 19;
- (e) will require that a clause be included in bidding documents and in contracts financed by a Bank loan, requiring bidders, suppliers and contractors, and their subcontractors, agents, personnel, consultants, service providers, or suppliers, to permit the Bank to inspect all accounts, records, and other documents relating to the submission of bids and contract performance, and to have them audited by auditors appointed by the Bank."

A firm or individual may be declared ineligible to be awarded a Bank financed contract upon: (i) completion of the Bank's sanctions proceedings as per its sanctions procedures, including, inter alia, cross-debarment as agreed with other International Financial Institutions, including Multilateral Development Banks, and through the application the World Bank Group corporate administrative procurement sanctions procedures for fraud and corruption; and (ii) as a result of temporary suspension or early temporary suspension in connection with an ongoing sanctions proceeding. See footnote 14 and paragraph 8 of Appendix 1 of these Guidelines.

A nominated sub-contractor, consultant, manufacturer or supplier, or service provider (different names are used depending on the particular bidding document) is one which has either been: (i) included by the bidder in its pre-qualification application or bid because it brings specific and critical experience and know-how that allow the bidder to meet the qualification requirements for the particular bid; or (ii) appointed by the Borrower.

### SECTION IX. SPECIAL CONDITIONS OF CONTRACT

The following Special Conditions of Contract (SCC) shall supplement and / or amend the General Conditions of Contract (GCC). Whenever there is a conflict, the provisions herein shall prevail over those in the GCC.

GCC 1.1(j)	The Purchaser is: Executive Engineer, Burdwan Investigation & Planning Division, I&W Directorate, Govt. of West Bengal  The Engineer In-Charge is: Executive Engineer, Damodar Head Works Division, I&WD, D.V.C New Colony, Durgapur-2, Dist. Paschim Burdwan  (Executive Engineer, Durgapur Mechanical & Electrical Division will provide necessary technical support to the concerned Executive Engineer for implementation of SCADA under NHP)
GCC 1.1 (o)	The Project Site(s)/Final Destination(s) is/are: at (i) Durgapur Barrage site, (ii) office of the Executive Engineer, Durgapur Head Works Division, (iii) Asansol and (iv) Head office of Irrigation & Waterways Directorate, Salt Lake, Kolkata.
GCC 4.2 (a)	The meaning of the trade terms shall be as prescribed by Incoterms.
GCC 4.2 (b)	The version edition of Incoterms shall be 2010.

#### **GCC 8.1**

For **notices**, the Purchaser's address shall be:

Attention: Executive Engineer, Burdwan Investigation & Planning

Division, I&W Directorate, Govt. of West Bengal

Street Address: NH-2

Floor/ Room number: Purta Bhawan, 3rd Floor

City: *Burdwan*PINCode: 713103
Country: INDIA

Telephone: +91342-2646799

Facsimile number: +91342-2646799

Electronic mail address: eebipd2012@gmail.com

#### GCC 10.2

#### **Settlement of Disputes**

The dispute settlement mechanism to be applied for adhoc arbitration shall be as follows:

- (a) In case of Dispute or difference arising between the Purchaser and a domestic supplier relating to any matter arising out of or connected with this agreement, such disputes or difference shall be settled in accordance with the Arbitration and Conciliation Act, 1996 as amended up-to-date. The arbitral tribunal shall consist of 3 arbitrators one each to be appointed by the Purchaser and the Supplier. The third Arbitrator shall be chosen by the two Arbitrators so appointed by the Parties and shall act as Presiding arbitrator. In case of failure of the two arbitrators appointed by the parties to reach upon a consensus within a period of 30 days from the appointment of the arbitrator appointed subsequently, the Presiding Arbitrator shall be appointed by the \*/president of the institution of Engineers (India), Kolkata
- (b) In the case of a dispute with a Foreign Supplier, the dispute shall be settled in accordance with provisions of UNCITRAL (United nations Commission on International Trade Law) Arbitration Rules. The Arbitral Tribunal shall consist of three Arbitrators one each to be appointed by the Purchaser and the Supplier. The third Arbitrator shall be chosen by the two Arbitrators so appointed by the parties, and shall act as presiding arbitrator. In case of failure of the two arbitrators appointed by the parties to reach upon a consensus within a period of 30 days from the appointment of the arbitrator appointed subsequently, the Presiding Arbitrator shall be appointed by the \* President of the Institution of Engineers (India)/
- (c) If one of the parties fails to appoint its arbitrator in pursuance of sub-clause (a) and (b) above, within 30 days after receipt of the notice of the appointment of its arbitrator by the other party, then the \*Indian Council of Arbitration/president of the Institution of Engineers (India)/The International Centre for Alternative Dispute Resolution (India), both in cases of the Foreign supplier as well as Indian supplier, shall appoint the arbitrator. A certified copy of the order of the President of the Institution of Engineers (India) Kolkata, making such an appointment shall be furnished to each of the parties.
- (d) Arbitration proceedings shall be held at \_\_\_\_\_Kolkata\_\_\_\_India, and the language of the arbitration proceedings and that of all documents and communications between the parties shall be English.
- (e) The decision of the majority of arbitrators shall be final and binding upon both parties. The cost and expenses of Arbitration proceedings will be paid as determined by the arbitral tribunal. However, the expenses incurred by each party in connection with the preparation, presentation etc. of its proceedings as also the fees and expenses paid to the arbitrator appointed by such party or on its behalf shall be borne by each party itself.
- (f) Where the value of the contract is Rs. 10 million and below, the disputes or differences arising shall be referred to the Sole Arbitrator. The Sole Arbitrator should be appointed by agreement between the parties; failing such agreement, by the appointing authority namely the \*Indian Council of Arbitration/President of the Institution of Engineers (India)/The International Centre for Alternative Dispute Resolution (India).
- (g) Except otherwise agreed to by the Parties, Arbitrators should give a decision in writing within 120 days of receipt of notification of dispute.

#### GCC 12.1 and The scope of supply for the Goods and Related Services to be supplied shall be as specified below: Scope of the supply including the related 25.2 services is listed in Table-1 & 2 of the Schedule of requirements and detailed in **Technical Specifications** (Section VII) Details of Shipping and other Documents to be furnished by the Supplier GCC 13.1 are given below: GCC 13.1 Upon delivery of the goods to the transporter/consignee, the supplier shall notify the purchaser and mail the following documents to the Purchaser: (i) Four (4) Copies of the Supplier invoice showing contract number, goods description, quantity, unit price, total amount; Delivery note, Railway receipt, or Road consignment (ii) equivalent transport document acknowledgement of receipt of goods from the Consignee; Four (4) Copies of packing list identifying contents of (iii) each package; (iv) Insurance certificate: Manufacturer's/Supplier's warranty certificate; (v) (vi) Inspection certificate issued by the nominated inspection agency, and the Supplier's factory inspection report; and (vii) Certificate or origin. The above documents shall be received by the Purchaser before arrival of the Goods (except where it is handed over to the Consignee with all documents) and if not received, the supplier will be responsible for any consequent expenses.

GCC 14.1	ADD to GCC 14.1;	
	The supplier is responsible for and obliged to conduct all contracted activities in accordance with the contract using state- of- the- art methods and economic principles and exercising all means available to achieve the performance specified in the Contract. The Supplier is obliged to work closely with the Purchaser's staff, act within its own authority and abide by directives issued by the Purchaser and implementation activities. The Supplier will abide by the job safety measures prevalent in India and will free the Purchaser from all demands or responsibilities arising from accidents or loss of life the cause of which is the supplier's negligence. The Supplier will pay all indemnities arising from such incidents and will not holding the activities of its personnel or sub- contracted personnel and will hold itself responsible for any misbehavior/ misconduct. The Supplier will treat as confidential all data and information about the purchaser, obtained in the execution of his responsibilities, in strict confidence and will not reveal such information to any other party without the prior written approval of the Purchaser.	
GCC 15.1		
	The prices charged for the Goods supplied and the related Services performed "shall not," be adjustable.	
GCC 16.1	GCC 16.1 Payment shall be made in Indian Rupees in the following manner:	

(i) 10% of Contract Price as advance payment against Bank Guarantee

(Note: Contract Price does not include any taxes or levies, as may be applicable and treated separately)

- (ii) On Delivery, Installation and testing: The 40 (Forty) percent of the "Contract Price" plus GST amount charged in invoice, shall be paid to the Supplier within 60 (sixty) days after the date of the Installation Certificate issued by the Purchaser's representative for the respective delivery.
- iii) On commissioning and final Acceptance: The 20 (Twenty) percent of the "Contract Price" plus GST amount charged in invoice, shall be paid to the Supplier within 60 (sixty) days after the date of the Final Acceptance Certificate issued by the Purchaser's representative for the respective delivery.

Advance payment of 10% paid against Bank Guarantee will be adjusted in 40% payment paid on Delivery and installation as stated above.

- iv) On the satisfactory completion of First year of warranty and Operation & Maintenance: the 8 (eight) percent of the "Contract Price" plus GST amount charged in invoice, shall be paid to the Supplier within 60 (sixty) days after the date of the completion of first year of Warranty and Operation & Maintenance period after Final Acceptance Certificate. Satisfactory completion is deemed if performance criteria as defined in section VI clause 4 are fulfilled.
- v) On the satisfactory completion of Second year of warranty and Operation & Maintenance: the 8 (eight) percent of the "Contract Price" plus GST amount charged in invoice, shall be paid to the Supplier within 60 (sixty) days after the date of the completion of second year of Warranty and Operation & Maintenance period after Final Acceptance Certificate. Satisfactory completion is deemed if performance criteria as defined in section VI, 3. Technical Specification under clause 4 are fulfilled.
- vi) On the satisfactory completion of Third year of warranty and Operation & Maintenance: the 8 (eight) percent of the "Contract Price" plus GST amount charged in invoice, shall be paid to the Supplier within 60 (sixty) days after the date of the completion of third year of Warranty and Operation & Maintenance period after Final Acceptance Certificate. Satisfactory completion is deemed if performance criteria as defined in section VI, 3. Technical Specification under clause 4 are fulfilled.
- vii) On the satisfactory completion of Fourth year of warranty and Operation & Maintenance: the 8 (eight) percent of the "Contract Price" plus GST amount charged in invoice, shall be paid to the Supplier within 60 (sixty) days after the date of the completion of fourth year of Warranty and Operation & Maintenance period after Final Acceptance Certificate. Satisfactory completion is deemed if performance criteria as defined in section VI, 3. Technical Specification under clause 4 are fulfilled.
- viii) On the satisfactory completion of Fifth year of warranty and Operation & Maintenance: the 8 (eight) percent of the "Contract Price" plus GST amount charged in invoice, shall be paid to the Supplier within 60 (sixty) days after the date of the completion of fifth year Warranty and Operation & Maintenance period after Final Acceptance Certificate. Satisfactory completion is deemed if performance criteria as defined in section VI, 3. Technical Specification under clause 4 are fulfilled.

The Income Tax and surcharges, if applicable, will be deducted from the payments due to the Supplier.

- a) The Suppliers request for payment with invoice in triplicate and the Acceptance certificate for each equipment should be sent to the Purchaser's representative i.e. "Executive Engineer, Burdwan Investigation & Planning Division, I&W Directorate, Govt. of West Bengal".
- b) Payment of Local Taxes such as GST will be against valid Invoice as per GSTACT & Rules and submission of GST Registration Certificate along with declaration that GST Registration is valid and all liabilities towards GST have been discharged by the vendor. GST amount will be paid after 30 days of submission of valid Invoice and all required documents and declaration by vendor.

The Supplier shall indicate in the Price Schedules specifying all items prices shown therein including the unit prices and total prices of the goods and related services along with GST or any other duties and taxes applicable against the schedule of requirements. GST if leviable shall be paid as applicable. Any statutory variation shall be paid on submission of documentary evidence. Suppliers shall be required to quote HSN code and applicable tax rates.

	<ul> <li>"GST" means all four Acts CGST, SGST, UTGST, IGST and any other regulations by Government in relation to GST and rules thereto.</li> <li>c) <ul> <li>i) For all the payments to be made, against Bank guarantees, the bank guarantee shall be issued by a Scheduled Indian Bank or a foreign bank located in India in the format enclosed at Section X. The guarantees issued by other banks should be confirmed by a Scheduled Indian Bank or a foreign bank operating in India.</li> <li>ii) Bank guarantees for advance payment shall be released not later than 30 days after the date of completion of supply of the goods at their final destination.</li> </ul> </li> </ul>
GCC 16.5	The payment-delay period after which the Purchaser shall pay interest to the supplier shall be 60 days.
GCC 17	The interest rate that shall be applied is 4 %.  In the case of tax/ duty waiver, the purchaser will issue only the certificates in terms of the Government of India's notification as per information given by supplier in form stipulated in Section IV. Supplier is solely responsible for obtaining such benefits and in case of failure to receive such benefits; the purchaser will not compensate the supplier separately.
GCC 18.1	Within 21 days of notification of award, the supplier shall furnish the Performance Security to the Purchaser shall be for an amount of 10% of the Contract value, valid upto 60 days after the date of completion of performance obligations including warranty obligations.  In the event of any correction of defects or replacement of defective material during the warranty period, the warranty for the corrected/replaced material shall be extended to a further period of 12 months and the Performance Bank guarantee for proportionate value shall be extended 60 days over and above the extended warranty period.
GCC 18.3	If required, the Performance Security shall be in the form of a "Bank Guarantee" or "a cashier's cheque or banker's certified cheque or crossed demand draft or pay order" drawn in favour of the Purchaser, 'The Executive Engineer, Burdwan I&P Division'.

GCC 18.4	Discharge of the performance Security shall take place not later than 60 days following the date of completion of the Supplier's performance obligations, including the warranty obligation, under the contract.
GCC 18.5	Add as Clause 18.5 to the GCC the following:  In the event of any Contractual amendment, the Supplier shall, within 28 days of receipt of such amendment, furnish the amendment to the Performance Security, rendering the same valid for the duration of the Contract, as amended for 60 days after the completion of performance obligations including warranty services obligations.
GCC 23.2	Packing Instructions: The Supplier will be required to make separate packages for each Consignee. Each package will be marked on three sides with proper paint/indelible ink with the following:  (i) Project; (ii) Contract No.; (iii) Country of Origin of Goods; (iv) Supplier's Name; (v) Packing List Reference Number.  Suppliers should use recycled materials as much as possible for packing
GCC 24.1	The insurance shall be paid in an amount equal to 110 percent of the EXW value of the Goods from "Warehouse to warehouse (final destination)" on "All Risks" basis including War Risks and Strikes.
GCC 25.1	The Supplier is required under the Contract to transport the Goods duly insured to the specified final destination, and all related costs shall be included in the Contract Price.
GCC 25.2	Incidental services to be provided are: As stipulated in the 'Schedule of Requirements'.

GCC 26.1	The inspections and tests shall be as detailed in Para 5 of Section VI Schedule of Requirement:  The supplier shall get each item indicated in the Schedule of requirement inspected in manufacturer's works and submit a test certificate and also manufacturer's guarantee /warranty certificate that the items are conforms to the laid down specification.	
	The Purchaser or its representative may inspect and /or test any or all the items to confirm their conformity to the contract specification, prior to dispatch from the manufacturer's premises. Such inspection and clearance will not prejudice the right of the consignee to inspect and test the items on receipt at destination to verify conformity to technical specification.	
	If the items are fails to meet the laid down specifications the supplier shall take immediate steps to remedy the deficiency or replace the defective parts of the each to the satisfaction of the purchaser/consignee	
GCC 26.2	The Inspections and tests shall be conducted at: As stipulated in the 'Schedule of Requirements'.	
GCC 27.1	The liquidated damages shall be: 0.5% of contract price per week or part thereof.	
GCC 27.2	The maximum amount of liquidated damages shall be: 10% of the contract price.	
GCC 28.3	The period of validity of the Warranty shall be Sixty (60) months after successful installation, testing, commissioning and acceptance. This includes seamless operation of SCADA system for Barrage. The warranty shall remain valid for Sixty (60) months after the Goods, or any portion thereof as the case may be, have been delivered to and accepted at the final destination.	

GCC 28.5	The period for repair or replacement shall be: 48 Hours/120 hrs. time required for bidder's maintenance engineers to restore the instrument or SCADA system shall not exceed 48 hours during monsoon and 120 hrs. during non-monsoon period. The performance of the system would be continuously monitored by the service engineer of the contractor deployed at the BCR who shall be responsible for detection of any fault in the SCADA & surveillance System. On detection of fault, the Contractor shall repair or replace the defective Goods or parts thereof, without cost to the Department within stipulated time of 48 hrs /120 hrs. It is the responsibility of the Supplier to rectify/replace the equipment without any notice from purchaser and it is the duty of its personnel i.e. dedicated service engineer cum data entry operator to notice that site become non-operational or become faulty. A system shall be treated as faulty if it fails to respond or transmits erroneous data during six consecutive pre-programmed observation cycles/3 hours. The decision of Engineer-in-Charge about errors in data shall be final and binding. If a remote site/ instrument continues to remain "fail" for more than 3 hours in excess of the maintenance time schedule of 48/120 hours. The contractor is liable to pay penalty @ Rs. 5000/- per Day/ during non-monsoon period and @Rs 10000/ per day during monsoon period (15th June to 15th October). The Day for the purpose of penalty shall be taken as failure period of 24 hours or part thereof for a particular remote site. The amount of penalty will be recovered from performance bank guarantee or payment due to bidder during warranty period.  Refer 4.35 "System Performance Criteria" for details of computation of Down time.	
GCC 28.6	The period shall be 14 days	
GCC 31.1	This clause will apply only to variations in GST and other taxes payable in India on the final product which is being supplied and not for variations	
	in tax on the individual components / raw materials which go into the product.	
GCC 37	Add the following additional sub clauses.	
	37.1 Supplier integrity:  The supplier is responsible for and obliged to conduct all contracted activities in accordance with the contract using state- of- the- art methods and economic principles and exercising all means available to achieve the performance specified in the Contract.	

#### 37.2

#### Supplier's obligations:

The Supplier is obliged to work closely with the Purchaser's staff, act within its own authority and abide by directives issued by the Purchaser and implementation activities.

The Supplier will abide by the job safety measures prevalent in India and will free the Purchaser from all demands or responsibilities arising from accidents or loss of life the cause of which is the supplier's negligence. The Supplier will pay all indemnities arising from such incidents and will not hold the purchaser responsible or obligated.

The Supplier is responsible for managing the activities of its personnel or sub-contracted personnel and will hold itself responsible for any misdemeanors.

The Supplier will treat as confidential all data and information about the purchaser, obtained in the execution of his responsibilities, in strict confidence and will not reveal such information to any other party without the prior written approval of the Purchaser.

#### 37.3

#### Site preparation and installation

The supplier is responsible for associated civil work required for installation and commissioning of the supplies in the Schedule of Requirement under the heading of Relative services

#### 37.4

#### Hardware installation:

The Supplier is responsible for all unpacking, assemblies, wiring, installations, cabling between hardware units and connecting to power supplies. The Supplier will test all hardware operations and accomplish all adjustments necessary for successful and continuous operation of the hardware at all installation sites.

Attachment: Price Adjustment Formula Not applicable

SECTION X – CONTRACT FORMS

### 1. LETTER OF ACCEPTANCE

[letterhead paper of the Purchaser]
[date] To: [name and address of the Supplier]
Subject: Notification of Award Contract No
This is to notify you that your Bid dated [insert date] for execution of the [insert name of the contract and identification number, as given in the SCC] for the Accepted Contract Amount of [insert amount in numbers and words in Rupees], as corrected and modified in accordance with the Instructions to Bidders is hereby accepted by our Agency.
You are requested to furnish the Performance Security within 21 days in accordance with the Conditions of Contract, using for that purpose the of the Performance Security Form included in Section X, Contract Forms of the Bidding Document.
Authorized Signature:

**Attachment: Contract Agreement** 

#### 2. CONTRACT AGREEMENT

[The successful Bidder shall fill in this form in accordance with the instructions indicated]

#### THIS CONTRACT AGREEMENT is made

the [insert: number] day of [insert: month], [insert: year].

#### **BETWEEN**

- (1) [insert complete name of Purchaser], a [insert description of type of legal entity, for example, an agency of the Ministry of .... of the Government of {insert name of Country of Purchaser}, or corporation incorporated under the laws of {insert name of Country of Purchaser}] and having its principal place of business at [insert address of Purchaser] (hereinafter called "the Purchaser"), and
- [ insert name of Supplier], a corporation incorporated under the laws of [ insert: country of Supplier] and having its principal place of business at [ insert: address of Supplier] (hereinafter called "the Supplier").

WHEREAS the Purchaser invited bids for certain Goods and ancillary services, viz., [insert brief description of Goods and Services] and has accepted a Bid by the Supplier for the supply of those Goods and Services in the sum of [insert Contract Price in words and figures, expressed in Rs] (hereinafter called "the Contract Price").

#### NOW THIS AGREEMENT WITNESSETH AS FOLLOWS:

- 1. In this Agreement words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract referred to.
- 2. The following documents shall constitute the Contract between the Purchaser and the Supplier, and each shall be read and construed as an integral part of the Contract Agreement. This Agreement shall prevail over all other contract documents: In the event of any discrepancy or inconsistency within the Contract documents, then the documents shall prevail in the order listed below.
- (a) The letter of Acceptance
- (b) this Contract Agreement
- (c) Letter of Bid Technical Part
- (d) The Supplier's letter of Bid Financial Part and original completed Schedules including Price Schedules
- (e) Special Conditions of Contract
- (f) General Conditions of Contract

- (g) Technical Requirements (including Schedule of Requirements and Technical Specifications)
- (h) [Add here any other document(s)listed in GCC/SCC as part of contract]
- 3. In consideration of the payments to be made by the Purchaser to the Supplier as hereinafter mentioned, the Supplier hereby covenants with the Purchaser to provide the Goods and Services and to remedy defects therein in conformity in all respects with the provisions of the Contract.
- 4. The Purchaser hereby covenants to pay the Supplier in consideration of the provision of the Goods and Services and the remedying of defects therein, the Contract Price or such other sum as may become payable under the provisions of the Contract at the times and in the manner prescribed by the Contract.

IN WITNESS whereof the parties hereto have caused this Agreement to be executed in accordance with the laws of [insert the name of the Contract governing law country] on the day, month and year indicated above.

For and on behalf of the Purchaser

Signed: [insert signature] in the capacity of [insert title or other appropriate designation] in the presence of [insert identification of official witness]

For and on behalf of the Supplier

Signed: [insert signature of authorized representative(s) of the Supplier] in the capacity of [insert title or other appropriate designation] in the presence of [insert identification of official witness]

## **3. Performance Security - Bank Guarantee** [Guarantor letterhead or SWIFT identifier code]

	mance Guarantee No[insert guarantee reference number][insert date of issue of the guarantee]
То:	[name of Purchaser]
	[address of Purchaser]
execute	WHEREAS [name and address of Supplier <sup>20</sup> ] (hereinafter called pplicant") has undertaken, in pursuance of Contract No dated to e [name of Contract and brief description of Goods and related as [where it is a second contract] (hereinafter called "the Contract");
	AND WHEREAS it has been stipulated by you in the said Contract that the Applicant shall you with a Bank Guarantee by a recognized bank for the sum specified therein as security for ance with his obligations in accordance with the Contract;
	AND WHEREAS we have agreed to give the Applicant such a Bank Guarantee;
	NOW THEREFORE we hereby affirm that we are the Guarantor and responsible to you, on of the Applicant, up to a total of [amount of guarantee <sup>21</sup> ] [in words], such sum being payable in the types and proportions of
currence demand [amour	ties in which the Contract Price is payable, and we undertake to pay you, upon your first written d and without cavil or argument, any sum or sums within the limits of
present	We hereby waive the necessity of your demanding the said debt from the Applicant before ing us with the demand.

 $<sup>^{20}</sup>$ In the case of a JV, insert the name of the Joint Venture

<sup>&</sup>lt;sup>21</sup>An amount shall be inserted by the Guarantor, representing the percentage of the Contract Price specified in the Contract and denominated in Indian Rupees.

We further agree that no change or addition to or other modification of the terms of the Contract or of the Goods and related Services to be supplied thereunder or of any of the Contract documents which may be made between you and the Applicant shall in any way release us from any liability under this guarantee, and we hereby waive notice of any such change, addition or modification.

This guarantee shall be valid until ....... (i.e.) 60 days following the Completion date of the Contract including any warranty obligations<sup>22</sup>, and any demand for payment under it must be received by us at this office on or before that date.

Signature and seal of the guarantor	
Name of Bank	
Address	
Date	

Note: All italicized text (including footnotes) is for use in preparing this form and shall be deleted from the final product.

 $<sup>^{\</sup>rm 22}$  Completion date as described in GC Clause 18.4

### **4.Advance Payment Security**

#### **Demand Guarantee**

[Guarantor letterhead or SWIFT identifier code]

Advance Payment Guarantee No[insert guarantee reference number]  Date[insert date of issue of the guarantee]	
To:[name of Purchaser]	
[address of Purchaser]	
[name of Contract]	
Gentlemen:	
In accordance with the provisions of the Conditions of Contract, Clause 16 ("Terms of Payment" of the above-mentioned Contract, [name and address of Supplier <sup>23</sup> ] (hereinafter called "the Applicant") shall deposit with [name of Purchaser] a bank guarantee to guarantee his proper and faithful performance under the said Clause of the Contract in an amount of [amount of guarantee <sup>24</sup> ] [in words].	f f f
We, the [bank or financial institution], as instructed by the Applicant agree unconditionally and irrevocably to guarantee as primary obligator and not as Surety merely, the payment to [name of Purchaser] on his first demand without whatsoever right of objection on our part and without his first claim to the Applicant, in the amount not exceeding [amount of guarantee] [in words].	e
We further agree that no change or addition to or other modification of the terms of the Contract or of Goods and related Services to be supplied thereunder or of any of the Contract documents which may be made between [name of Purchaser] and the Applicant, shall in any way release us from any liability under this guarantee, and we hereby waive notice of any such change addition or modification.	n y

 $<sup>^{23}\</sup>mbox{In}$  the case of a JV, insert the name of the Joint Venture

<sup>&</sup>lt;sup>24</sup>An amount shall be inserted by the bank representing the amount of the Advance Payment, and denominated in Indian Rupees.

This guarantee shall remain val	id and in full effect from the date of the advance payment under
the Contract until	[name of Purchaser] receives full repayment of the
same amount from the Applicant. Cons	sequently any demand for payment under this guarantee must be
received by us at this office on or before	that date.
	Yours truly,
	Signature and seal:
	Name of Donks
	Name of Bank:
	Address:
	Date:

Note: All italicized text (including footnotes) is for use in preparing this form and shall be deleted from the final product.